

UAE CABLE®



Full Arabic legal name
Full English legal name

يولان لصناعة الكابلات الكهربائية ذ.م.م
YU LAN ELECTRICAL CABLE MANUFACTURING
LLC

الاسم القانوني الكامل باللغة العربية
الاسم القانوني الكامل باللغة الانجليزية

Registered address

UMM THAOB 7, UNION STREET, UMM THAOB,
UMM AL QUWAIN, Umm Al-Quwain, United
Arab Emirates, 39371, +971547116666

العنوان المسجل

Tax Registration Number

100556645800003

رقم التسجيل الضريبي

Note: that this product is for export only, not for use in UAE

UAECABLE®



EXPORTED TO IRAQ, YEMEN, CONGO,
SOMALIA, MALI, NAGA, MAURITANIA
MORE THAN 30 COUNTRIES

INDEX

Chairman's Message

03

INTRODUCTION

05

QUALITY CONTROL & R&D SOLUTIONS

07

CERTIFICATIONS & APPROVALS

08

INDEX OF TABLES

09

PRODUCT RANGE

11

LVC ABLES

13

MDPE CABLES

22

MYC ABLES

30

LSF/LSZH CABLES

44

FIRE RESISTANT CABLES

53


INSTRUMENTATION CABLES

60

HUMAN RESOURCES

79

LAECABLE[®]

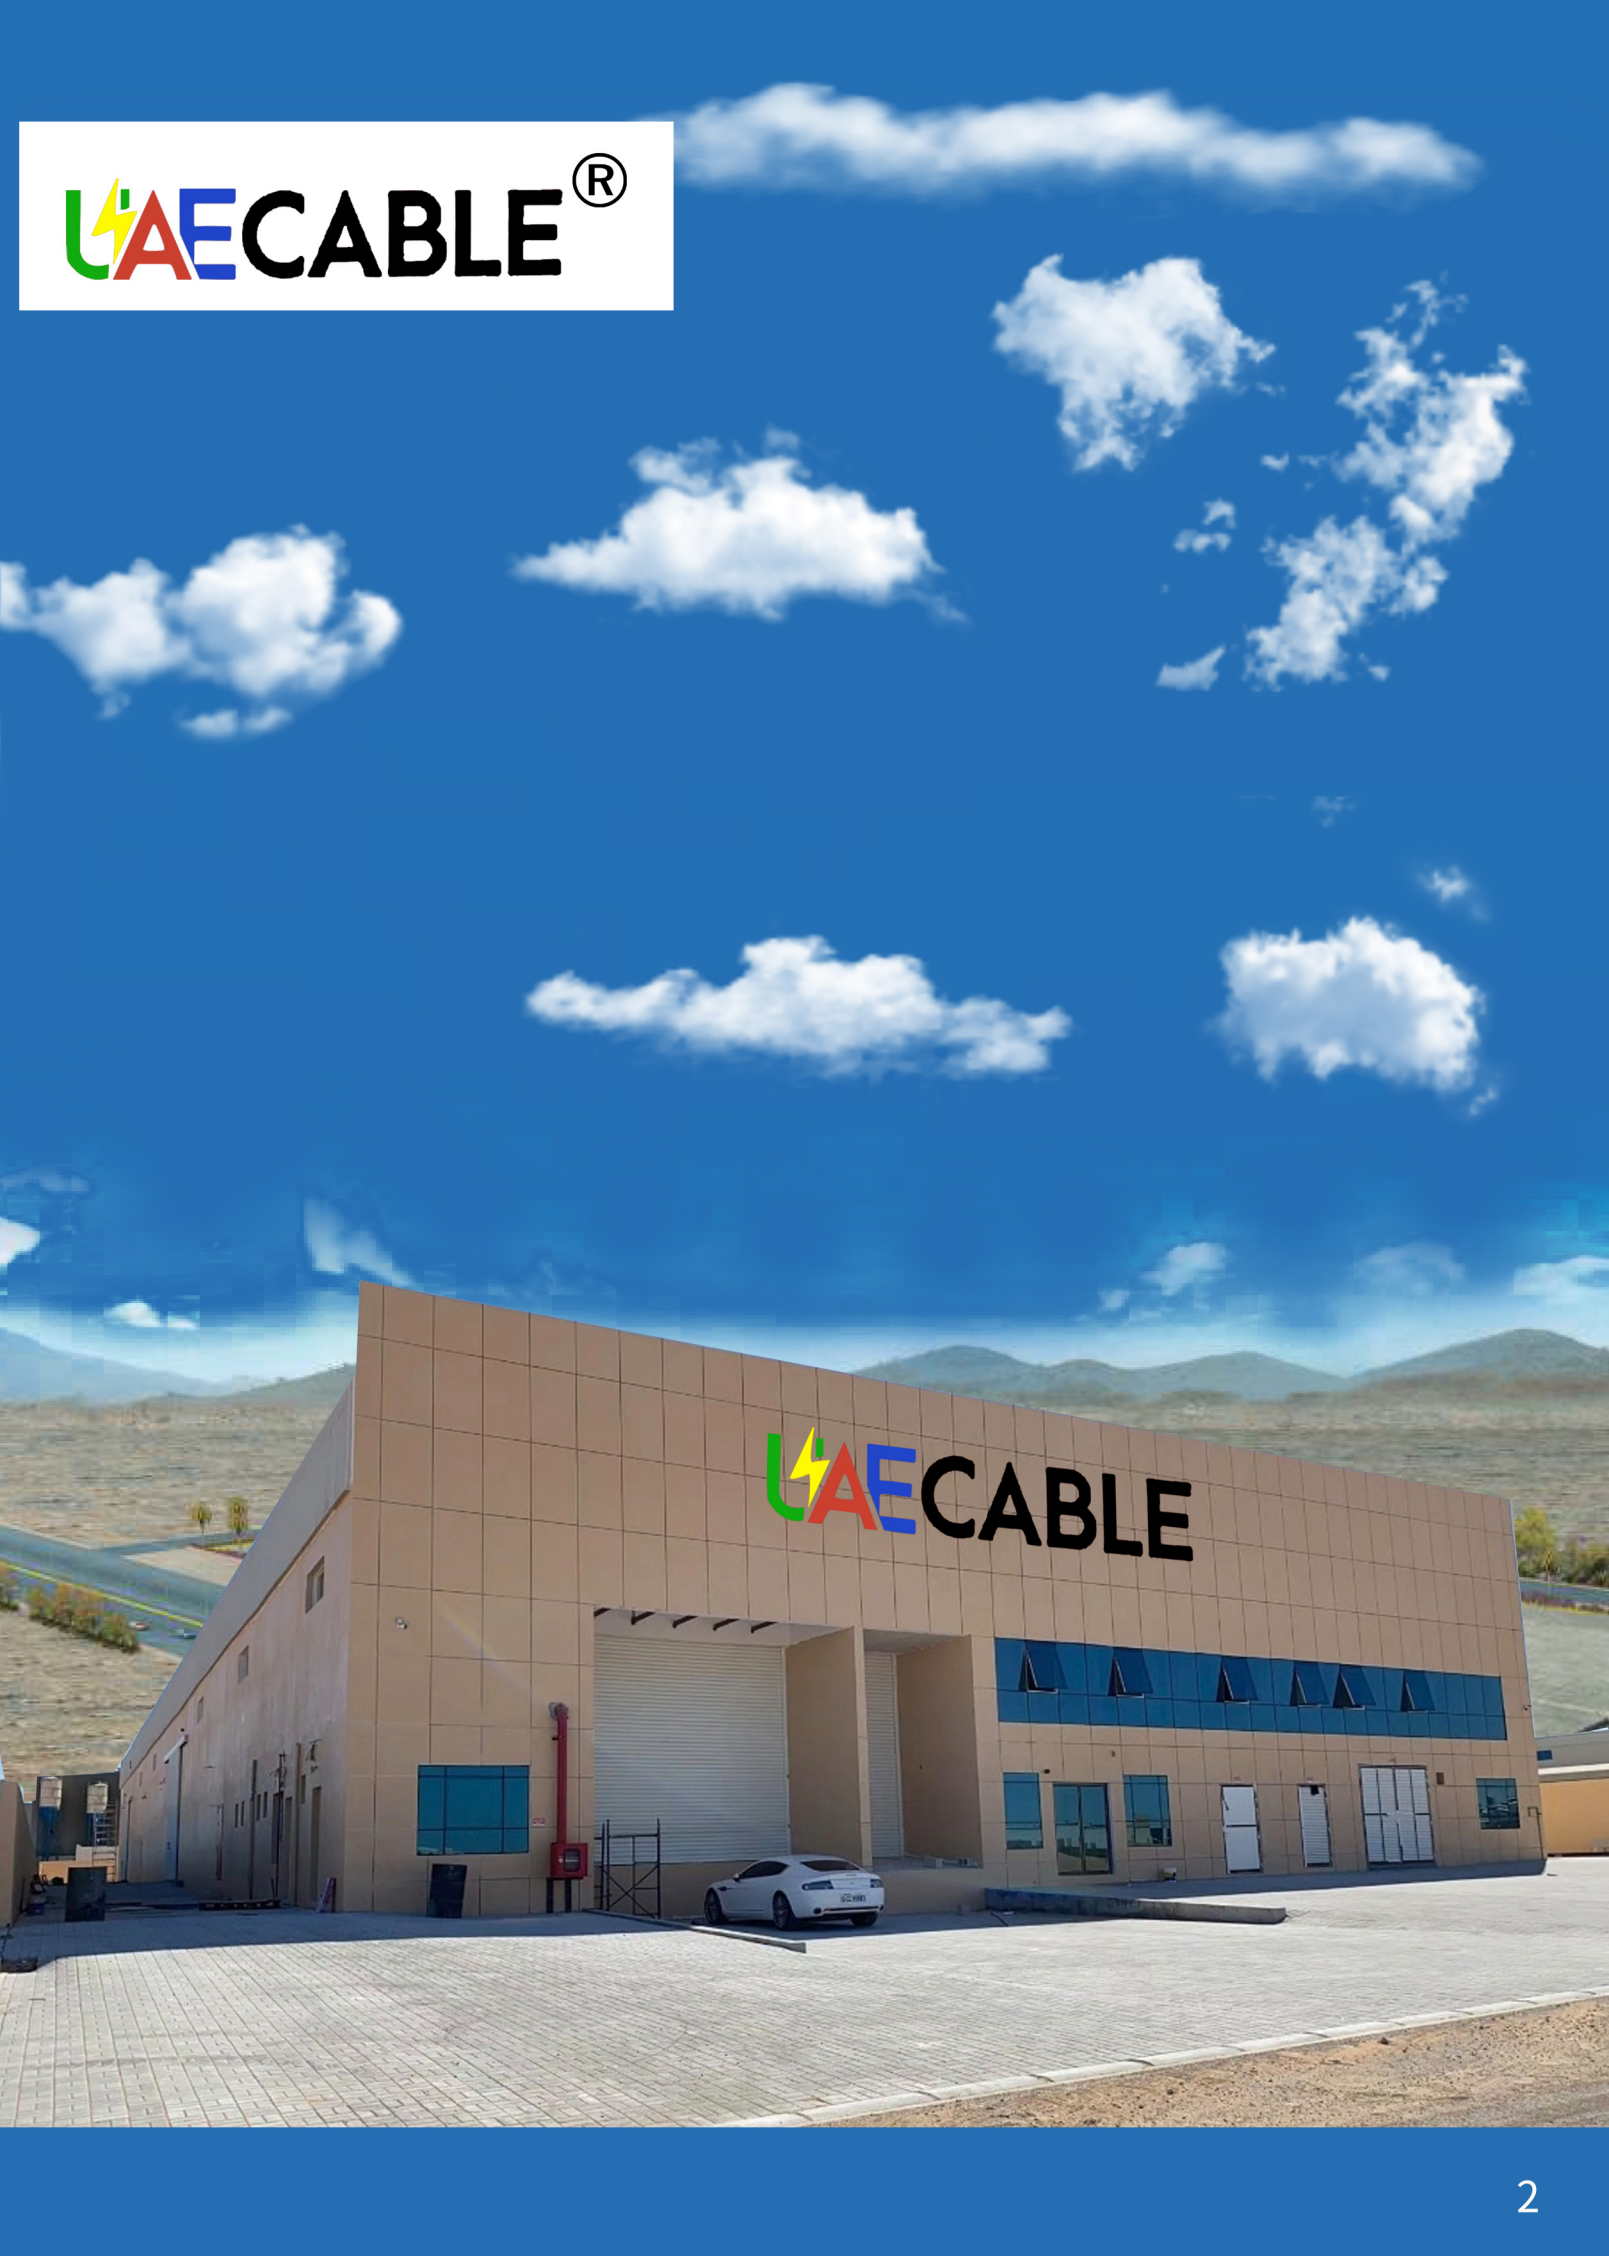




United Arab Emirates yulan Wire Factory is an Arab and Chinese joint venture wire and cable manufacturing enterprise located in Ebony Gaiwan Industrial Zone, United Arab Emirates. The predecessor of the company was established in Zhejiang, China in 1988, the company covers the upstream and downstream of wire and cable. Help customers in the Middle East, Africa and Asia to set up their own factories, jointly operate production, and upgrade manufacturing in local industries. The company covers cable equipment, wire and cable, power supply materials, used cable equipment sales and maintenance. Founded in Dubai in 2001, the company is a wire and cable supplier to more than 30 countries such as Iraq, Yemen, Congo, Somalia, Mali, Naga, Mauritania. Annual export wire and cable 500 containers. The company's brands include UAE CABLE, YULAN, YUCAB, and a dopo

UAE CABLE[®]




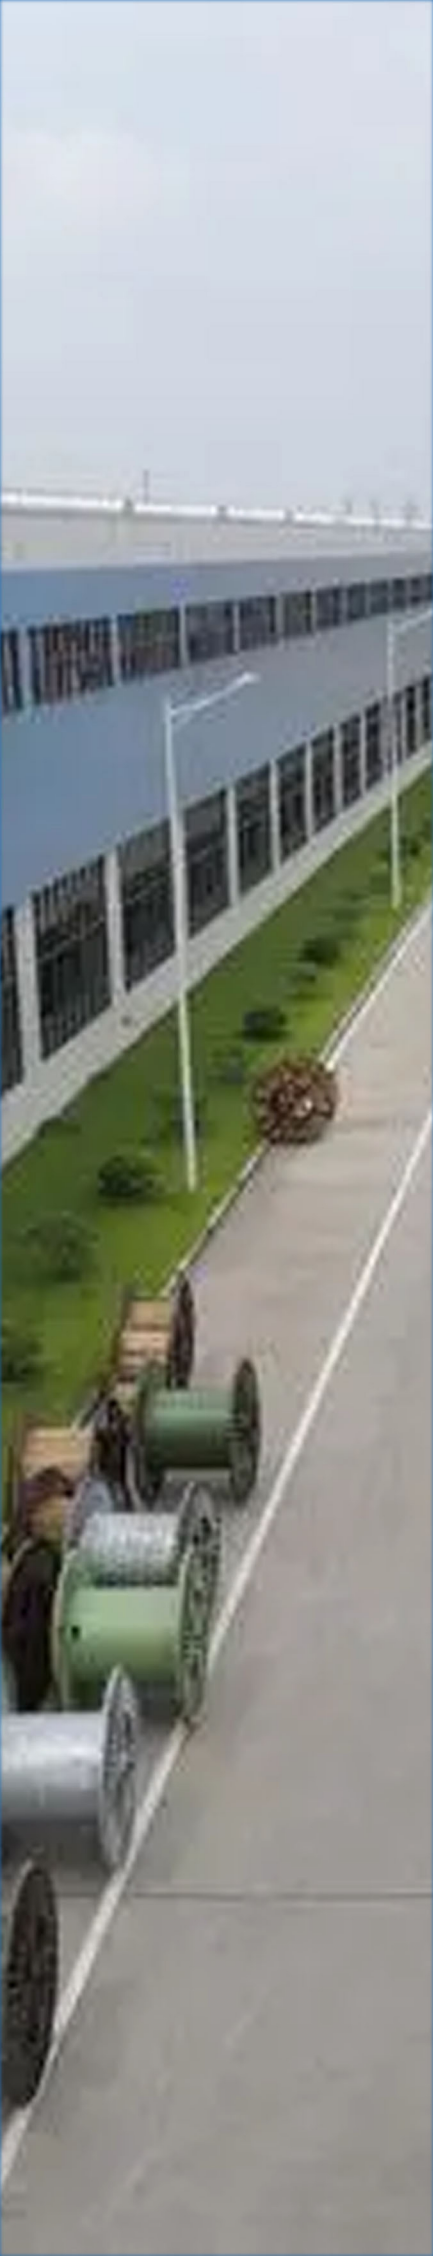


INTRODUCE

FOUNDED IN DUBAI IN 2001, THE COMPANY IS A WIRE AND CABLE SUPPLIER TO MORE THAN A DOZEN COUNTRIES SUCH AS IRAQ, YEMEN, CONGO, SOMALIA, MALI, NAGA, MAURITANIA. ANNUAL EXPORT WIRE AND CABLE 500 CONTAINERS.

COMBINING ITS OWN ADVANTAGES, THE COMPANY HAS COOPERATED WITH MORE THAN A DOZEN WIRE AND CABLE EQUIPMENT MANUFACTURING ENTERPRISES IN CHINA TO PROVIDE HIGH-QUALITY NEW EQUIPMENT AND SECOND-HAND EQUIPMENT SALES AND MAINTENANCE. CAN HELP THE MIDDLE EAST, AFRICA, ASIA WIRE FACTORY EQUIPMENT UPGRADE, MAINTENANCE.

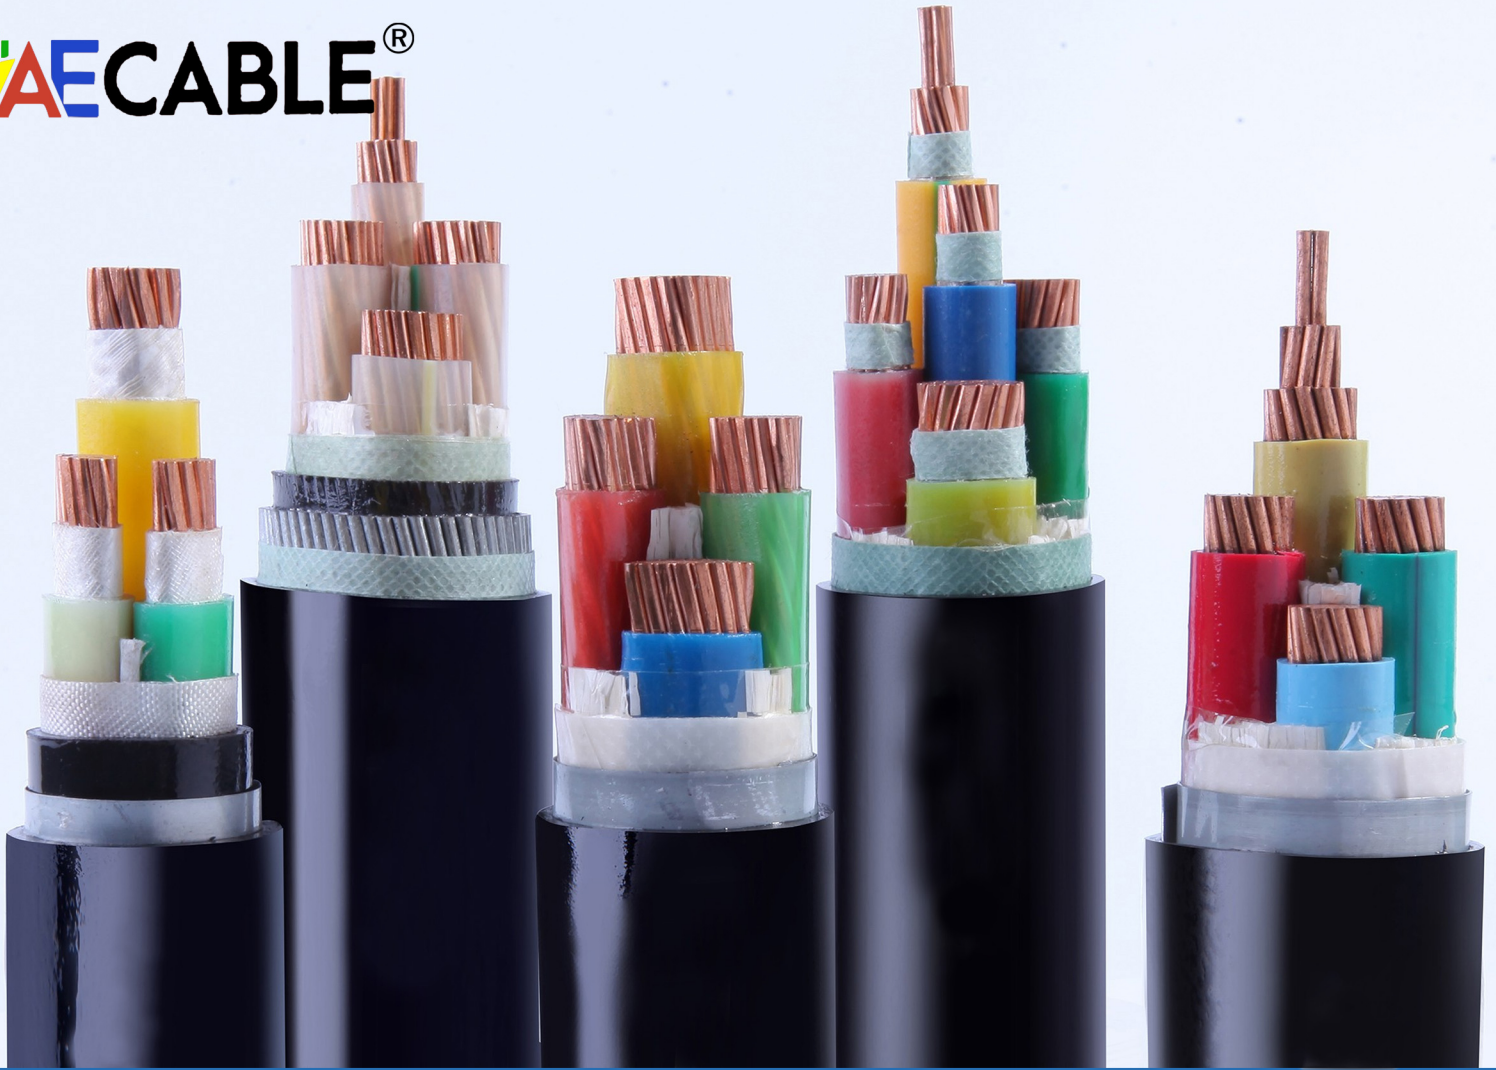

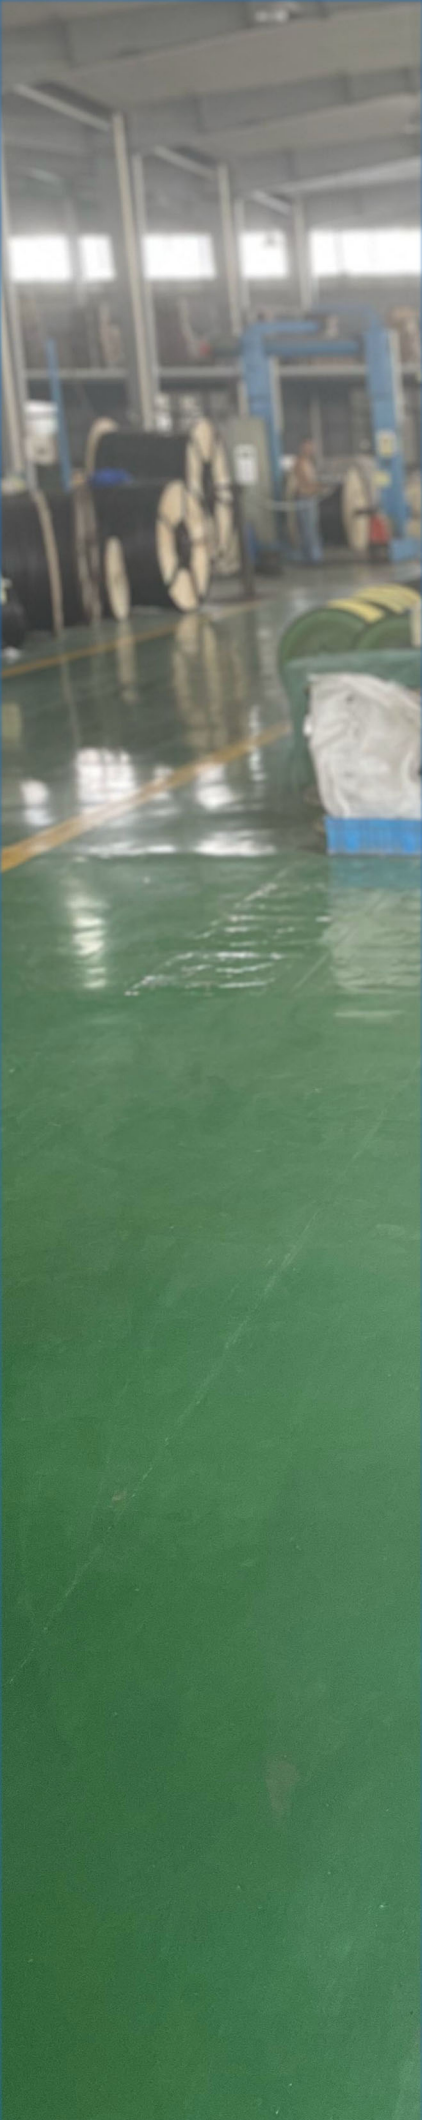

ENTERPRISE CULTURE

The company strictly refers to the international advanced management system, and has been rated as a contract-abiding and creditworthy unit for many years, high-tech enterprises, the company's brand wire and cable through long-term operation and verification, with stable quality, performance safety has won the trust of the majority of users and a good reputation, the company has been adhering to the mission of "let partners succeed", With the core values of "pragmatic gratitude, integrity and win-win" hand in hand with the majority of users and partners to create the great vision of "the most competitive enterprise" in the industry!

UNITED ARAB EMIRATES
MINISTRY OF ECONOMY

الإمارات العربية المتحدة
وزارة الاقتصاد

Trade Marks Department
إدارة العلامات التجارية

شهادة تسجيل علامة تجارية

عملاً بأحكام المادة 16 من القانون الاتحادي رقم 36 لسنة 2021 و تعديلاته بشأن تسجيل العلامات التجارية
تشهد وزارة الاقتصاد أن العلامة التجارية التي سبق تقديم طلب تسجيلها تحت رقم: 371825 بتاريخ: 2022/03/01
من قبل: جوشون زهنتج
الموطن:
ص ب 39371، دبي، أ.ع.م. صندوق البريد: 39371


صورة العلامة

UAE CABLE

اسم العلامة: UAE CABLE
رقم الفئة: 9 (بيان المنتجات موضح خلف الصفحة)
بيانات الأولوية: رقم طلب الأولوية: تاريخ الطلب: الجنسية:
قد تم تسجيلها بتاريخ: 2022/10/04
وسيظل التسجيل نافذ المفعول لمدة 10 عشر سنوات اعتباراً من 2022/03/01 وينتهي في: 2032/03/01
ويجوز تجديد الحماية وفقاً لأحكام المادة 19 من قانون العلامات التجارية لمعد متتالية أخرى كل منها عشر سنوات.

2022

مدير إدارة العلامات التجارية












بيان المنتجات الخاص بالعلامة المودعة تحت رقم 371825

لغة: 9 - الأجهزة والأدوات الطبية والملاحية والمساحية وأجهزة وأدوات التصوير الفوتوغرافي والسينمائي والأجهزة والأدوات البصرية
وأجهزة وأدوات الوزن والقياس والإشارة والمراقبة (الإشراف) والاتصال والتعليم، أجهزة وأدوات لوصول أو فتح أو تحويل أو تثبيت أو تنظيم أو
التحكم في الطاقة الكهربائية، أجهزة تسجيل أو إرسال أو نسخ الصوت أو الصور، حاملات بيانات مغناطيسية، أقراص تسجيل، ماكينات بيع البيرة
والبيات للأجهزة التي تعمل بتلعب النغمة، آلات تسجيل النغمة، آلات حاسبة، معدات وأجهزة حاسوب لمعالجة البيانات، أجهزة إخماد النيران









2022

تحريراً في: 2022 / 10 / 04






LV Cables




















	Table 1 - Single core wires, with solid or stranded Copper conductor, PVC Insulated.....	14
	Table 2 - Single core cable, Cu/XLPE/AWA/PVC, 600/1000V, conf. to BS: 5467.....	15
	Table 3 - Two core cable, Cu/XLPE/SWA/PVC, 600/1000V, conf. to BS: 5467.....	16
	Table 4 - Three core cable, Cu/XLPE/SWA/PVC, 600/1000V, conf. to BS: 5467.....	17
	Table 5 - Four core cable, Cu/XLPE/SWA/PVC, 600/1000V, conf. to BS: 5467.....	18
	Table 6 - Five core cable, Cu/XLPE/SWA/PVC, 600/1000V, conf. to BS: 5467.....	19
	Table 7 - Auxillary (Control) cable, 1.5mm ² , Cu/XLPE/SWA/PVC, 600/1000V, conf. to BS: 5467.....	20
	Table 8 - Auxillary (Control) cable, 2.5mm ² , Cu/XLPE/SWA/PVC, 600/1000V, conf. to BS: 5467.....	21
	Table 9 - Auxillary (Control) cable, 4mm ² , Cu/XLPE/SWA/PVC, 600/1000V, conf. to BS: 5467.....	21

MDPE Cables

	Table 10 - Single core cable, Cu/XLPE/AWA/MDPE, 600/1000V, generally to BS: 5467.....	22
	Table 11 - Two core cable, Cu/XLPE/SWA/MDPE, 600/1000V, generally to BS: 5467.....	23
	Table 12 - Three core cable, Cu/XLPE/SWA/MDPE, 600/1000V, generally to BS: 5467.....	24
	Table 13 - Four core cable, Cu/XLPE/SWA/MDPE, 600/1000V, generally to BS: 5467.....	25
	Table 14 - Five core cable, Cu/XLPE/SWA/MDPE, 600/1000V, generally to BS: 5467.....	26
	Table 15 - Auxillary (Control) cable, 1.5mm ² , Cu/XLPE/SWA/MDPE 600/1000V, generally to BS: 5467.....	27
	Table 16 - Auxillary (Control) cable, 2.5mm ² , Cu/XLPE/SWA/MDPE 600/1000V, generally to BS: 5467.....	28
	Table 17 - Auxillary (Control) cable, 4mm ² , Cu/XLPE/SWA/MDPE 600/1000V, generally to BS: 5467.....	28
	Tables 18 - 31 Group Rating Factors - LV & MDPE Cables.....	29

MV Cables

	Table 32: 3.6/6.0(7.2)kV Single core cable, Cu or Al Cond./XLPE/AWA/PVC, Conf. to IEC:60502-2.....	33
	Table 33: 3.6/6.0(7.2)kV Three core cable Cu or Al Cond./XLPE/SWA/PVC, conductor Conf. to IEC:60502-2.....	34
	Table 34: 6/10(12)kV Single core cable, Cu or Al Cond./XLPE/AWA/PVC, Conf. to IEC:60502-2.....	35
	Table 35: 6/10(12)kV Three core cable Cu or Al Cond./XLPE/SWA/PVC, Conf. to IEC:60502-2.....	36
	Table 36: 8.7/15(17.5)kV Single core cable, Cu or Al Cond./XLPE/AWA/PVC, Conf. to IEC:60502-2.....	37

	Table 37: 8.7/15(17.5)kV Three core cable Cu or Al Cond./XLPE/SWA/PVC, Conf. to IEC:60502-2.....	38
	Table 38: 12/20(24)kV Single core cable, Cu or Al Cond./XLPE/AWA/PVC, Conf. to IEC:60502-2.....	39
	Table 39: 12/20(24)kV Three core cable Cu or Al Cond./XLPE/SWA/PVC, Conf. to IEC:60502-2.....	40
	Table 40: 18/30(36)kV Single core cable, Cu or Al Cond./XLPE/AWA/PVC, Conf. to IEC:60502-2.....	41
	Table 41: 18/30(36)kV Three core cable Cu or Al Cond./XLPE/SWA/PVC, Conf. to IEC:60502-2.....	42
	Tables 42 - 53 Group Rating Factors - MV Cables.....	43
LSF/LSZH & Fire Resistant Cables		
	Table 54: Single Core Wires, solid or stranded copper conductor, LSF/LSZH insulated 450/750V, conf. to BS 7211....	45
	Table 55: Single core cable, Cu/XLPE/AWA, LSF/LSZH sheathed, 600/1000V, conf. to BS: 6724.....	46
	Table 56: Two core cable, Cu/XLPE/SWA, LSF/LSZH sheathed, 600/1000V, conf. to BS: 6724.....	47
	Table 57: Three core cable, Cu/XLPE/SWA, LSF/LSZH sheathed, 600/1000V, conf. to BS: 6724.....	48
	Table 58: Four core cable, Cu/XLPE/SWA, LSF/LSZH sheathed, 600/1000V, conf. to BS: 6724.....	49
	Table 59: Five core cable, Cu/XLPE/SWA, LSF/LSZH sheathed, 600/1000V, conf. to BS: 6724.....	50
	Table 60: Auxillary (Control) cable, 1.5mm ² , Cu/XLPE/SWA, LSF/LSZH sheathed, 600/1000V, conf. to BS: 6724.....	51
	Table 61: Auxillary (Control) cable, 2.5mm ² , Cu/XLPE/SWA, LSF/LSZH sheathed, 600/1000V, conf. to BS: 6724.....	52
	Table 62: Auxillary (Control) cable, 4mm ² , Cu/XLPE/SWA, LSF/LSZH sheathed, 600/1000V, conf. to BS: 6724.....	52
	Table 63: Two core Fire resistant cable, Cu/XLPE/SWA, LSF/LSZH sheathed, 600/1000V, conf. to BS: 7846.....	53
	Table 64: Three core Fire resistant cable, Cu/XLPE/SWA, LSF/LSZH sheathed, 600/1000V, conf. to BS: 7846.....	54
	Table 65: Four core Fire resistant cable, Cu/XLPE/SWA, LSF/LSZH sheathed, 600/1000V, conf. to BS: 7846.....	55
	Table 66: Five core Fire resistant cable, Cu/XLPE/SWA, LSF/LSZH sheathed, 600/1000V, conf. to BS: 7846.....	56
	Table 67: Auxillary (Control) Fire resistant cable, 1.5mm ² , LSF/LSZH sheathed, 600/1000V, conf. to BS: 7846.....	57
	Table 68: Auxillary (Control) Fire resistant cable, 2.5mm ² , LSF/LSZH sheathed, 600/1000V, conf. to BS: 7846.....	58
	Table 69: Auxillary (Control) Fire resistant cable, 4mm ² , LSF/LSZH sheathed, 600/1000V, conf. to BS: 7846.....	58
	Tables 70 - 83 Group Rating Factors - LSF/LSZH Cables.....	59
	Sub index for instrumentation Cables.....	60
	Tables 84 - 95 Instrumentation Cables.....	64-77

High Voltage Cables

Specifications	: Cables as per IEC / VDE / IEEE or any other international specifications
Grades	: 66 kV to 220 kV
Cross Sectional Area	: 95 sq. mm. to 2000 sq. mm.
Conductor	: Copper / Aluminium
Insulation	: Super clean XLPE
Armour	: Aluminium wire
Sheathing	: HDPE with extruded layer of semi-conducting material



Medium Voltage Cables

Specifications	: Cables as per BIS / BS / IEC / or any other international specifications
Grades	: 3.8 kV to 33 kV
Core	: Single & three core
Cross Sectional Area	: 35 sq. mm. to 1000 sq. mm.
Conductor	: Aluminium / Copper
Insulation	: XLPE
Armour	: Aluminium / Galvanized Steel (Wire/Tape)
Sheathing	: PVC / PE / LSF



Low Voltage Cables

Specifications	: Cables as per BIS / BS / IEC / or any other international specifications
Grades	: 600 / 1000 V, 1.9 / 3.3kV
Core	: Single to 100
Cross Sectional Area	: 1.5 sq. mm. to 1000 sq. mm.
Conductor	: Aluminium / Copper
Insulation	: XLPE / PVC
Armour	: Aluminium / Galvanized Steel
Sheathing	: PVC / PE / LSF



Instrumentation cables

Specification	: Cables as per BS 5308 Part-1/Part-2, BS EN 50288-7 or any international standard.
Type	: Pair/Triad/Quads
No of Pair/Triad/Quads	: Up to 50 Pairs/Triads/Quads
Size	: 0.5 sq.mm to 4 sq.mm.
Conductor	: Plain / tinned copper
Insulation	: XLPE / PE / PVC
Shielding	: Al.Mylar foil screen / Braided screen
Armour	: Galvanized steel wire / tape / braid or unarmoured
Sheath	: PVC / LSF.






Wiring Cables

- Specifications : Wires as per BS 6004/BS EN 50525-2-31/
IEC 60227 or other international specifications
- Core : Single Core
- Cross Sectional Area: 0.5 sq. mm. to 6.0 Sq.mm
- Conductor : Copper Stranded (Class 2) or flexible (Class 5)
- Insulation : PVC

PVC Flexible Cables

- Specifications : Cables as per BS 6004/BS 6500/BS 7919/
BS EN 50525-2-11/IEC 60227
- Core : Single to 5
- Cross Sectional Area : 0.5 sq. mm. to 4 sq. mm.
- Conductor : Copper Flexible (Class 5)
- Insulation : PVC
- Sheathing : PVC

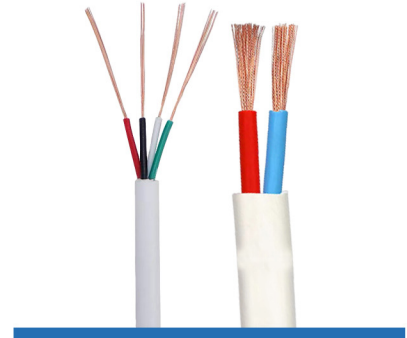


LSF/LSZH Cables (MV/LV/Flexibles & Wires)

- Specifications : Cables as per BS 7211/BS EN 50525-3-41/
BS 6724/ BS 7835
- Core : Single to 100
- Cross Sectional Area : 1.5 sq. mm. to 1000 sq. mm.
- Conductor : Aluminium / Copper
- Insulation : XLPE
- Armour : Aluminium / Galvanized Steel
- Sheathing : LSF/LSZH, Zero Halogen – no corrosive gas emission

Fire Resistant Cables

- Specifications : Cables as per BS 7846/BS 6387 CWZ/IEC 60502-1/IEC 60331
- Core : Single to 100
- Cross Sectional Area : 1.5 Sq.mm- to 1000 sq.mm.
- Conductor : Copper/Aluminium
- Flame Barrier : Glass Mica Tape
- Insulation : XLPE
- Armour : Aluminium/Galvanized Steel.
- Sheathing : LSF/LSZH, Zero Halogen- no corrosive gas emission.

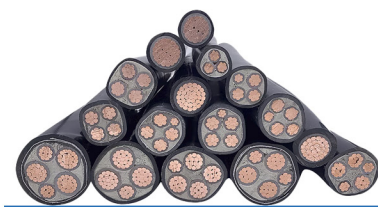

Speciality Cables

- To client specifications
- Heat, oil, flame retardant cables
- LSF/LSZH with hydro carbon resistance cables
- 5 kV airport lighting cables, runway signalling cables
- VFD Cables

CONSTRUCTION OF LOW VOLTAGE CABLES

- **CONDUCTORS**

Electrical grade high conductivity Copper / Aluminium wires are stranded to make stranded circular or Shaped, conductors as per BS EN 60228 or IEC 60228.

- **INSULATION**

High quality XLPE / PVC material is used for insulating the conductors as per BS 7655 or IEC 60502-1.

- **ASSEMBLY**

Multi-core cables of two, three, four or more insulated cores are laid-up together with non-hygroscopic fillers compatible with the insulation material and bound with suitable binder tape.

- **REGULAR COLOR CODE**

Single core: Red
 Two cores: Red, Black
 Three cores: Red, Yellow, Blue/Brown
 Four cores: Red, Yellow, Blue/Brown, Black
 Five cores: Red, Yellow, Blue/Brown, Black, Yellow-Green
 Above Five Cores: Black numerals printed on white core insulation.
 Cables with special core colors can also be manufactured as per project requirement.

- **BEDDING**

The assembly is bedded with an extruded layer of special grade PVC or PE compounds as per project requirement.

- **ARMOUR**

The armour is given for the protection of cable against physical damage. Galvanised round steel wire or galvanised steel tapes are applied helically over bedding as armouring. However, single core cables are armored with Aluminium round wire or Aluminium tape.

- **OUTER SHEATH**

The outer sheath is made of extruded Polyvinyl Chloride (PVC) type ST2 as per IEC 60502-1, Type 9 as per BS 7655 or Polyethylene PE ST7. Polyethylene outer sheath is used in case the cable requires higher impregnability to moisture. Outer sheath is of generally black /red colour or as per project requirement.

- **MARKING OVER OUTER SHEATH**

Outer sheath is marked / embossed with Manufacturer name, no of cores, size, Voltage ratings, and year of manufacture, sequential length marking and any other desired marking for better identification at site.

- **FLAME RETARDANT CABLE SHEATHS**


Cables with special flame retardant PVC compounds meeting flame test requirements of IEC 60332-3-22, IEC 60332-3-23 or IEC 60332-3-24 are manufactured as per project requirement.

- **PACKING**

The cables are supplied on drums manufactured from high quality pine wood or steel. The pine wooden drums are properly seasoned and treated, with minimum painting to make them more eco-friendly. The cable ends are sealed with heat shrinkable end caps, marked with our logo, to avoid any possibility of ingress of water or dirt during transportation and storage as well as any pilferage of the cable.

Each drum is clearly marked with our name and logo, type, size, length, net and gross weight and sequential length marking details. An arrow and suitable instruction is marked on the drum indicating the direction, the drum should be rolled while laying the cable.

- **TYPICAL CROSS SECTION DRAWING OF LV CABLE**

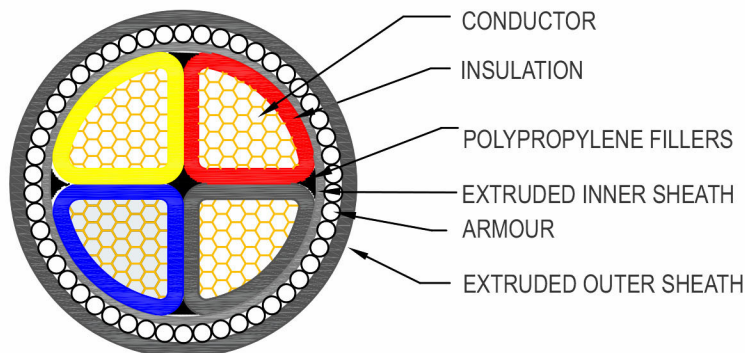

- **TESTING**

We are equipped with state of the art testing facility capable of testing raw materials and cables as per BS, IEC or most of the international standards.

All the cables manufactured, undergo strict quality control during stage wise manufacturing process and routine test as per relevant standards are conducted on all finished drums and test certificate mentioning drum number and test results are provided against each and every drums.




Table-1

SINGLE CORE WIRES, WITH SOLID OR STRANDED COPPER CONDUCTOR, PVC INSULATED



Specification : BS 6004/ BS EN 50525-2-31
 Nominal Voltage : 450/750V

Harmonized code designations
 Solid Conductor : H07V-U
 Stranded Conductor : H07V-R

Nominal Area of the conductor	Maximum Cable diameter	Radial thickness of Insulation	Number/ nominal diameter of wires
Sq. mm	mm	mm	No./mm
1.5	3.2	0.7	1/1.38
1.5	3.3	0.7	7/0.53
2.5	3.9	0.8	1/1.78
2.5	4.0	0.8	7/0.67
4	4.4	0.8	1/2.26
4	4.6	0.8	7/0.85
6	5.0	0.8	1/2.77
6	5.2	0.8	7/1.04
10	6.4	1.0	1/3.57
10	6.7	1.0	7
16	7.8	1.0	7
25	9.7	1.2	7
35	10.9	1.2	7
50	12.8	1.4	7
70	14.6	1.4	19
95	17.1	1.6	19
120	18.8	1.6	19
150	20.9	1.8	19
185	23.3	2.0	37
240	26.6	2.2	37
300	29.6	2.4	37
400	33.2	2.6	61
500	36.9	2.8	61
630	41.1	2.8	61



Nominal Area of the conductor	Maximum conductor resistance	Current Rating		Weight of Cables
		Laid in conduits	Laid in Free Air (Approx.)	
Sq. mm	ohm/Km	Amps	Amps	Kg/Km
1.5	12.1	16	20	21
1.5	12.1	16	20	23
2.5	7.41	21	26	33
2.5	7.41	21	26	35
4	4.61	28	35	47
4	4.61	28	35	51
6	3.08	36	46	66
6	3.08	36	46	71
10	1.83	50	63	114
10	1.83	50	63	117
16	1.15	68	80	167
25	0.727	89	108	262
35	0.524	110	133	360
50	0.387	134	166	479
70	0.268	177	205	687
95	0.193	207	247	935
120	0.153	239	290	1162
150	0.124	262	334	1433
185	0.0991	296	388	1778
240	0.0754	346	463	2280
300	0.0601	394	540	2893
400	0.0470	401	580	3715
500	0.0366	530	620	4691
630	0.0283	611	715	6035




* Standard Packing: 100 yards/Mtrs rolls upto 16sq.mm
 1000 Mtrs from 25sq.mm to 150sq.mm
 500 Mtrs from 185sq.mm to 630sq.mm

Current Rating is based on the below conditions.
 Amb. temp: 30°C
 Conductor Operating temp: 70°C
 Conductor size from 16 mm² to 630 mm² is circular compacted

Table-2

Single core cable, Copper Conductor, XLPE insulated, Aluminium wire armoured, PVC sheathed, 600/1000V, conf. to BS: 5467



Area	Thickness of XLPE Insulation	Thickness of Bedding	Dimension of Armour wire sheath	Thickness of PVC Outer sheath	Overall diameter	Net Wt. of Cable
	Nominal	Nominal	Nominal	Nominal	Approx.	Approx.
mm ²	mm	mm	mm	mm	mm	kg/km
50	1.0	0.8	0.90	1.5	17.5	650
70	1.1	0.8	1.25	1.5	20.2	940
95	1.1	0.8	1.25	1.6	22.3	1210
120	1.2	0.8	1.25	1.6	24.2	1465
150	1.4	1.0	1.60	1.7	27.4	1920
185	1.6	1.0	1.60	1.8	30.0	2325
240	1.7	1.0	1.60	1.8	32.8	2875
300	1.8	1.0	1.60	1.9	35.6	3445
400	2.0	1.2	2.00	2.0	40.5	4480
500	2.2	1.2	2.00	2.1	44.2	5550
630	2.4	1.2	2.00	2.2	48.8	7040
800	2.6	1.4	2.50	2.4	55.4	9020
1000	2.8	1.4	2.50	2.5	60.6	11040

Area	D.C. resistance at 20° C	A.C. resistance at operating Temp. 90° C	Reactance at 50 Hz	Current Rating			Short circuit rating for 1 Sec.	Voltage Drop
	Max	Approx.	Approx.	Ground	Duct	Air		
mm ²	Ohm/km	Ohm/km	Ohm/km	Amps	Amps	Amps	kA(rms)	V/A/km
50	0.387	0.494	0.106	208	208	203	7.15	0.88
70	0.268	0.342	0.102	262	256	260	10.01	0.62
95	0.193	0.247	0.098	313	301	319	13.6	0.46
120	0.153	0.196	0.096	355	337	370	17.2	0.38
150	0.124	0.159	0.095	397	364	425	21.5	0.32
185	0.0991	0.1280	0.092	447	402	488	26.5	0.27
240	0.0754	0.0984	0.089	514	451	576	34.3	0.23
300	0.0601	0.0795	0.090	573	492	656	42.9	0.21
400	0.0470	0.0635	0.089	648	533	749	57.2	0.19
500	0.0366	0.0512	0.088	718	577	847	71.5	0.18
630	0.0283	0.0418	0.086	790	623	954	90.1	0.17
800	0.0221	0.0349	0.086	833	649	1037	114.4	0.16
1000	0.0176	0.0302	0.084	884	690	1125	143.0	0.15

The above data is indicative & may be changed without prior information.

* Standard Packing: 1000 Mtrs from 50sq.mm to 185sq.mm
 500 Mtrs from 240sq.mm to 630sq.mm
 300 Mtrs from 800sq.mm to 1000sq.mm

Operating conditions - Amb. air temp: 40° C


Ground temp: 20° C

Depth of laying: 50 cm

Thermal resistivity of soil: 120° C-cm/W

Table-3

Two core cable, Copper conductor, XLPE Insulated, Gal. steel wire armoured, PVC sheathed, 600/1000V, conf. to BS: 5467



Area	Thickness of XLPE Insulation	Thickness of Bedding	Dimension of Armour Wire	Thickness of PVC Outer sheath	Overall diameter	Net Wt. of Cable
	Nominal	Nominal	Nominal	Nominal	Approx.	Approx.
mm ²	mm	mm	mm	mm	mm	kg/km
1.5	0.6	0.8	0.90	1.3	12.1	255
2.5	0.7	0.8	0.90	1.4	13.6	315
4	0.7	0.8	0.90	1.4	14.7	370
6	0.7	0.8	0.90	1.4	15.9	440
10	0.7	0.8	0.90	1.5	18.0	575
16	0.7	0.8	1.25	1.5	20.4	740
25	0.9	0.8	1.25	1.6	20.4	1000
35	0.9	1.0	1.60	1.7	23.3	1425
50	1.0	1.0	1.60	1.8	25.8	1755
70	1.1	1.0	1.60	1.9	29.0	2310
95	1.1	1.2	2.00	2.0	33.1	3160
120	1.2	1.2	2.00	2.1	36.1	3750
150	1.4	1.2	2.00	2.2	39.3	4410
185	1.6	1.4	2.50	2.4	44.7	5680
240	1.7	1.4	2.50	2.5	49.0	6955
300	1.8	1.6	2.50	2.6	53.5	8400
400	2.0	1.6	2.50	2.8	59.0	10400


Area	D.C. resistance at 20° C	A.C. resistance at operating Temp. 90° C	Reactance at 50 Hz	Current Rating			Short circuit rating for 1 Sec.	Voltage Drop
	Max	Approx.		Approx.	Ground	Duct		
mm ²	Ohm/km	Ohm/km	Ohm/km	Amps	Amps	Amps	kA(rms)	V/A/km
1.5	12.1	15.43	0.105	33	27	27	0.21	26.72
2.5	7.41	9.45	0.099	42	36	36	0.36	16.37
4	4.61	5.88	0.093	57	46	48	0.57	10.18
6	3.08	3.93	0.088	70	58	62	0.86	6.80
10	1.83	2.33	0.084	96	78	84	1.43	4.04
16	1.15	1.47	0.081	124	101	111	2.29	2.54
25	0.727	0.927	0.081	164	133	144	3.58	1.61
35	0.524	0.669	0.079	196	159	178	5.01	1.17
50	0.387	0.494	0.075	232	189	215	7.15	0.87
70	0.268	0.343	0.074	286	235	269	10.01	0.61
95	0.193	0.248	0.072	344	283	333	13.6	0.45
120	0.153	0.197	0.072	395	326	385	17.2	0.36
150	0.124	0.160	0.073	443	366	439	21.5	0.30
185	0.0991	0.1291	0.072	499	415	507	26.5	0.26
240	0.0754	0.0998	0.071	576	480	598	34.3	0.21
300	0.0601	0.0812	0.071	646	540	682	42.9	0.19
400	0.0470	0.0656	0.070	744	622	785	57.2	0.17

The above data is indicative & may be changed without prior information.
 Conductor upto 16mm² will be round.
 Conductor of 25mm² and above will be compacted sector shaped conductor.
 * Standard Packing: 1000 Mtrs upto 95sq.mm
 500 Mtrs from 120sq.mm to 300sq.mm
 300 Mtrs for 400sq.mm

Operating conditions - Amb. air temp. 40° C
 Ground temp: 20° C
 Depth of laying : 50 cm
 Thermal resistivity of soil: 120° C-cm/W

Table-4

Three core cable, Copper conductor, XLPE Insulated, Gal. steel wire armoured, PVC sheathed, 600/1000V, conf. to BS: 5467



Area	Thickness of XLPE Insulation	Thickness of Bedding	Dimension of Armour Wire	Thickness of PVC Outer sheath	Overall diameter	Net Wt. of Cable
	Nominal	Nominal	Nominal	Nominal	Approx.	Approx.
mm ²	mm	mm	mm	mm	mm	kg/km
1.5	0.6	0.8	0.9	1.3	12.6	280
2.5	0.7	0.8	0.9	1.4	14.1	355
4	0.7	0.8	0.9	1.4	15.3	430
6	0.7	0.8	0.9	1.4	16.6	525
10	0.7	0.8	1.25	1.5	19.5	810
16	0.7	0.8	1.25	1.6	21.6	985
25	0.9	1.0	1.6	1.7	23.6	1500
35	0.9	1.0	1.6	1.8	25.7	1905
50	1.0	1.0	1.6	1.8	28.5	2335
70	1.1	1.0	1.6	1.9	32.2	3150
95	1.1	1.2	2.0	2.1	37.0	4270
120	1.2	1.2	2.0	2.2	40.4	5160
150	1.4	1.4	2.5	2.3	45.5	6560
185	1.6	1.4	2.5	2.4	49.8	7820
240	1.7	1.4	2.5	2.6	55.1	9660
300	1.8	1.6	2.5	2.7	60.2	11845
400	2.0	1.6	2.5	2.9	66.6	14715

Area	D.C. resistance at 20° C	A.C. resistance at operating Temp. 90° C	Reactance at 50 Hz	Current Rating			Short circuit rating for 1 Sec.	Voltage Drop
	Max	Approx.	Approx.	Ground	Duct	Air		
mm ²	Ohm/km	Ohm/km	Ohm/km	Amps	Amps	Amps	kA(rms)	V/A/km
1.5	12.1	15.43	0.105	25	22	23	0.21	26.72
2.5	7.41	9.45	0.099	32	30	31	0.36	16.37
4	4.61	5.88	0.093	42	39	41	0.57	10.18
6	3.08	3.93	0.088	52	49	52	0.86	6.80
10	1.83	2.33	0.084	71	66	72	1.43	4.04
16	1.15	1.47	0.081	105	84	94	2.29	2.54
25	0.727	0.927	0.081	136	111	123	3.58	1.61
35	0.524	0.669	0.079	163	133	151	5.01	1.17
50	0.387	0.494	0.075	194	158	184	7.15	0.87
70	0.268	0.343	0.074	241	197	231	10.01	0.61
95	0.193	0.248	0.072	288	237	285	13.6	0.45
120	0.153	0.197	0.072	331	273	331	17.2	0.36
150	0.124	0.160	0.073	370	309	378	21.5	0.30
185	0.0991	0.1291	0.072	418	348	436	26.5	0.26
240	0.0754	0.0998	0.071	483	403	514	34.3	0.21
300	0.0601	0.0812	0.071	540	452	586	42.9	0.19
400	0.0470	0.0656	0.070	621	530	674	57.2	0.17

The above data is indicative & may be changed without prior information.
 Conductor upto 16mm² will be round.
 Conductor of 25mm² and above will be compacted sector shaped conductor.
 * Standard Packing: 1000 Mtrs upto 95sq.mm
 500 Mtrs from 120sq.mm to 300sq.mm
 300 Mtrs for 400sq.mm

Operating conditions - Amb. air temp: 40° C
 Ground temp: 20° C
 Depth of laying: 50 cm
 Thermal resistivity of soil: 120° C-cm/W

Table-5

Four core cable, Copper conductor, XLPE Insulated, Gal. steel wire armoured, PVC sheathed, 600/1000V, conf. to BS: 5467



Area	Thickness of XLPE Insulation	Thickness of Bedding	Dimension of Armour Wire	Thickness of PVC Outer sheath	Overall diameter	Net Wt. of Cable
	Nominal	Nominal	Nominal	Nominal	Approx.	Approx.
mm ²	mm	mm	mm	mm	mm	kg/km
1.5	0.6	0.8	0.9	1.3	13.3	335
2.5	0.7	0.8	0.9	1.4	15.0	430
4	0.7	0.8	0.9	1.4	16.4	535
6	0.7	0.8	0.9	1.5	18.7	770
10	0.7	0.8	1.25	1.5	21.1	960
16	0.7	0.8	1.25	1.6	23.4	1200
25	0.9	1.0	1.6	1.7	26.1	1855
35	0.9	1.0	1.6	1.8	28.6	2370
50	1.0	1.0	1.6	1.9	32.0	2950
70	1.1	1.2	2.0	2.1	37.7	4355
95	1.1	1.2	2.0	2.2	41.7	5445
120	1.2	1.4	2.5	2.3	47.1	7010
150	1.4	1.4	2.5	2.4	51.4	8365
185	1.6	1.4	2.5	2.6	56.6	10050
240	1.7	1.6	2.5	2.7	63.0	12450
300	1.8	1.6	2.5	2.9	68.8	15300
400	2.0	1.8	3.15	3.2	78.1	20100


Area	D.C. resistance at 20° C	A.C. resistance at operating Temp. 90° C	Reactance at 50 Hz	Current Rating			Short circuit rating for 1 Sec.	Voltage Drop
	Max	Approx.	Approx.	Ground	Duct	Air		
mm ²	Ohm/km	Ohm/km	Ohm/km	Amps	Amps	Amps	kA(rms)	V/A/km
1.5	12.1	15.43	0.105	25	22	23	0.21	26.72
2.5	7.41	9.45	0.099	32	30	31	0.36	16.37
4	4.61	5.88	0.093	42	39	41	0.57	10.18
6	3.08	3.93	0.088	52	49	52	0.86	6.80
10	1.83	2.33	0.084	71	66	72	1.43	4.04
16	1.15	1.47	0.081	105	84	94	2.29	2.54
25	0.727	0.927	0.081	136	111	123	3.58	1.61
35	0.524	0.669	0.079	163	133	151	5.01	1.17
50	0.387	0.494	0.075	194	158	184	7.15	0.87
70	0.268	0.343	0.074	241	197	231	10.01	0.61
95	0.193	0.248	0.072	288	237	285	13.6	0.45
120	0.153	0.197	0.072	331	273	331	17.2	0.36
150	0.124	0.160	0.073	370	309	378	21.5	0.30
185	0.0991	0.1291	0.072	418	348	436	26.5	0.26
240	0.0754	0.0998	0.071	483	403	514	34.3	0.21
300	0.0601	0.0812	0.071	540	452	586	42.9	0.19
400	0.0470	0.0656	0.070	621	530	674	57.2	0.17

The above data is indicative & may be changed without prior information.
 Conductor upto 16mm² will be round.
 Conductor of 25mm² and above will be compacted sector shaped conductor.
 * Standard Packing: 1000 Mtrs upto 70sq.mm
 500 Mtrs from 95sq.mm to 300sq.mm
 200 Mtrs for 400sq.mm

Operating conditions - Amb. air temp. 40° C
 Ground temp: 20° C
 Depth of laying : 50 cm
 Thermal resistivity of soil: 120° C-cm/W

Table-6

Five core cable, Copper conductor, XLPE Insulated, Gal. steel wire armoured, PVC sheathed, 600/1000V, conf. to BS: 5467



Area	Thickness of XLPE Insulation	Thickness of Bedding	Dimension of Armour Wire	Thickness of PVC Outer sheath	Overall diameter	Net Wt. of Cable
	Nominal	Nominal	Nominal	Nominal	Approx.	Approx.
mm ²	mm	mm	mm	mm	mm	kg/km
1.5	0.6	0.8	0.9	1.4	14.3	385
2.5	0.7	0.8	0.9	1.4	16.1	495
4	0.7	0.8	0.9	1.5	17.8	620
6	0.7	0.8	1.25	1.5	20.0	845
10	0.7	0.8	1.25	1.6	22.9	1130
16	0.7	1.0	1.6	1.7	26.6	1685
25	0.9	1.0	1.6	1.8	31.5	2330
35	0.9	1.0	1.6	1.9	34.8	2965
50	1.0	1.2	2.0	2.0	40.4	4075
70	1.1	1.2	2.0	2.2	46.3	5475


Area	D.C. resistance at 20° C	A.C. resistance at operating Temp. 90° C	Reactance at 50 Hz	Current Rating			Short circuit rating for 1 Sec.	Voltage Drop
	Max	Approx.	Approx.	Ground	Duct	Air		
mm ²	Ohm/km	Ohm/km	Ohm/km	Amps	Amps	Amps	kA(rms)	V/A/km
1.5	12.1	15.43	0.105	25	22	23	0.21	26.72
2.5	7.41	9.45	0.099	32	30	31	0.36	16.37
4	4.61	5.88	0.093	42	39	41	0.57	10.18
6	3.08	3.93	0.088	52	49	52	0.86	6.80
10	1.83	2.33	0.084	71	66	72	1.43	4.04
16	1.15	1.47	0.081	105	84	94	2.29	2.54
25	0.727	0.927	0.081	136	111	123	3.58	1.61
35	0.524	0.669	0.079	163	133	151	5.01	1.17
50	0.387	0.494	0.075	194	158	184	7.15	0.87
70	0.268	0.343	0.074	241	197	231	10.01	0.61

The above data is indicative & may be changed without prior information.
 Conductor upto 10mm² will be round, non-compacted.
 Conductor above 10mm² will be round, compacted.
 * Standard Packing: 1000Mtr Drums

Operating conditions - Amb. Air temp. 40° C
 Ground temp: 20° C
 Depth of laying : 50 cm
 Thermal resistivity of soil: 120° C-cm/W

Table - 7

Auxillary (Control) cable, 1.5mm², Copper conductor, XLPE insulated, Gal. steel wire armoured, PVC sheathed, 600/1000V, conf. to BS: 5467

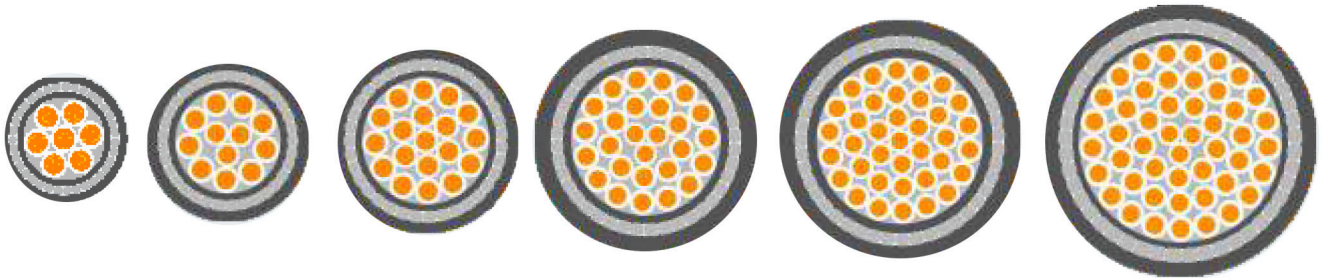

Area	Thickness of XLPE Insulation	Thickness of Bedding	Dimension of Armour Wire	Thickness of PVC Outer sheath	Overall diameter	Net Wt. of Cable
	Nominal	Nominal	Nominal	Nominal	Approx.	Approx.
mm ²	mm	mm	mm	mm	mm	kg/km
7 x 1.5	0.6	0.8	0.9	1.4	15.2	440
12 x 1.5	0.6	0.8	1.25	1.5	19.4	745
19 x 1.5	0.6	0.8	1.25	1.6	22.2	965
27 x 1.5	0.6	1.0	1.6	1.7	26.7	1425
37 x 1.5	0.6	1.0	1.6	1.7	29.0	1710
48 x 1.5	0.6	1.0	1.6	1.8	32.7	2070

Area	D.C. resistance at 20° C	A.C. resistance at operating Temp. 90° C	Reactance at 50 Hz	Current Rating			Short circuit rating for 1 Sec.	Voltage Drop
	Max	Approx.		Approx.	Ground	Duct		
mm ²	Ohm/km	Ohm/km	Ohm/km	Amps	Amps	Amps	kA(rms)	V/A/km
7 x 1.5	12.1	15.43	0.105	21	17	17	0.215	26.73
12 x 1.5	12.1	15.43	0.105	18	14	14	0.215	26.73
19 x 1.5	12.1	15.43	0.105	15	12	12	0.215	26.73
27 x 1.5	12.1	15.43	0.105	13	10	10	0.215	26.73
37 x 1.5	12.1	15.43	0.105	11	9	9	0.215	26.73
48 x 1.5	12.1	15.43	0.105	10	8	8	0.215	26.73

The above data is indicative & may be changed without prior information.
 * Standard Packing: 1000 Mtr Drums

Operating conditions - Amb. air temp. 40° C
 Ground temp: 20° C
 Depth of laying : 50 cm
 Thermal resistivity of soil: 120° C-cm/W

Table - 8

Auxiliary (Control) cable, 2.5mm², Copper conductor, XLPE insulated, Gal. steel wire armoured, PVC sheathed, 600/1000V, conf. to BS: 5467

Area	Thickness of XLPE Insulation	Thickness of Bedding	Dimension of Armour Wire	Thickness of PVC Outer sheath	Overall diameter	Net Wt. of Cable
	Nominal	Nominal	Nominal	Nominal	Approx.	Approx.
mm ²	mm	mm	mm	mm	mm	kg/km
7 x 2.5	0.7	0.8	0.9	1.4	17.1	570
12 x 2.5	0.7	0.8	1.25	1.6	22.4	980
19 x 2.5	0.7	1.0	1.6	1.7	26.6	1485
27 x 2.5	0.7	1.0	1.6	1.8	30.7	1905
37 x 2.5	0.7	1.0	1.6	1.8	33.8	2320
48 x 2.5	0.7	1.2	2.0	2.0	39.3	3165

Area	D.C. resistance at 20° C	A.C. resistance at operating Temp. 90° C	Reactance at 50 Hz	Current Rating			Short circuit rating for 1 Sec.	Voltage Drop
	Max	Approx.	Approx.	Ground	Duct	Air		
mm ²	Ohm/km	Ohm/km	Ohm/km	Amps	Amps	Amps	kA(rms)	V/A/km
7 x 2.5	7.41	9.45	0.099	27	22	23	0.358	16.37
12 x 2.5	7.41	9.45	0.099	22	19	19	0.358	16.37
19 x 2.5	7.41	9.45	0.099	19	16	16	0.358	16.37
27 x 2.5	7.41	9.45	0.099	16	14	13	0.358	16.37
37 x 2.5	7.41	9.45	0.099	14	12	12	0.358	16.37
48 x 2.5	7.41	9.45	0.099	13	11	11	0.358	16.37

The above data is indicative & may be changed without prior information.
* Standard Packing: 1000 Mtr Drums

Operating conditions - Amb. Air temp. 40° C
Ground temp: 20° C
Depth of laying : 50 cm
Thermal resistivity of soil: 120° C-cm/W

Table - 9

Auxiliary (Control) cable, 4mm², Copper conductor, XLPE insulated, Gal. steel wire armoured, PVC sheathed, 600/1000V, conf. to BS: 5467

Area	Thickness of XLPE Insulation	Thickness of Bedding	Dimension of Armour Wire	Thickness of PVC Outer sheath	Overall diameter	Net Wt. of Cable
	Nominal	Nominal	Nominal	Nominal	Approx.	Approx.
mm ²	mm	mm	mm	mm	mm	kg/km
7 x 4	0.7	0.8	1.25	1.5	19.7	840
12 x 4	0.7	1.0	1.6	1.6	25.7	1400
19 x 4	0.7	1.0	1.6	1.7	29.3	1900
27 x 4	0.7	1.0	1.6	1.9	34.4	2485
37 x 4	0.7	1.2	2.0	2.0	39.2	3410
48 x 4	0.7	1.2	2.0	2.1	44.1	4150


Area	D.C. resistance at 20° C	A.C. resistance at operating Temp. 90° C	Resistance at 50 Hz	Current Rating			Short circuit rating for 1 Sec.	Voltage Drop
	Max	Approx.	Approx.	Ground	Duct	Air		
mm ²	Ohm/km	Ohm/km	Ohm/km	Amps	Amps	Amps	kA(rms)	V/A/km
7 x 4	4.61	5.88	0.093	36	29	30	0.572	10.18
12 x 4	4.61	5.88	0.093	30	24	25	0.572	10.18
19 x 4	4.61	5.88	0.093	25	20	21	0.572	10.18
27 x 4	4.61	5.88	0.093	22	17	18	0.572	10.18
37 x 4	4.61	5.88	0.093	19	16	16	0.572	10.18
48 x 4	4.61	5.88	0.093	18	14	15	0.572	10.18

The above data is indicative & may be changed without prior information.
* Standard Packing: 1000 Mtr Drums

Operating conditions - Amb. air temp. 40° C
Ground temp: 20° C
Depth of laying : 50 cm
Thermal resistivity of soil: 120° C-cm/W

Table - 10

Single core cable, Copper Conductor, XLPE insulated, Aluminium wire armoured, MDPE sheathed, 600/1000V, generally to BS: 5467



Area	Thickness of XLPE Insulation	Thickness of Bedding	Dimension of Armour Wire	Thickness of MDPE Outersheath	Overall diameter	Net Wt. of Cable
	Nominal	Nominal	Nominal	Nominal	Approx	Approx
mm ²	mm	mm	mm	mm	mm	kg/km
50	1.0	0.8	0.90	1.5	17.5	620
70	1.1	0.8	1.25	1.5	20.2	900
95	1.1	0.8	1.25	1.6	22.3	1165
120	1.2	0.8	1.25	1.6	24.2	1420
150	1.4	1.0	1.60	1.7	27.4	1860
185	1.6	1.0	1.60	1.8	30.0	2260
240	1.7	1.0	1.60	1.8	32.8	2800
300	1.8	1.0	1.60	1.9	35.6	3360
400	2.0	1.2	2.00	2.0	40.5	4380
500	2.2	1.2	2.00	2.1	44.2	5430
630	2.4	1.2	2.00	2.2	48.8	6900
800	2.6	1.4	2.50	2.4	55.4	8850
1000	2.8	1.4	2.50	2.5	60.6	10850


Area	D.C. resistance at 20 °C	A.C. resistance at operating temp. 90 °C	Reactance at 50Hz	Current Rating			Short circuit rating for 1 Sec.	Voltage Drop
	Max	Approx	Approx	Ground	Duct	Air		
mm ²	Ohm/km	Ohm/km	Ohm/km	Amps	Amps	Amps	kA(rms)	V/A/km
50	0.387	0.494	0.106	208	208	203	7.15	0.88
70	0.268	0.342	0.102	262	256	260	10.01	0.62
95	0.193	0.247	0.098	313	301	319	13..6	0.46
120	0.153	0.196	0.096	355	337	370	17.2	0.38
150	0.124	0.159	0.095	397	364	425	21.5	0.32
185	0.0991	0.128	0.092	447	402	488	26.5	0.27
240	0.0754	0.0984	0.089	514	451	576	34.3	0.23
300	0.0601	0.0795	0.090	573	492	656	42.9	0.21
400	0.0470	0.0635	0.089	648	533	749	57.2	0.19
500	0.0366	0.0512	0.088	718	577	847	71.5	0.18
630	0.0283	0.0418	0.086	790	623	954	90.1	0.17
800	0.0221	0.0349	0.086	833	649	1037	114.4	0.16
1000	0.0176	0.0302	0.084	884	690	1125	143.0	0.15

The above data is indicative & may be changed without prior information.
 * Standard Packing: 1000 Mtrs from 50sq.mm to 185sq.mm
 500 Mtrs from 240sq.mm to 630sq.mm
 300 Mtrs from 800sq.mm to 1000sq.mm

Operating conditions - Amb. air temp: 40° C
 Ground temp: 20° C
 Depth of laying: 50 cm
 Thermal resistivity of soil: 120° C-cm/W

Table-11

Two core cable, Copper conductor, XLPE Insulated, Gal. steel wire armoured, MDPE sheathed, 600/1000V, generally to BS: 5467



Area	Thickness of XLPE Insulation	Thickness of Bedding	Dimension of Armour Wire	Thickness of MDPE Outersheath	Overall diameter	Net Wt. of Cable
	Nominal	Nominal	Nominal	Nominal	Approx	Approx
mm ²	mm	mm	mm	mm	mm	kg/km
1.5	0.6	0.8	0.90	1.3	12.1	235
2.5	0.7	0.8	0.90	1.4	13.6	290
4	0.7	0.8	0.90	1.4	14.7	345
6	0.7	0.8	0.90	1.4	15.9	410
10	0.7	0.8	0.90	1.5	18.0	540
16	0.7	0.8	1.25	1.5	20.4	700
25	0.9	0.8	1.25	1.6	20.4	960
35	0.9	1.0	1.60	1.7	23.3	1375
50	1.0	1.0	1.60	1.8	25.8	1700
70	1.1	1.0	1.60	1.9	29.0	2240
95	1.1	1.2	2.00	2.0	33.1	3075
120	1.2	1.2	2.00	2.1	36.1	3660
150	1.4	1.2	2.00	2.2	39.3	4300
185	1.6	1.4	2.50	2.4	44.7	5550
240	1.7	1.4	2.50	2.5	49.0	6800
300	1.8	1.6	2.50	2.6	53.5	8230
400	2.0	1.6	2.50	2.8	59.0	10200


Area	D.C. resistance at 20 °C	A.C. resistance at operating temp. 90 °C	Reactance at 50Hz	Current Rating			Short circuit rating for 1 Sec.	Voltage Drop
	Max	Approx		Ground	Duct	Air		
mm ²	Ohm/km	Ohm/km	Ohm/km	Amps	Amps	Amps	kA(rms)	V/A/km
1.5	12.1	15.43	0.105	33	27	27	0.21	26.72
2.5	7.41	9.45	0.099	42	36	36	0.36	16.37
4	4.61	5.88	0.093	57	46	48	0.57	10.18
6	3.08	3.93	0.088	70	58	62	0.86	6.80
10	1.83	2.33	0.084	96	78	84	1.43	4.04
16	1.15	1.47	0.081	124	101	111	2.29	2.54
25	0.727	0.927	0.081	164	133	144	3.58	1.61
35	0.524	0.669	0.079	196	159	178	5.01	1.17
50	0.387	0.494	0.075	232	189	215	7.15	0.87
70	0.268	0.343	0.074	286	235	269	10.01	0.61
95	0.193	0.248	0.072	344	283	333	13.6	0.45
120	0.153	0.197	0.072	395	326	385	17.2	0.36
150	0.124	0.160	0.073	443	366	439	21.5	0.30
185	0.0991	0.1291	0.072	499	415	507	26.5	0.26
240	0.0754	0.0998	0.071	576	480	598	34.3	0.21
300	0.0601	0.0812	0.071	646	540	682	42.9	0.19
400	0.0470	0.0656	0.070	744	622	785	57.2	0.17

The above data is indicative & may be changed without prior information.
 Conductor upto 16mm² will be round.
 Conductor of 25mm² and above will be compacted sector shaped conductor.
 * Standard Packing: 1000 Mtrs upto 95sq.mm
 500 Mtrs from 120sq.mm to 300sq.mm
 300 Mtrs for 400sq.mm

Operating conditions - Amb. air temp. 40° C
 Ground temp: 20° C
 Depth of laying : 50 cm
 Thermal resistivity of soil: 120° C-cm/W

Table-12

Three core cable, Copper conductor, XLPE Insulated, Gal. steel wire armoured, MDPE sheathed, 600/1000V, generally to BS: 5467



Area	Thickness of XLPE Insulation	Thickness of Bedding	Dimension of Armour Wire	Thickness of MDPE Outersheath	Overall diameter	Net Wt. of Cable
	Nominal	Nominal	Nominal	Nominal	Approx	Approx
mm ²	mm	mm	mm	mm	mm	kg/km
1.5	0.6	0.8	0.9	1.3	12.6	260
2.5	0.7	0.8	0.9	1.4	14.1	330
4	0.7	0.8	0.9	1.4	15.3	405
6	0.7	0.8	0.9	1.4	16.6	495
10	0.7	0.8	1.25	1.5	19.5	775
16	0.7	0.8	1.25	1.6	21.6	940
25	0.9	1.0	1.6	1.7	23.6	1450
35	0.9	1.0	1.6	1.8	25.7	1845
50	1.0	1.0	1.6	1.8	28.5	2290
70	1.1	1.0	1.6	1.9	32.2	3070
95	1.1	1.2	2.0	2.1	37.0	4170
120	1.2	1.2	2.0	2.2	40.4	5050
150	1.4	1.4	2.5	2.3	45.5	6430
185	1.6	1.4	2.5	2.4	49.8	7670
240	1.7	1.4	2.5	2.6	55.1	9480
300	1.8	1.6	2.5	2.7	60.2	11640
400	2.0	1.6	2.5	2.9	66.6	14470


Area	D.C. resistance at 20 °C	A.C. resistance at operating temp. 90 °C	Reactance at 50Hz	Current Rating			Short circuit rating for 1 Sec.	Voltage Drop
	Max	Approx	Approx	Ground	Duct	Air		
mm ²	Ohm/km	Ohm/km	Ohm/km	Amps	Amps	Amps	kA(rms)	V/A/km
1.5	12.1	15.43	0.105	25	22	23	0.21	26.72
2.5	7.41	9.45	0.099	32	30	31	0.36	16.37
4	4.61	5.88	0.093	42	39	41	0.57	10.18
6	3.08	3.93	0.088	52	49	52	0.86	6.80
10	1.83	2.33	0.084	71	66	72	1.43	4.04
16	1.15	1.47	0.081	105	84	94	2.29	2.54
25	0.727	0.927	0.081	136	111	123	3.58	1.61
35	0.524	0.669	0.079	163	133	151	5.01	1.17
50	0.387	0.494	0.075	194	158	184	7.15	0.87
70	0.268	0.343	0.074	241	197	231	10.01	0.61
95	0.193	0.248	0.072	288	237	285	13.6	0.45
120	0.153	0.197	0.072	331	273	331	17.2	0.36
150	0.124	0.160	0.073	370	309	378	21.5	0.30
185	0.0991	0.1291	0.072	418	348	436	26.5	0.26
240	0.0754	0.0998	0.071	483	403	514	34.3	0.21
300	0.0601	0.0812	0.071	540	452	586	42.9	0.19
400	0.0470	0.0656	0.070	621	530	674	57.2	0.17

The above data is indicative & may be changed without prior information.
 Conductor upto 16mm² will be round.
 Conductor of 25mm² and above will be compacted sector shaped conductor.
 * Standard Packing: 1000 Mtrs upto 95sq.mm
 500 Mtrs from 120sq.mm to 300sq.mm
 300 Mtrs for 400sq.mm

Operating conditions - Amb. air temp: 40° C
 Ground temp: 20° C
 Depth of laying: 50 cm
 Thermal resistivity of soil: 120° C-cm/W

Table-13

Four core cable, Copper conductor, XLPE Insulated, Gal. steel wire armoured, MDPE sheathed, 600/1000V, generally to BS: 5467



Area	Thickness of XLPE Insulation	Thickness of Bedding	Dimension of Armour Wire	Thickness of MDPE Outersheath	Overall diameter	Net Wt. of Cable
	Nominal	Nominal	Nominal	Nominal	Approx	Approx
mm ²	mm	mm	mm	mm	mm	kg/km
1.5	0.6	0.8	0.90	1.3	13.3	315
2.5	0.7	0.8	0.90	1.4	15.0	405
4	0.7	0.8	0.90	1.4	16.4	505
6	0.7	0.8	0.90	1.5	18.7	735
10	0.7	0.8	1.25	1.5	21.1	920
16	0.7	0.8	1.25	1.6	23.4	1150
25	0.9	1.0	1.60	1.7	26.1	1800
35	0.9	1.0	1.60	1.8	28.6	2300
50	1.0	1.0	1.60	1.9	32.0	2870
70	1.1	1.2	2.00	2.1	37.7	4250
95	1.1	1.2	2.00	2.2	41.7	5325
120	1.2	1.4	2.50	2.3	47.1	6870
150	1.4	1.4	2.50	2.4	51.4	8200
185	1.6	1.4	2.50	2.6	56.6	9860
240	1.7	1.6	2.50	2.7	63.0	12230
300	1.8	1.6	2.50	2.9	68.8	15040
400	2.0	1.8	3.15	3.2	78.1	19770


Area	D.C. resistance at 20 °C	A.C. resistance at operating temp. 90 °C	Reactance at 50Hz	Current Rating			Short circuit rating for 1 Sec.	Voltage Drop
	Max	Approx	Approx	Ground	Duct	Air		
mm ²	Ohm/km	Ohm/km	Ohm/km	Amps	Amps	Amps	kA(rms)	V/A/km
1.5	12.1	15.43	0.105	25	22	23	0.21	26.72
2.5	7.41	9.45	0.099	32	30	31	0.36	16.37
4	4.61	5.88	0.093	42	39	41	0.57	10.18
6	3.08	3.93	0.088	52	49	52	0.86	6.80
10	1.83	2.33	0.084	71	66	72	1.43	4.04
16	1.15	1.47	0.081	105	84	94	2.29	2.54
25	0.727	0.927	0.081	136	111	123	3.58	1.61
35	0.524	0.669	0.079	163	133	151	5.01	1.17
50	0.387	0.494	0.075	194	158	184	7.15	0.87
70	0.268	0.343	0.074	241	197	231	10.01	0.61
95	0.193	0.248	0.072	288	237	285	13.6	0.45
120	0.153	0.197	0.072	331	273	331	17.2	0.36
150	0.124	0.160	0.073	370	309	378	21.5	0.30
185	0.0991	0.1291	0.072	418	348	436	26.5	0.26
240	0.0754	0.0998	0.071	483	403	514	34.3	0.21
300	0.0601	0.0812	0.071	540	452	586	42.9	0.19
400	0.0470	0.0656	0.070	621	530	674	57.2	0.17

The above data is indicative & may be changed without prior information.
 Conductor upto 16mm² will be round.
 Conductor of 25mm² and above will be compacted sector shaped conductor.
 * Standard Packing: 1000 Mtrs upto 70sq.mm
 500 Mtrs from 95sq.mm to 300sq.mm
 200 Mtrs for 400sq.mm

Operating conditions - Amb. air temp. 40° C
 Ground temp: 20° C
 Depth of laying : 50 cm
 Thermal resistivity of soil: 120° C-cm/W

Table-14

Five core cable, Copper conductor, XLPE Insulated, Gal. steel wire armoured, MDPE sheathed, 600/1000V, generally to BS: 5467



Area	Thickness of XLPE Insulation	Thickness of Bedding	Dimension of Armour Wire	Thickness of MDPE Outersheath	Overall diameter	Net Wt. of Cable
	Nominal	Nominal	Nominal	Nominal	Approx	Approx
mm ²	mm	mm	mm	mm	mm	kg/km
1.5	0.6	0.8	0.90	1.4	14.3	360
2.5	0.7	0.8	0.90	1.4	16.1	465
4	0.7	0.8	0.90	1.5	17.8	585
6	0.7	0.8	1.25	1.5	20.0	805
10	0.7	0.8	1.25	1.6	22.9	1080
16	0.7	1.0	1.60	1.7	26.6	1625
25	0.9	1.0	1.60	1.8	31.5	2255
35	0.9	1.0	1.60	1.9	34.8	2880
50	1.0	1.2	2.00	2.0	40.4	3970
70	1.1	1.2	2.00	2.2	46.3	5345


Area	D.C. resistance at 20 °C	A.C. resistance at operating temp. 90 °C	Reactance at 50Hz	Current Rating			Short circuit rating for 1 Sec.	Voltage Drop
	Max	Approx	Approx	Ground	Duct	Air		
mm ²	Ohm/km	Ohm/km	Ohm/km	Amps	Amps	Amps	kA(rms)	V/A/km
1.5	12.1	15.43	0.105	25	22	23	0.21	26.72
2.5	7.41	9.45	0.099	32	30	31	0.36	16.37
4	4.61	5.88	0.093	42	39	41	0.57	10.18
6	3.08	3.93	0.088	52	49	52	0.86	6.80
10	1.83	2.33	0.084	71	66	72	1.43	4.04
16	1.15	1.47	0.081	105	84	94	2.29	2.54
25	0.727	0.927	0.081	136	111	123	3.58	1.61
35	0.524	0.669	0.079	163	133	151	5.01	1.17
50	0.387	0.494	0.075	194	158	184	7.15	0.87
70	0.268	0.343	0.074	241	197	231	10.01	0.61

The above data is indicative & may be changed without prior information.
 Conductor upto 10mm² will be round, non-compacted.
 Conductor above 10mm² will be round, compacted.
 * Standard Packing: 1000Mtr Drums

Operating conditions - Amb. Air temp. 40° C
 Ground temp: 20° C
 Depth of laying : 50 cm
 Thermal resistivity of soil: 120° C-cm/W

Table - 15

Auxillary (Control) cable, 1.5mm², Copper conductor, XLPE insulated, Gal. steel wire armoured, MDPE sheathed, 600/1000V, generally to BS: 5467

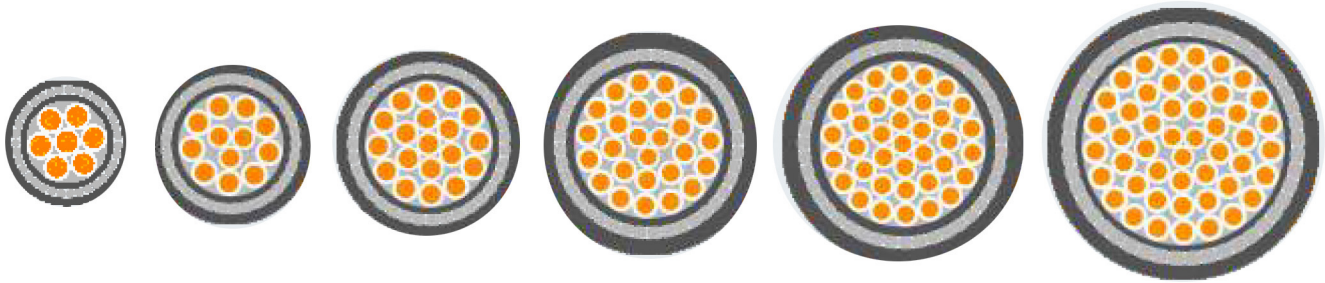

Area	Thickness of XLPE Insulation	Thickness of Bedding	Dimension of Armour Wire	Thickness of MDPE Outersheath	Overall diameter	Net Wt. of Cable
	Nominal	Nominal	Nominal	Nominal	Approx	Approx
mm ²	mm	mm	mm	mm	mm	kg/km
7 x 1.5	0.6	0.8	0.90	1.4	15.2	415
12 x 1.5	0.6	0.8	1.25	1.5	19.4	710
19 x 1.5	0.6	0.8	1.25	1.6	22.2	920
27 x 1.5	0.6	1.0	1.6	1.7	26.7	1365
37 x 1.5	0.6	1.0	1.6	1.7	29.0	1645
48 x 1.5	0.6	1.0	1.6	1.8	32.7	1990

Area	D.C. resistance at 20 °C	A.C. resistance at operating temp.90 °C	Reactance at 50Hz	Current Rating			Short circuit rating for 1 Sec.	Voltage Drop
	Max	Approx	Approx	Ground	Duct	Air		
mm ²	Ohm/km	Ohm/km	Ohm/km	Amps	Amps	Amps	kA(rms)	V/A/km
7 x 1.5	12.1	15.43	0.105	21	17	17	0.215	26.73
12 x 1.5	12.1	15.43	0.105	18	14	14	0.215	26.73
19 x 1.5	12.1	15.43	0.105	15	12	12	0.215	26.73
27 x 1.5	12.1	15.43	0.105	13	10	10	0.215	26.73
37 x 1.5	12.1	15.43	0.105	11	9	9	0.215	26.73
48 x 1.5	12.1	15.43	0.105	10	8	8	0.215	26.73

The above data is indicative & may be changed without prior information.
* Standard Packing: 1000 Mtr Drums

Operating conditions - Amb. air temp. 40° C
Ground temp: 20° C
Depth of laying : 50 cm
Thermal resistivity of soil: 120° C-cm/W

Table - 16

Auxillary (Control) cable, 2.5mm², Copper conductor, XLPE insulated, Gal. steel wire armoured, MDPE sheathed, 600/1000V, generally to BS: 5467

Area	Thickness of XLPE Insulation	Thickness Of Bedding	Dimension of Armour Wire	Thickness of MDPE Outersheath	Over all diameter	Net Wt. of Cable
	Nominal	Nominal	Nominal	Nominal	Approx	Approx
mm ²	mm	mm	mm	mm	mm	kg/km
7 x 2.5	0.7	0.8	0.90	1.4	17.1	540
12 x 2.5	0.7	0.8	1.25	1.6	22.4	930
19 x 2.5	0.7	1.0	1.6	1.7	26.6	1425
27 x 2.5	0.7	1.0	1.6	1.8	30.7	1830
37 x 2.5	0.7	1.0	1.6	1.8	33.8	2240
48 x 2.5	0.7	1.2	2.0	2.0	39.3	3060

Area	D.C. resistance at 20 °C	A.C. resistance at operating temp. 90 °C	Reactance at 50Hz	Current Rating			Short circuit rating for 1 Sec.	Voltage Drop
	Max	Approx	Approx	Ground	Duct	Air		
mm ²	Ohm/km	Ohm/km	Ohm/km	Amps	Amps	Amps	kA(rms)	V/A/km
7 x 2.5	7.41	9.45	0.099	27	22	23	0.358	16.37
12 x 2.5	7.41	9.45	0.099	22	19	19	0.358	16.37
19 x 2.5	7.41	9.45	0.099	19	16	16	0.358	16.37
27 x 2.5	7.41	9.45	0.099	16	14	13	0.358	16.37
37 x 2.5	7.41	9.45	0.099	14	12	12	0.358	16.37
48 x 2.5	7.41	9.45	0.099	13	11	11	0.358	16.37

The above data is indicative & may be changed without prior information.
* Standard Packing: 1000 Mtr Drums

Operating conditions - Amb. Air temp. 40° C
Ground temp: 20° C
Depth of laying : 50 cm
Thermal resistivity of soil: 120° C-cm/W

Table - 17

Auxillary (Control) cable, 4mm², Copper conductor, XLPE insulated, Gal. steel wire armoured, MDPE sheathed, 600/1000V, generally to BS: 5467

Area	Thickness of XLPE Insulation	Thickness Of Bedding	Dimension of Armour Wire	Thickness of MDPE Outersheath	Over all diameter	Net Wt. of Cable
	Nominal	Nominal	Nominal	Nominal	Approx	Approx
mm ²	mm	mm	mm	mm	mm	kg/km
7 x 4	0.7	0.8	1.25	1.5	19.7	800
12 x 4	0.7	1.0	1.6	1.6	25.7	1345
19 x 4	0.7	1.0	1.6	1.7	29.3	1835
27 x 4	0.7	1.0	1.6	1.9	34.4	2400
37 x 4	0.7	1.2	2.0	2.0	39.2	3305
48 x 4	0.7	1.2	2.0	2.1	44.1	4030

Area	D.C. resistance at 20 °C	A.C. resistance at operating temp. 90 °C	Reactance at 50Hz	Current Rating			Short circuit rating for 1 Sec.	Voltage Drop
	Max	Approx	Approx	Ground	Duct	Air		
mm ²	Ohm/km	Ohm/km	Ohm/km	Amps	Amps	Amps	kA(rms)	V/A/km
7 x 4	4.61	5.88	0.093	36	29	30	0.572	10.18
12 x 4	4.61	5.88	0.093	30	24	25	0.572	10.18
19 x 4	4.61	5.88	0.093	25	20	21	0.572	10.18
27 x 4	4.61	5.88	0.093	22	17	18	0.572	10.18
37 x 4	4.61	5.88	0.093	19	16	16	0.572	10.18
48 x 4	4.61	5.88	0.093	18	14	15	0.572	10.18

The above data is indicative & may be changed without prior information.
* Standard Packing: 1000 Mtr Drums

Operating conditions - Amb. air temp. 40° C
Ground temp: 20° C
Depth of laying : 50 cm
Thermal resistivity of soil: 120° C-cm/W

Tables - 18 to 31

Group Rating Factors for Circuits for Three Single Core Cables in Trefoil formation

Table 18: Touching Horizontal Formation laid Direct in Ground

No. of Circuits	Spacing (Between Centres of Circuits)				
	Touching	15 cm	30 cm	45 cm	60 cm
2	0.78	0.81	0.85	0.88	0.90
3	0.68	0.71	0.77	0.81	0.83
4	0.61	0.65	0.72	0.76	0.79
5	0.56	0.61	0.68	0.73	0.78

Table 20: Cables laid on Racks/Trays in covered trench with removable covers where air circulation is restricted. Trefoils are separated by two cable dia horizontally and the trays are in tiers with 30 cm. gap between them.

No. of Racks Trays in tiers	No. of Trefoils in horizontal formation		
	1	2	3
1	0.95	0.90	0.88
2	0.90	0.85	0.83
3	0.88	0.83	0.81
6	0.86	0.81	0.79

Table 19: Cables laid in Trefoil Ducts in horizontal formation

No. of Circuits	Spacing (Between Centres of Circuits)		
	Touching	45 cm	60 cm
2	0.87	0.90	0.91
3	0.79	0.83	0.86
4	0.74	0.79	0.82
5	0.71	0.76	0.79

Table 21: Cables laid as in 'C' but open air

No. of Racks	No. of Cables per Rack		
	1	2	3
1	1	0.98	0.96
2	1	0.95	0.93
3	1	0.94	0.92
6	1	0.93	0.90

Group Rating Factors for Circuits for Multi-core Cables

Table 22: Cables laid inside concrete trench with removable covers, on cable trays where air circulation is restricted. The cables spaced by one cable diameter and trays in tiers by 300 mm. The clearance of the cable from the Wall is 25 mm.

No. of Cables trays in Tier	Number of cables				
	1	2	3	6	9
1	0.95	0.9	0.88	0.85	0.84
2	0.90	0.85	0.83	0.81	0.80
3	0.88	0.83	0.81	0.79	0.78
6	0.86	0.81	0.79	0.77	0.76

Table 23: Cables laid on cable trays exposed to air, the cables spaced by one cable diameter and trays in tiers by 300 mm. The clearance between the Wall and the cable is 25 mm.

No. of Cables Trays in Tier	Number of cables per Rack			
	2	3	6	9
1	0.98	0.96	0.93	0.92
2	0.95	0.93	0.90	0.89
3	0.94	0.92	0.89	0.88
6	0.93	0.90	0.87	0.86

Table 24: Cables laid on cable trays exposed to air, the cables are touching and trays in tiers by 300 mm. The clearance between the wall and the cable is 25 mm.

No. of Cables Trays in Tier	Number of cables per Rack			
	2	3	6	9
1	0.84	0.80	0.75	0.73
2	0.80	0.76	0.71	0.69
3	0.78	0.74	0.70	0.68
6	0.76	0.72	0.68	0.66

Table 25: Cables laid Direct in Ground in horizontal formation.

No. of Cables in group	Spacing of cables			
	Touching	15 cm	30 cm	45 cm
2	0.79	0.82	0.87	0.90
3	0.69	0.75	0.79	0.83
4	0.62	0.69	0.74	0.79
5	0.58	0.65	0.72	0.76
6	0.54	0.61	0.69	0.75

Table 26: Cables laid Direct in single way ducts/pipes in horizontal formation.

No. of Cables in group	Spacing of cables			
	Touching	30 cm	45 cm	60 cm
2	0.88	0.90	0.92	0.94
3	0.82	0.84	0.87	0.89
4	0.77	0.80	0.84	0.87
5	0.74	0.78	0.82	0.85
6	0.71	0.76	0.81	0.84

Table 27: Rating Factor for Variation in Dept. of laying in Ground

Dept. of Laying (cm)	50	80	100	125	150	200 & above
Rating Factor upto 50 mm ²	1	0.97	0.95	0.94	0.93	0.91
Rating Factor 70 mm ² to 300 mm ²	1	0.96	0.94	0.92	0.91	0.88
Rating Factor above 300 mm ²	1	0.94	0.92	0.9	0.89	0.86

Table 28: Rating Factors for Variation in Ambient Air Temperature

Air Temp. °C	15	20	25	30	35	40	45	50	55
Rating Factor	1.22	1.18	1.14	1.1	1.05	1.0	0.95	0.89	0.84

Table 29: Rating Factors for Variation in Ambient Ground Temperature

Group Temp. °C	15	20	25	30	35	40	45	50	55
Rating Factor	1.04	1	0.96	0.9	0.89	0.85	0.8	0.76	0.71

Table 30: Rating Factors for Variation in thermal resistivity of soil (multicore cables laid direct in the ground) - Average values

Nominal area of conductor mm ²	For values of thermal resistivity of Soil in °C-cm/W					
	80	90	100	150	200	250
Up to 16	1.09	1.06	1.04	0.95	0.86	0.79
25 to 150	1.14	1.10	1.07	0.93	0.84	0.76
185 & above	1.16	1.11	1.07	0.92	0.82	0.74

Table 31: Rating Factors for Variation in thermal resistivity of soil, three single core cables laid direct in the ground (three cables in trefoil touching) : Average Values

Nominal area of conductor mm ²	For values of thermal resistivity of Soil in °C-cm/W					
	80	90	100	150	200	250
Up to 150	1.16	1.11	1.07	0.91	0.81	0.73
185 to 400	1.17	1.12	1.07	0.90	0.80	0.72
500 & above	1.18	1.13	1.08	0.90	0.79	0.71

- **CONDUCTOR**

Electrical grade, high conductivity Copper / Aluminium wires are stranded to make compacted circular conductors as per IEC 60228.

- **SEMI-CONDUCTING LAYER OVER CONDUCTOR**

Extruded semi-conducting compound is applied over the conductor, in tandem with insulation.

- **INSULATION**

High quality super clean XLPE insulating compound is used for insulating the cores on 'Maillefer' CCV line equipped with online x-ray analyser to maintain the desired thicknesses of insulation and semiconducting layer as per the relevant standards.

- **SEMI-CONDUCTING LAYER OVER INSULATION**

Shield consisting of a layer of bonded or strippable, extruded semi-conducting compound applied in tandem over the insulation.

- **METALLIC SHIELD**

Copper tape / copper wires is helically applied over the cores, of cross section suitable as per the standard or as per the system fault current requirement. Colour marking tape is applied longitudinally below the metallic sheath for core identification.

- **SEPARATION SHEATH**

Separation sheath of ST-2 PVC along with polypropylene [PP] fillers, is provided.

- **ARMOUR**

The armour is given for the protection of cable against physical damage. Galvanised round steel wire or galvanised steel tapes are applied helically over bedding as armouring. However, single core cables are armored with Aluminium round wire or Aluminium tape.

- **OUTER SHEATH**

The outer sheath shall be of extruded Polyvinyl Chloride (PVC) type ST2 as per IEC 60502-2, Type 9 as per BS 7655 or LSF/LSZH Type LTS1 / ST 8. Polyethylene outer sheath is used in case the cable requires higher impregnability to moisture. Outer sheath is of generally black/ red colour or as per project requirement.

- **MARKING OVER OUTER SHEATH**

Outer sheath shall be marked / embossed with Manufacturer name, no of cores, size, Voltage ratings, and year of manufacture, sequential length marking and any other desired marking for better identification at site.

- **FIRE RETARDANT CABLE SHEATHS**


Cables with special flame retardant PVC compounds meeting flame test requirements of IEC 60332-3-22, IEC 60332-3-23 or IEC 60332-3-24 are manufactured as per project requirement.

- **PACKING**

The cables are supplied on drums manufactured from high quality pine wood or steel. The pine wooden drums are properly seasoned and treated, with minimum painting to make them more eco-friendly. The cable ends are sealed with heat shrinkable end caps, marked with our logo, to avoid any possibility of ingress of water or dirt during transportation and storage as well as any pilferage of the cable.

Each drum is clearly marked with our name and logo, type, size, length, net and gross weight and sequential length marking details. An arrow and suitable instruction is marked on the drum indicating the direction, the drum should be rolled while laying the cable.

- **TYPICAL CROSS SECTION DRAWING OF MV CABLE**

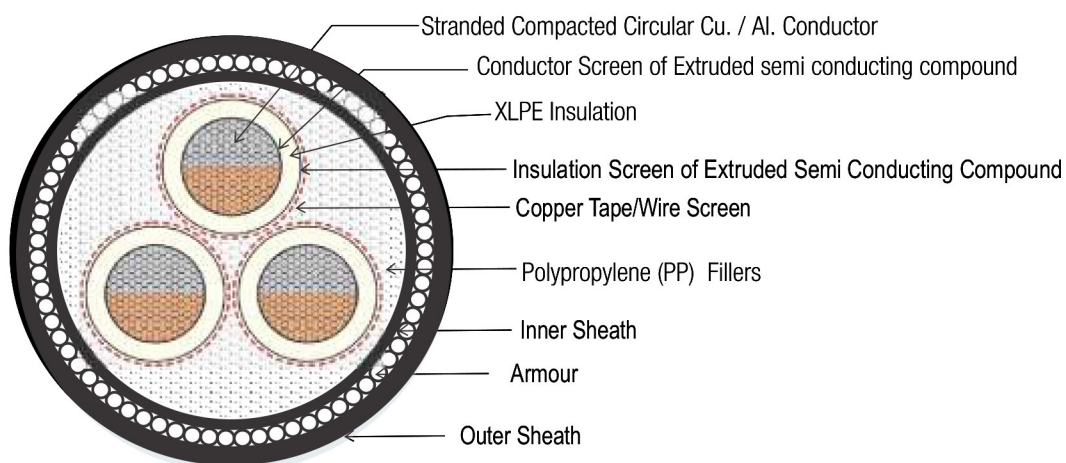

● **Voltage designations U₀/U (U_m) and Categories**

- 1) 3.6/6.0(7.2) kV 2) 6.0/10(12) kV 3) 8.7/15(17.5) kV 4) 12/20(24) kV 5) 18/30(36) kV

U₀ is the rated power frequency voltage between conductor and earth or metallic screen for which the cable is designed.

U is the rated power frequency voltage between conductors for which the cable is designed.

U_m is the maximum value of the "highest system voltage" for which the equipment may be used.

The rated voltage of the cable for a given application shall be suitable for the operating conditions in the system in which the cable is used. To facilitate the selection of the cable, systems are divided into three categories:

Category A: this category comprises those systems in which any phase conductor that comes in contact with earth or an earth conductor is disconnected from the system within 1 min.

Category B: this category comprises those systems which, under fault conditions, are operated for a short time with one phase earthed. This period, according to IEC 60183, should not exceed 1 hr. For cables covered by this standard, a longer period, not exceeding 8 hr. on any occasion, can be tolerated. The total duration of earth faults in any year should not exceed 125 hr.


Category C: this category comprises all systems which do not fall into category A or B.

NOTE: It should be realized that in a system where an earth fault is not automatically and promptly isolated, the extra stresses on the insulation of cables during the earth fault reduce the life of the cables to a certain degree. If the system is expected to be operated fairly often with a permanent earth fault, it may be advisable to classify the system in category C.


● **SHORT CIRCUIT RATINGS OF CONDUCTORS**

The values of fault current given in the graph below are based on the cable being fully loaded at the start of the short circuit (conductor temperature 90°C) and a final conductor temperature of 250°C. It should be ensured that the accessories associated with the cables are also capable of operation at these values of fault current and temperature.

COPPER CONDUCTORS

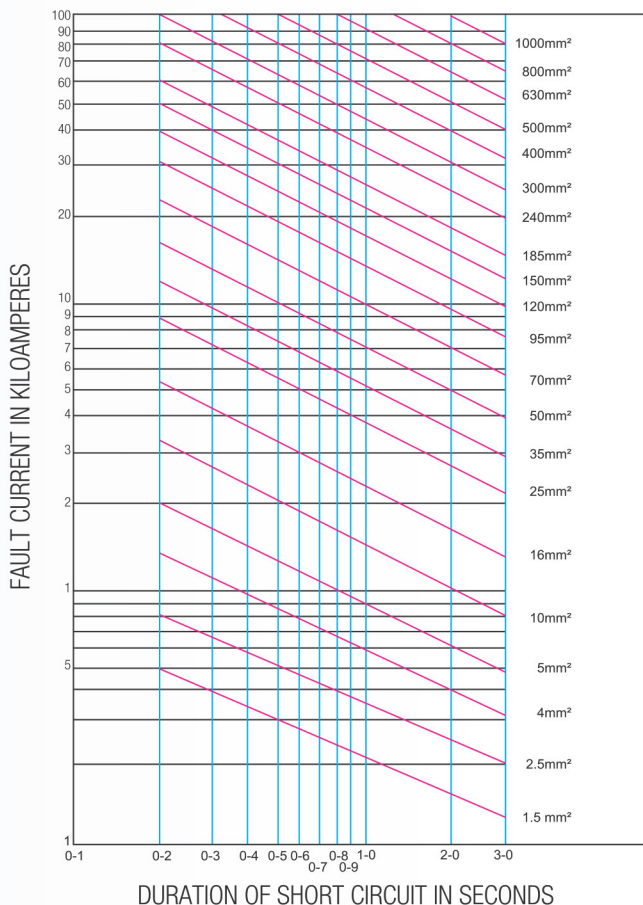

ALUMINIUM CONDUCTORS

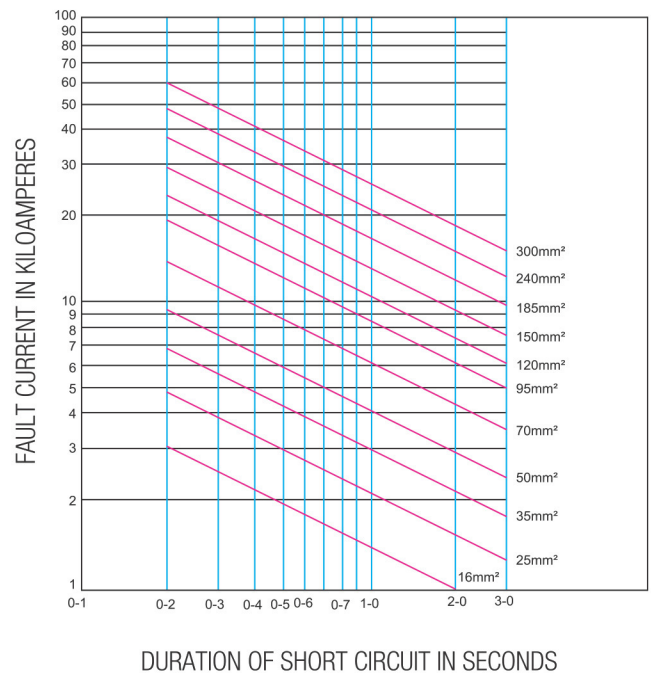

FOLLOWING TESTS ARE CARRIED OUT ON THE CABLES:**ROUTINE TESTS**

- a) Conductor resistance test
- b) Partial discharge test [for screened cables only]
[To be carried out on full drum length]
- c) High voltage test

SAMPLE TESTS

- a) Conductor examination
- b) Check of dimensions
- c) Voltage test for 4 hr.
- d) Hot set test

SPECIAL TESTS FOR FRLS CABLES

- i) Oxygen Index Test as per ASTM-D-2863
- ii) Temp. Index Test as per ASTM-D-2863
- iii) Acid Gas Generation test (HCL) as per IEC-754(1)
- iv) Light transmission as per BS EN 61034
- v) Smoke density test as per ASTM-D-2843
- vi) Flammability tests
 - a. As per IEC 332-1
 - b. As per IEC 332-3
 - c. Swedish Chimney as per SS-424-14-75 (Class F 3)
 - d. IEEE - 383

PARTIAL DISCHARGE TEST

This test is conducted for detection and measurement of partial discharge in screened cables. Partial discharges in voids remain unnoticed in the normal HV test and could be harmful for the life of insulation.

Extruded di-electric tends to deteriorate very fast due to the discharges in small voids and cavities. It is therefore necessary that such voids should as far as possible be avoided in the extrusion process.

Still certain minute voids are unavoidable and these remain in the insulation. The magnitude of discharge in such voids is measured so as to determine whether these are within permissible limits.

This test is performed on such extruded di-electric in order to ensure that the insulation is free from partial discharges in excess of certain limits.

IMPULSE TEST

Insulating material used in M.V. cables is subjected to transient over voltages resulting from nearby lightning strokes. The ability of insulating material to withstand these transient voltages is important in establishing the reliability of the cable insulation and the design of cable.

TYPE TESTS**ELECTRICAL**


- 1) Bending test followed by partial discharge test
- 2) Tan δ . measurement
- 3) Heating cycle test followed by partial discharge test
- 4) Impulse test followed by voltage test
- 5) Voltage test of 4 hr.
- 6) Resistivity of semi-conducting screen
- 7) Insulation resistance measurement

NON-ELECTRICAL

- 1) Measurement of Insulation thickness
- 2) Measurement of thickness of non-metallic sheaths
- 3) Determination of mechanical properties of Insulation before & after ageing
- 4) Determination of mechanical properties of Non-metallic sheaths before & after ageing
- 5) Ageing test on pieces of completed cable
- 6) Loss of mass for PVC sheath
- 7) Pressure test at high temperature
- 8) Tests at low temperatures on PVC sheath
- 9) Heat shock test
- 10) Hot set test
- 11) Water absorption test on insulation
- 12) Flame spread test for PVC sheathed cables
- 13) Shrinkage for XLPE insulation

Table-32
3.6/6.0 (7.2) kV

**Single core XLPE Insulated Screened Armoured cable
with Aluminium/Copper conductor Conf. to IEC:60502-2**

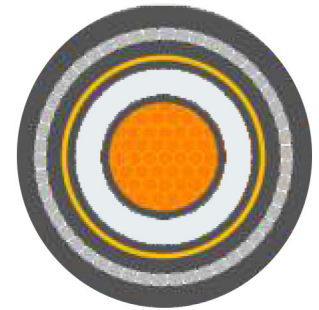

Area mm ²	Thickness of XLPE Insulation		Thickness of Separation Sheath		Dimension of Armour Wire		Thickness of Outer sheath		Approx. Overall diameter mm	Approx. Net Wt. of Cable	
	mm		mm		mm		mm			kg/km	kg/km
	Nom		Nom				Nom	Min		Al	Cu
25	2.5		1.2		1.6		1.80	1.24	23	670	820
35	2.5		1.2		1.6		1.80	1.24	24	735	950
50	2.5		1.2		1.6		1.80	1.24	25	815	1100
70	2.5		1.2		1.6		1.80	1.24	27	930	1355
95	2.5		1.2		1.6		1.90	1.32	29	1080	1650
120	2.5		1.2		1.6		1.90	1.32	30	1200	1930
150	2.5		1.2		1.6		2.00	1.40	32	1330	2235
185	2.5		1.2		2.0		2.00	1.40	34	1600	2725
240	2.6		1.2		2.0		2.10	1.48	38	1925	3350
300	2.8		1.2		2.0		2.20	1.56	40	2225	4065
400	3.0		1.2		2.0		2.30	1.64	44	2660	5030
500	3.2		1.3		2.5		2.50	1.80	49	3365	6350
630	3.2		1.4		2.5		2.60	1.88	53	3980	7890
800	3.2		1.4		2.5		2.70	1.96	58	4715	9665
1000	3.2		1.5		2.5		2.90	2.12	63	5600	11775


Area mm ²	Max D.C. resistance at 20°C		Approx. A.C. resistance at operating temp 90°C		Approx. reactance at 50 Hz Ohm/km	Approx. Capacitance µf/km	Current Rating as per IEC 60 502-2						Short circuit rating for 1 Sec.	
	Ohm/km		Ohm/km				Direct in Ground		In duct		In Air		kA(rms)	
	Al	Cu	Al	Cu	Amps	Amps	Amps	Amps	Amps	Amps	Al	Cu		
	Al	Cu	Al	Cu	Al	Cu	Al	Cu	Al	Cu	Al	Cu		
25	1.20	0.727	1.54	0.927	0.148	0.263	108	140	102	132	127	163	2.35	3.58
35	0.868	0.524	1.113	0.668	0.141	0.292	129	166	122	157	154	198	3.29	5.01
50	0.641	0.387	0.822	0.494	0.134	0.326	152	196	144	186	184	238	4.70	7.15
70	0.443	0.268	0.568	0.342	0.124	0.371	186	239	176	227	230	296	6.58	10.01
95	0.320	0.193	0.411	0.247	0.118	0.418	221	285	210	271	280	361	8.93	13.6
120	0.253	0.153	0.325	0.196	0.114	0.460	252	323	240	308	324	417	11.28	17.2
150	0.206	0.124	0.265	0.159	0.111	0.494	281	361	267	343	368	473	14.1	21.5
185	0.164	0.0991	0.211	0.1276	0.107	0.550	317	406	303	387	424	543	17.4	26.5
240	0.125	0.0754	0.161	0.0979	0.105	0.601	367	469	351	447	502	641	22.6	34.3
300	0.100	0.0601	0.130	0.0789	0.102	0.617	414	526	397	504	577	735	28.2	42.9
400	0.0778	0.0470	0.1016	0.0629	0.098	0.655	470	590	451	564	673	845	37.6	57.2
500	0.0605	0.0366	0.0800	0.0504	0.098	0.686	533	669	511	639	763	958	47.0	71.5
630	0.0469	0.0283	0.0633	0.0409	0.095	0.766	605	760	581	727	867	1089	59.2	90.1
800	0.0367	0.0221	0.0512	0.0342	0.091	0.862	684	860	657	822	980	1232	75.2	114.4
1000	0.0291	0.0176	0.0425	0.0294	0.090	0.949	768	964	737	922	1100	1381	94.0	143.0

The above data is indicative & may be changed without prior information.
All conductors will be compacted circular shaped
Cables can be supplied in multiples of 500 mtrs or as per customer requirement.

Operating conditions - Amb. air temp. 30° C
Ground temp: 20° C
Depth of laying : 80 cm
Thermal resistivity of soil: 1.50 K-m/W
Thermal resistivity of duct: 1.20 K-m/W

Table-33
3.6/6.0 (7.2) kV

**Three core XLPE Insulated Screened Armoured cable
with Aluminium/Copper conductor Conf. to IEC:60502-2**

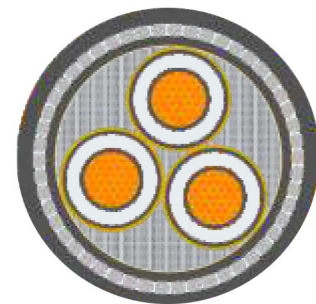

Area mm ²	Thickness of XLPE Insulation		Thickness of Separation Sheath		Dimension of Armour Wire		Thickness of Outer sheath		Approx. Overall diameter mm	Approx. Net Wt. of Cable	
	mm		mm		mm		mm			kg/km	kg/km
	Nom		Nom				Nom Min				
25	2.5	2.5	1.2	1.2	2.00	2.30	1.64	39	2500	2955	
35	2.5	2.5	1.2	1.2	2.00	2.30	1.64	42	3090	3745	
50	2.5	2.5	1.3	1.3	2.50	2.50	1.80	46	3935	4800	
70	2.5	2.5	1.4	1.4	2.50	2.60	1.88	50	4575	5865	
95	2.5	2.5	1.4	1.4	2.50	2.70	1.96	54	5225	6985	
120	2.5	2.5	1.5	1.5	2.50	2.80	2.04	57	5865	8075	
150	2.5	2.5	1.5	1.5	2.50	2.90	2.12	60	6465	9210	
185	2.5	2.5	1.6	1.6	2.50	3.00	2.20	65	7430	10810	
240	2.6	2.6	1.7	1.7	2.50	3.20	2.36	72	8945	13265	
300	2.8	2.8	1.8	1.8	3.15	3.50	2.60	79	11275	16840	
400	3.0	3.0	2.0	2.0	3.15	3.80	2.84	88	13615	20795	


Area mm ²	Max D.C. resistance at 20°C		Approx. A.C. resistance at operating temp 90°C		Approx. reactance at 50 Hz Ohm/km	Approx. Capacitance µf/km	Current Rating as per IEC 60 502-2						Short circuit rating for 1 Sec. kA(rms)	
	Ohm/km		Ohm/km				Direct in Ground		In duct		In Air			
	Al	Cu	Al	Cu			Amps	Amps	Amps	Amps	Amps	Amps		
	Al	Cu	Al	Cu			Al	Cu	Al	Cu	Al	Cu		
25	1.20	0.727	1.54	0.927	0.118	0.263	100	129	87	112	111	143	2.35	3.58
35	0.868	0.524	1.113	0.668	0.113	0.292	119	154	104	134	133	172	3.29	5.01
50	0.641	0.387	0.822	0.494	0.180	0.326	140	181	123	158	159	205	4.70	7.15
70	0.443	0.268	0.568	0.342	0.099	0.371	171	220	150	194	196	253	6.58	10.01
95	0.320	0.193	0.411	0.247	0.095	0.418	204	263	180	232	238	307	8.93	13.60
120	0.253	0.153	0.325	0.196	0.092	0.460	232	298	206	264	274	352	11.28	17.20
150	0.206	0.124	0.265	0.160	0.090	0.494	259	332	231	296	309	397	14.10	21.50
185	0.164	0.0991	0.211	0.1286	0.0863	0.550	293	374	262	335	354	453	17.40	26.50
240	0.125	0.0754	0.162	0.0987	0.0858	0.601	338	431	304	387	415	529	22.60	34.30
300	0.100	0.0601	0.130	0.0799	0.084	0.617	380	482	343	435	472	599	28.20	42.90
400	0.0778	0.0470	0.1024	0.0642	0.0821	0.655	432	541	393	492	545	683	37.60	57.20

The above data is indicative & may be changed without prior information.
All conductors will be compacted circular shaped
Cables can be supplied in multiples of 250/500 mtrs or as per customer requirement.

Operating conditions - Amb. air temp. 30° C
Ground temp: 20° C
Depth of laying : 80 cm
Thermal resistivity of soil: 1.50 K-m/W
Thermal resistivity of duct: 1.20 K-m/W

Table-34
6/10 (12) kV

**Single core XLPE Insulated Screened Armoured cable
with Aluminium/Copper conductor Conf. to IEC:60502-2**

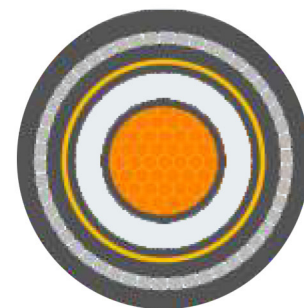

Area mm ²	Thickness of XLPE Insulation		Thickness of Separation Sheath		Dimension of Armour Wire		Thickness of Outer sheath		Approx. Overall diameter mm	Approx. Net Wt. of Cable	
	mm		mm		mm	mm		mm		kg/km	
	Nom		Nom			Nom	Min			Al	Cu
25	3.4	1.2	1.6	1.80	1.24	25	750	905			
35	3.4	1.2	1.6	1.80	1.24	26	820	1040			
50	3.4	1.2	1.6	1.80	1.24	27	900	1190			
70	3.4	1.2	1.6	1.90	1.32	29	1040	1465			
95	3.4	1.2	1.6	1.90	1.32	30	1180	1765			
120	3.4	1.2	1.6	2.00	1.40	32	1320	2050			
150	3.4	1.2	2.0	2.10	1.48	34	1550	2455			
185	3.4	1.2	2.0	2.10	1.48	36	1740	2860			
240	3.4	1.2	2.0	2.20	1.56	39	2060	3485			
300	3.4	1.2	2.0	2.20	1.56	43	2320	4155			
400	3.4	1.2	2.0	2.40	1.72	45	2745	5115			
500	3.4	1.3	2.5	2.50	1.80	50	3395	6380			
630	3.4	1.4	2.5	2.60	1.88	54	4030	7935			
800	3.4	1.4	2.5	2.70	1.96	58	4765	9710			
1000	3.4	1.5	2.5	2.90	2.12	63	5655	11800			


Area mm ²	Max D.C. resistance at 20°C		Approx. A.C. resistance at operating temp 90°C		Approx. reactance at 50 Hz Ohm/km	Approx. Capacitance µf/km	Current Rating as per IEC 60 502-2						Short circuit rating for 1 Sec.	
	Ohm/km		Ohm/km				Direct in Ground		In duct		In Air		kA(rms)	
	Al	Cu	Al	Cu			Amps	Amps	Amps	Amps	Amps	Amps	Al	Cu
	Al	Cu	Al	Cu			Al	Cu	Al	Cu	Al	Cu	Al	Cu
25	1.20	0.727	1.54	0.927	0.153	0.209	108	140	102	132	127	163	2.35	3.58
35	0.868	0.524	1.113	0.668	0.146	0.230	129	166	122	157	154	198	3.29	5.01
50	0.641	0.387	0.822	0.494	0.138	0.255	152	196	144	186	184	238	4.70	7.15
70	0.443	0.268	0.568	0.342	0.129	0.289	186	239	176	227	230	296	6.58	10.01
95	0.320	0.193	0.411	0.247	0.122	0.324	221	285	210	271	280	361	8.93	13.6
120	0.253	0.153	0.325	0.196	0.118	0.355	252	323	240	308	324	417	11.28	17.2
150	0.206	0.124	0.265	0.159	0.116	0.380	281	361	267	343	368	473	14.1	21.5
185	0.164	0.0991	0.211	0.1276	0.111	0.421	317	406	303	387	424	543	17.4	26.5
240	0.125	0.0754	0.161	0.0978	0.108	0.475	367	469	351	447	502	641	22.6	34.3
300	0.100	0.0601	0.130	0.0788	0.104	0.520	414	526	397	504	577	735	28.2	42.9
400	0.0778	0.0470	0.1016	0.0628	0.100	0.585	470	590	451	564	673	845	37.6	57.2
500	0.0605	0.0366	0.0799	0.0504	0.098	0.649	533	669	511	639	763	958	47.0	71.5
630	0.0469	0.0283	0.0633	0.0408	0.095	0.725	605	760	581	727	867	1089	59.2	90.1
800	0.0367	0.0221	0.0512	0.0341	0.092	0.815	684	860	657	822	980	1232	75.2	114.4
1000	0.0291	0.0176	0.0425	0.0294	0.090	0.897	768	964	737	922	1100	1381	94.0	143.0

The above data is indicative & may be changed without prior information.
All conductors will be compacted circular shaped
Cables can be supplied in multiples of 500 mtrs or as per customer requirement.

Operating conditions - Amb. air temp. 30° C
Ground temp: 20° C
Depth of laying : 80 cm
Thermal resistivity of soil: 1.50 K-m/W
Thermal resistivity of duct: 1.20 K-m/W

Table-35
6/10 (12) kV

**Three core XLPE Insulated Screened Armoured cable
with Aluminium/Copper conductor Conf. to IEC:60502-2**

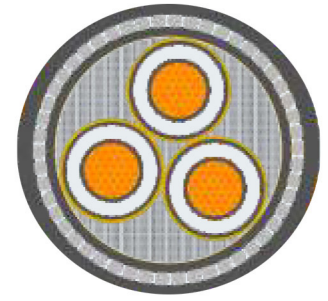

Area mm ²	Thickness of XLPE Insulation	Thickness of Seperation Sheath	Dimension of Armour Wire mm	Thickness of Outer sheath		Approx. Overall diameter mm	Approx. Net Wt. of Cable	
	mm	mm		mm	mm		kg/km	kg/km
	Nom	Nom		Nom	Min		Al	Cu
25	3.4	1.3	2.50	2.40	1.72	45	3335	3790
35	3.4	1.3	2.50	2.50	1.80	47	3600	4260
50	3.4	1.4	2.50	2.60	1.88	51	4080	4950
70	3.4	1.4	2.50	2.70	1.96	54	4530	5820
95	3.4	1.5	2.50	2.90	2.12	58	5215	6980
120	3.4	1.6	2.50	3.00	2.20	62	5845	8060
150	3.4	1.6	2.50	3.10	2.28	64	6335	9075
185	3.4	1.7	2.50	3.20	2.36	69	7155	10535
240	3.4	1.8	3.15	3.40	2.52	77	9340	13655
300	3.4	1.9	3.15	3.60	2.68	82	10430	16000
400	3.4	2.0	3.15	3.80	2.84	90	12185	19365


Area mm ²	Max D.C. resistance at 20°C		Approx. A.C. resistance at operating temp 90°C		Approx. reactance at 50 Hz Ohm/km	Approx. Capaci- tance µf/km	Current Rating as per IEC 60 502-2						Short circuit rating for 1 Sec. kA(rms)	
	Ohm/km		Ohm/km				Direct in Ground		In duct		In Air			
	Al	Cu	Al	Cu			Amps	Amps	Amps	Amps	Amps	Amps		
	Al	Cu	Al	Cu			Al	Cu	Al	Cu	Al	Cu		
25	1.20	0.727	1.54	0.927	0.126	0.209	100	129	87	112	111	143	2.35	3.58
35	0.868	0.524	1.113	0.668	0.120	0.230	119	154	104	134	133	172	3.29	5.01
50	0.641	0.387	0.822	0.494	0.114	0.255	140	181	123	158	159	205	4.70	7.15
70	0.443	0.268	0.568	0.342	0.106	0.289	171	220	150	194	196	253	6.58	10.01
95	0.320	0.193	0.411	0.247	0.101	0.324	204	263	180	232	238	307	8.93	13.6
120	0.253	0.153	0.325	0.196	0.097	0.355	232	298	206	264	274	352	11.28	17.2
150	0.206	0.124	0.265	0.159	0.095	0.380	259	332	231	296	309	397	14.1	21.5
185	0.164	0.0991	0.211	0.1281	0.0910	0.421	293	374	262	335	354	453	17.4	26.5
240	0.125	0.0754	0.162	0.0985	0.0895	0.475	338	431	304	387	415	529	22.6	34.3
300	0.100	0.0601	0.130	0.0797	0.0870	0.520	380	482	343	435	472	599	28.2	42.9
400	0.0778	0.0470	0.1024	0.0641	0.0836	0.585	432	541	393	492	545	683	37.6	57.2

The above data is indicative & may be changed without prior information.
All conductors will be compacted circular shaped
Cables can be supplied in multiples of 250/500 mtrs or as per customer requirement.

Operating conditions - Amb. air temp. 30° C
Ground temp: 20° C
Depth of laying : 80 cm
Thermal resistivity of soil: 1.50 K-m/W
Thermal resistivity of duct: 1.20 K-m/W

Table-36
8.7/15 (17.5) kV

**Single core XLPE Insulated Screened Armoured cable
with Aluminium/Copper conductor Conf. to IEC:60502-2**

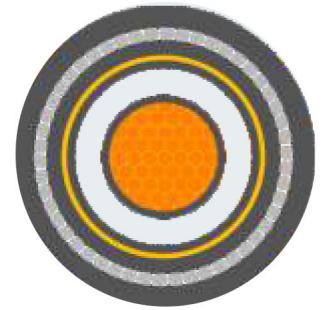

Area mm ²	Thickness of XLPE Insulation	Thickness of Seperation Sheath	Dimension of Armour Wire mm	Thickness of Outer sheath		Approx. Overall diameter mm	Approx. Net Wt. of Cable	
	mm	mm		mm	mm		kg/km	kg/km
	Nom	Nom		Nom	Min		Al	Cu
25	4.5	1.2	1.60	1.80	1.24	27	865	1020
35	4.5	1.2	1.60	1.90	1.32	28	950	1170
50	4.5	1.2	1.60	1.90	1.32	29	1040	1325
70	4.5	1.2	1.60	1.90	1.32	31	1165	1595
95	4.5	1.2	2.00	2.00	1.40	34	1420	2000
120	4.5	1.2	2.00	2.10	1.48	35	1575	2305
150	4.5	1.2	2.00	2.10	1.48	37	1700	2605
185	4.5	1.2	2.00	2.20	1.56	39	1915	3030
240	4.5	1.2	2.00	2.30	1.64	42	2240	3665
300	4.5	1.2	2.00	2.30	1.64	44	2510	4250
400	4.5	1.3	2.50	2.50	1.80	49	3135	5500
500	4.5	1.3	2.50	2.60	1.88	52	3630	6615
630	4.5	1.4	2.50	2.70	1.96	56	4265	8175
800	4.5	1.5	2.50	2.80	2.04	61	5075	10020
1000	4.5	1.6	2.50	3.00	2.20	66	5970	12130

Area mm ²	Max D.C. resistance at 20°C		Approx. A.C. resistance at operating temp 90°C		Approx. reactance at 50 Hz Ohm/km	Approx. Capaci- tance µf/km	Current Rating as per IEC 60 502-2						Short circuit rating for 1 Sec. kA(rms)	
	Ohm/km		Ohm/km				Direct in Ground		In duct		In Air			
	Al	Cu	Al	Cu			Amps	Amps	Amps	Amps	Amps	Amps		
	Al	Cu	Al	Cu			Al	Cu	Al	Cu	Al	Cu		
25	1.20	0.727	1.54	0.927	0.158	0.171	108	140	102	132	127	163	2.35	3.58
35	0.868	0.524	1.113	0.668	0.151	0.187	129	166	122	157	154	198	3.29	5.01
50	0.641	0.387	0.822	0.494	0.144	0.207	152	196	144	186	184	238	4.70	7.15
70	0.443	0.268	0.568	0.342	0.133	0.232	186	239	176	227	230	296	6.58	10.01
95	0.320	0.193	0.411	0.247	0.128	0.259	221	285	210	271	280	361	8.93	13.6
120	0.253	0.153	0.325	0.196	0.124	0.283	252	323	240	308	324	417	11.28	17.2
150	0.206	0.124	0.265	0.159	0.120	0.302	281	361	267	343	368	473	14.1	21.5
185	0.164	0.0991	0.211	0.1275	0.115	0.333	317	406	303	387	424	543	17.4	26.5
240	0.125	0.0754	0.161	0.0977	0.112	0.374	367	469	351	447	502	641	22.6	34.3
300	0.100	0.0601	0.129	0.0787	0.108	0.408	414	526	397	504	577	735	28.2	42.9
400	0.0778	0.0470	0.1014	0.0626	0.105	0.458	470	590	451	564	673	845	37.6	57.2
500	0.0605	0.0366	0.0798	0.0502	0.101	0.506	533	669	511	639	763	958	47.0	71.5
630	0.0469	0.0283	0.0631	0.0406	0.098	0.564	605	760	581	727	867	1089	59.2	90.1
800	0.0367	0.0221	0.0510	0.0338	0.095	0.632	684	860	657	822	980	1232	75.2	114.4
1000	0.0291	0.0176	0.0422	0.0291	0.092	0.6941	768	964	737	922	1100	1381	94.0	143.0

The above data is indicative & may be changed without prior information.
All conductors will be compacted circular shaped
Cables can be supplied in multiples of 500 mtrs or as per customer requirement.

Operating conditions - Amb. air temp. 30° C
Ground temp: 20° C
Depth of laying : 80 cm
Thermal resistivity of soil: 1.50 K-m/W
Thermal resistivity of duct: 1.20 K-m/W

Table-37
8.7/15 (17.5) kV

**Three core XLPE Insulated Screened Armoured cable
with Aluminium/Copper conductor Conf. to IEC:60502-2**



Area mm ²	Thickness of XLPE Insulation	Thickness Seperation Sheath	Dimension of Armour Wire mm	Thickness of Outer sheath		Approx. Overall diameter mm	Approx. Net Wt. of Cable	
	mm Nom	mm Nom		mm Nom	mm Min		kg/km Al	kg/km Cu
25	4.5	1.4	2.50	2.60	1.88	50	3950	4405
35	4.5	1.4	2.50	2.70	1.96	52	4230	4890
50	4.5	1.5	2.50	2.80	2.04	55	4625	5490
70	4.5	1.5	2.50	2.90	2.12	59	5210	6505
95	4.5	1.6	2.50	3.00	2.20	63	5895	7655
120	4.5	1.7	2.50	3.10	2.28	67	6490	8705
150	4.5	1.7	2.50	3.20	2.36	70	7025	9765
185	4.5	1.8	3.15	3.40	2.52	76	8780	12160
240	4.5	1.9	3.15	3.60	2.68	82	10135	14455
300	4.5	2.0	3.15	3.70	2.76	87	11300	16860
400	4.5	2.1	3.15	4.00	3.00	95	13715	20355


Area mm ²	Max D.C. resistance at 20°C		Approx. A.C. resistance at operating temp 90°C		Approx. reactance at 50 Hz Ohm/km	Approx. Capaci- tance µf/km	Current Rating as per IEC 60 502-2						Short circuit rating for 1 Sec. kA(rms)	
	Ohm/km Al	Ohm/km Cu	Ohm/km Al	Ohm/km Cu			Direct in Ground		In duct		In Air		Al	Cu
	Amps	Amps	Amps	Amps	Amps	Amps	Al	Cu	Al	Cu	Al	Cu	Al	Cu
25	1.20	0.727	1.540	0.927	0.134	0.171	100	129	87	112	111	143	2.35	3.58
35	0.868	0.524	1.113	0.668	0.128	0.187	119	154	104	134	134	172	3.29	5.01
50	0.641	0.387	0.822	0.494	0.122	0.207	140	181	123	158	159	205	4.70	7.15
70	0.443	0.268	0.568	0.342	0.113	0.232	171	220	150	194	196	253	6.58	10.01
95	0.320	0.193	0.411	0.247	0.107	0.259	204	263	180	232	238	307	8.93	13.6
120	0.253	0.153	0.325	0.196	0.103	0.283	232	298	206	264	274	352	11.28	17.2
150	0.206	0.124	0.265	0.159	0.101	0.302	259	332	231	296	309	397	14.1	21.5
185	0.164	0.0991	0.211	0.128	0.0963	0.333	293	374	262	335	354	453	17.4	26.5
240	0.125	0.0754	0.162	0.0978	0.0942	0.374	338	431	304	387	415	529	22.6	34.3
300	0.100	0.0601	0.130	0.0795	0.0914	0.408	380	482	343	435	472	599	28.2	42.9
400	0.0778	0.0470	0.1021	0.0637	0.0876	0.458	432	541	393	492	545	683	37.6	57.2

The above data is indicative & may be changed without prior information.
All conductors will be compacted circular shaped
Cables can be supplied in multiples of 250/500 mtrs or as per customer requirement.

Operating conditions - Amb. air temp. 30° C
Ground temp: 20° C
Depth of laying : 80 cm
Thermal resistivity of soil: 1.50 K-m/W
Thermal resistivity of duct: 1.20 K-m/W

Table-38
12/20 (24) kV

**Single core XLPE Insulated Screened Armoured cable
with Aluminium/Copper conductor Conf. to IEC:60502-2**

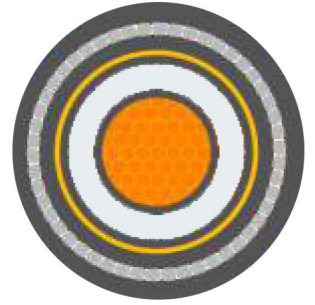

Area mm ²	Thickness of XLPE Insulation	Thickness of Seperation Sheath	Dimension of Armour Wire mm	Thickness of Outer sheath		Approx. Overall diameter mm	Approx. Net Wt. of Cable	
	mm	mm		mm	mm		kg/km	kg/km
	Nom	Nom		Nom	Min		Al	Cu
35	5.5	1.2	1.6	1.90	1.32	30	1060	1280
50	5.5	1.2	1.6	2.00	1.40	32	1165	1455
70	5.5	1.2	2.0	2.00	1.40	34	1390	1820
95	5.5	1.2	2.0	2.10	1.48	36	1560	2145
120	5.5	1.2	2.0	2.10	1.48	37	1715	2445
150	5.5	1.2	2.0	2.20	1.56	39	1860	2765
185	5.5	1.2	2.0	2.20	1.56	41	2065	3180
240	5.5	1.2	2.0	2.30	1.64	44	2400	3825
300	5.5	1.3	2.5	2.40	1.72	47	2885	4720
400	5.5	1.3	2.5	2.50	1.80	51	3315	5680
500	5.5	1.4	2.5	2.60	1.88	54	3840	6830
630	5.5	1.4	2.5	2.80	2.04	59	4525	8430
800	5.5	1.5	2.5	2.90	2.12	63	5335	10280
1000	5.5	1.6	2.5	3.00	2.20	68	6200	12365


Area mm ²	Max D.C. resistance at 20°C		Approx. A.C. resistance at operating temp 90°C		Approx. reactance at 50 Hz Ohm/km	Approx. Capaci- tance µf/km	Current Rating as per IEC 60 502-2						Short circuit rating for 1 Sec. kA(rms)	
	Ohm/km		Ohm/km				Direct in Ground		In duct		In Air			
	Al	Cu	Al	Cu			Amps	Amps	Amps	Amps	Amps	Amps		
	Al	Cu	Al	Cu			Al	Cu	Al	Cu	Al	Cu		
35	0868	0.524	1.113	0.668	0.155	0.150	129	166	122	157	154	198	3.29	5.01
50	0.641	0.387	0.822	0.494	0.148	0.163	152	196	144	186	184	238	4.70	7.15
70	0.443	0.268	0.568	0.342	0.142	0.179	186	239	176	227	230	296	6.58	10.01
95	0.320	0.193	0.411	0.247	0.132	0.200	221	285	210	271	280	361	8.93	13.6
120	0.253	0.153	0.325	0.196	0.127	0.223	252	323	240	308	324	417	11.28	17.2
150	0.206	0.124	0.265	0.159	0.124	0.242	281	361	267	343	368	473	14.1	21.5
185	0.164	0.0991	0.211	0.1275	0.119	0.258	317	406	303	387	424	543	17.4	26.5
240	0.125	0.0754	0.161	0.0976	0.115	0.283	367	469	351	447	502	641	22.6	34.3
300	0.100	0.0601	0.129	0.0785	0.112	0.317	414	526	397	504	577	735	28.2	42.9
400	0.0778	0.0470	0.1014	0.0625	0.108	0.345	470	590	451	564	673	845	37.6	57.2
500	0.0605	0.0366	0.0797	0.0500	0.104	0.386	533	667	511	638	763	956	47.0	71.5
630	0.0469	0.0286	0.0630	0.0404	0.100	0.426	604	756	580	723	865	1083	59.2	90.1
800	0.0367	0.0221	0.0508	0.0336	0.097	0.473	686	860	659	822	983	1231	75.2	114.4
1000	0.0291	0.0176	0.0420	0.0289	0.094	0.529	776	973	744	930	1111	1393	94.0	143.0

The above data is indicative & may be changed without prior information.
All conductors will be compacted circular shaped
Cables can be supplied in multiples of 500 mtrs or as per customer requirement.

Operating conditions - Amb. air temp. 30° C
Ground temp: 20° C
Depth of laying : 80 cm
Thermal resistivity of soil: 1.50 K-m/W
Thermal resistivity of duct: 1.20 K-m/W

Table-39
12/20 (24) kV

**Three core XLPE Insulated Screened Armoured cable
with Aluminium/Copper conductor Conf. to IEC:60502-2**

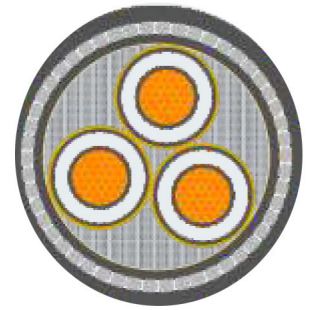

Area mm ²	Thickness of XLPE Insulation		Thickness of Seperation Sheath		Dimension of Armour Wire		Thickness of Outer sheath		Approx. Overall diameter mm	Approx. Net Wt. of Cable	
	mm		mm		mm		mm			kg/km	kg/km
	Nom		Nom				Nom	Min		Al	Cu
35	5.5	5.5	1.5	1.5	2.50	2.50	2.80	2.04	57	4775	5435
50	5.5	5.5	1.6	1.6	2.50	2.50	2.90	2.12	60	5245	6110
70	5.5	5.5	1.6	1.6	2.50	2.50	3.10	2.28	64	5350	6645
95	5.5	5.5	1.7	1.7	2.50	2.50	3.20	2.36	68	6575	8340
120	5.5	5.5	1.7	1.7	3.15	3.15	3.30	2.44	73	7975	10190
150	5.5	5.5	1.8	1.8	3.15	3.15	3.40	2.52	76	8610	11350
185	5.5	5.5	1.9	1.9	3.15	3.15	3.60	2.68	80	9520	12900
240	5.5	5.5	2.0	2.0	3.15	3.15	3.70	2.76	87	10950	15265
300	5.5	5.5	2.0	2.0	3.15	3.15	3.90	2.92	92	12190	17755
400	5.5	5.5	2.2	2.2	3.15	3.15	4.10	3.08	100	14035	21215


Area mm ²	Max D.C. resistance at 20°C		Approx. A.C. resistance at operating temp 90°C		Approx. reactance at 50 Hz Ohm/km	Approx. Capaci- tance µf/km	Current Rating as per IEC 60 502-2						Short circuit rating for 1 Sec. kA(rms)	
	Ohm/km		Ohm/km				Direct in Ground		In duct		In Air			
	Al	Cu	Al	Cu			Amps	Amps	Amps	Amps	Amps	Amps		
	Al	Cu	Al	Cu			Al	Cu	Al	Cu	Al	Cu		
35	0868	0.524	1.113	0.668	0.135	0.150	119	154	104	134	133	172	3.29	5.01
50	0.641	0.387	0.822	0.494	0.128	0.163	140	181	123	158	159	205	4.70	7.15
70	0.443	0.268	0.568	0.342	0.121	0.179	171	220	150	194	196	253	6.58	10.01
95	0.320	0.193	0.411	0.247	0.113	0.200	204	263	180	232	238	307	8.93	13.6
120	0.253	0.153	0.325	0.196	0.108	0.223	232	298	206	264	274	352	11.28	17.2
150	0.206	0.124	0.265	0.159	0.106	0.242	259	332	231	296	309	397	14.1	21.5
185	0.164	0.0991	0.211	0.1278	0.1015	0.258	293	374	262	335	354	453	17.4	26.5
240	0.125	0.0754	0.162	0.0982	0.0983	0.283	338	431	304	387	415	529	22.6	34.3
300	0.100	0.0601	0.130	0.0793	0.0952	0.317	380	482	343	435	472	599	28.2	42.9
400	0.0778	0.0470	0.102	0.0635	0.0915	0.345	432	541	393	492	545	683	37.6	57.2

The above data is indicative & may be changed without prior information.
All conductors will be compacted circular shaped
Cables can be supplied in multiples of 250/500 mtrs or as per customer requirement.

Operating conditions - Amb. air temp. 30° C
Ground temp: 20° C
Depth of laying : 80 cm
Thermal resistivity of soil: 1.50 K-m/W
Thermal resistivity of duct: 1.20 K-m/W

Table-40
18/30 (36) kV

**Single core XLPE Insulated Screened Armoured cable
with Aluminium/Copper conductor Conf. to IEC:60502-2**

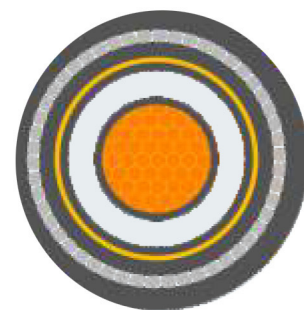

Area mm ²	Thickness of XLPE Insulation		Thickness of Separation Sheath		Dimension of Armour Wire		Thickness of Outer sheath		Approx. Overall diameter mm	Approx. Net Wt. of Cable	
	mm		mm		mm		mm			kg/km	kg/km
	Nom		Nom				Nom	Min		Al	Cu
50	8.0		1.2		2.0		2.20	1.56	38	1625	1910
70	8.0		1.2		2.0		2.20	1.56	39	1770	2200
95	8.0		1.2		2.0		2.30	1.64	41	1960	2540
120	8.0		1.2		2.0		2.30	1.64	43	2120	2850
150	8.0		1.3		2.5		2.40	1.72	45	2460	3365
185	8.0		1.3		2.5		2.50	1.80	48	2705	3825
240	8.0		1.3		2.5		2.50	1.80	50	3055	4480
300	8.0		1.4		2.5		2.60	1.88	53	3415	5250
400	8.0		1.4		2.5		2.70	1.96	56	3875	6240
500	8.0		1.5		2.5		2.80	2.04	60	4465	7450
630	8.0		1.5		2.5		2.90	2.12	64	5125	9035
800	8.0		1.6		2.5		2.10	2.28	69	6000	10945
1000	8.0		1.7		2.5		3.20	2.36	73	6920	13080


Area mm ²	Max D.C. resistance at 20°C		Approx. A.C. resistance at operating temp 90°C		Approx. reactance at 50 Hz Ohm/km	Approx. Capacitance µf/km	Current Rating as per IEC 60 502-2						Short circuit rating for 1 Sec.	
	Ohm/km		Ohm/km				Direct in Ground		In duct		In Air		kA(rms)	
	Al	Cu	Al	Cu			Amps	Amps	Amps	Amps	Amps	Amps	Al	Cu
	Al	Cu	Al	Cu			Al	Cu	Al	Cu	Al	Cu	Al	Cu
50	0.641	0.387	0.822	0.494	0.160	0.150	152	196	144	186	184	238	4.70	7.15
70	0.443	0.268	0.568	0.342	0.151	0.163	186	239	176	227	230	296	6.58	10.01
95	0.320	0.193	0.411	0.247	0.144	0.179	221	285	210	271	280	361	8.93	13.6
120	0.253	0.153	0.325	0.196	0.136	0.200	252	322	240	308	324	417	11.28	17.2
150	0.206	0.124	0.265	0.159	0.134	0.223	281	361	267	343	368	473	14.10	21.5
185	0.164	0.0991	0.211	0.1273	0.129	0.242	317	406	303	387	424	543	17.40	26.5
240	0.125	0.0754	0.161	0.0975	0.124	0.258	367	469	351	447	502	641	22.60	34.3
300	0.100	0.0601	0.129	0.0784	0.119	0.283	414	526	397	504	577	735	28.20	42.9
400	0.0778	0.0470	0.1012	0.0623	0.114	0.317	470	590	451	564	673	845	37.60	57.2
500	0.0605	0.0366	0.0795	0.0497	0.111	0.345	533	667	511	638	763	956	47.00	71.5
630	0.0469	0.0283	0.0627	0.0401	0.106	0.386	604	756	580	723	865	1083	59.20	90.1
800	0.0367	0.0221	0.0505	0.0322	0.102	0.426	686	860	659	822	983	1231	75.20	114.4
1000	0.0291	0.0176	0.0416	0.0284	0.099	0.473	776	973	744	930	1111	1393	94.00	143.0

The above data is indicative & may be changed without prior information.
All conductors will be compacted circular shaped
Cables can be supplied in multiples of 500 mtrs or as per customer requirement.

Operating conditions - Amb. air temp. 30° C
Ground temp: 20° C
Depth of laying : 80 cm
Thermal resistivity of soil: 1.50 K-m/W
Thermal resistivity of duct: 1.20 K-m/W

Table-41
18/30 (36) kV

Three core XLPE Insulated Screened Armoured cable
with Aluminium/Copper conductor Conf. to IEC:60502-2

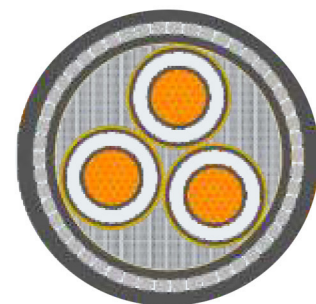

Area mm ²	Thickness of XLPE Insulation	Thickness of Seperation Sheath	Dimension of Armour Wire mm	Thickness of Outer sheath		Approx. Overall diameter mm	Approx. Net Wt. of Cable	
	mm Nom	mm Nom		mm Nom	mm Min		kg/km Al	kg/km Cu
50	8.0	1.8	3.15	3.4	2.52	74	7760	8625
70	8.0	1.8	3.15	3.5	2.60	77	8465	9760
95	8.0	1.9	3.15	3.6	2.68	81	9080	10840
120	8.0	2.0	3.15	3.7	2.76	85	9960	12175
150	8.0	2.0	3.15	3.8	2.84	88	10650	13395
185	8.0	2.1	3.15	4	3.00	93	11680	15060
240	8.0	2.2	3.15	4.1	3.08	99	13175	17495
300	8.0	2.3	3.15	4.3	3.24	104	14365	19930
400	8.0	2.4	3.15	4.5	3.40	111	16270	23450

Area mm ²	Max D.C. resistance at 20°C		Approx. A.C. resistance at operating temp 90°C		Approx. reactance at 50 Hz Ohm/km	Approx. Capaci- tance µf/km	Current Rating as per IEC 60 502-2						Short circuit rating for 1 Sec. kA(rms)	
	Ohm/km Al	Ohm/km Cu	Ohm/km Al	Ohm/km Cu			Direct in Ground		In duct		In Air		Al	Cu
	Amps Al	Amps Cu	Amps Al	Amps Cu	Amps Al	Amps Cu	Amps Al	Amps Cu	Amps Al	Amps Cu	Amps Al	Amps Cu	Amps Al	Amps Cu
50	0.641	0.387	0.822	0.494	0.141	0.150	140	181	123	158	159	205	4.70	7.15
70	0.443	0.268	0.568	0.342	0.133	0.163	171	220	150	194	196	253	6.58	10.01
95	0.320	0.193	0.411	0.247	0.127	0.179	204	263	180	232	238	307	8.93	13.60
120	0.253	0.153	0.325	0.196	0.119	0.200	232	298	206	264	274	352	11.28	17.20
150	0.206	0.124	0.265	0.159	0.116	0.223	259	332	231	296	309	397	14.10	21.50
185	0.164	0.0991	0.211	0.1276	0.1114	0.242	293	374	262	335	354	453	17.40	26.50
240	0.125	0.0754	0.162	0.0979	0.1082	0.258	338	431	304	387	415	529	22.60	34.30
300	0.100	0.0601	0.130	0.0789	0.1038	0.283	380	482	342	435	472	599	28.20	42.90
400	0.0778	0.0470	0.1017	0.0630	0.0994	0.317	432	541	393	492	545	683	37.60	57.20

The above data is indicative & may be changed without prior information.
All conductors will be compacted circular shaped
Cables can be supplied in multiples of 250/500 mtrs or as per customer requirement.

Operating conditions - Amb. air temp. 30° C
Ground temp: 20° C
Depth of laying : 80 cm
Thermal resistivity of soil: 1.50 K-m/W
Thermal resistivity of duct: 1.20 K-m/W

Tables - 42 to 53

Group Rating Factors for Circuits for Three Single Core Cables in Trefoil formation

Table 42: Horizontal Formation laid Direct in Ground

No. of Circuits in group	Spacing between Trefoil group centres (cm)			
	Touching	20	40	60
2	0.85	0.88	0.92	0.94
3	0.75	0.8	0.85	0.88
4	0.69	0.75	0.82	0.86
5	0.65	0.72	0.79	0.84
6	0.62	0.69	0.77	0.83

Table 43: Cables Laid in Air on Preforated trays with 2D apart from other Trefoil group.

No. of Trays	No. of 3 phase circuits		
	1	2	3
1	1	0.98	0.96
2	0.97	0.93	0.89
3	0.96	0.92	0.86

Group Rating Factors for Circuits for Multi-core Cables

Table 44: Cables laid on perforated trays touching each other.

No. of Cable trays	Number of cables				
	2	3	4	6	9
1	0.88	0.82	0.79	0.76	0.73
2	0.87	0.8	0.77	0.73	0.68
3	0.86	0.79	0.76	0.71	0.66

Table 45: Cables laid on perforated trays exposed to air, the cables paced by one cable diameter.

No. of Cable Trays	Number of cables per Rack			
	2	3	6	9
1	1	0.98	0.95	0.91
2	0.99	0.96	0.92	0.87
3	0.98	0.95	0.91	0.85

Table 46: Cables laid Direct in Ground in horizontal formation

No. of circuits in group	Spacing of cables (cm)			
	Touching	20	40	60
2	0.8	0.86	0.9	0.92
3	0.69	0.77	0.82	0.86
4	0.62	0.72	0.79	0.83
5	0.57	0.68	0.76	0.81
6	0.54	0.65	0.74	0.8

Table 47: Recommended Minimum bending Radius.

Type of Cable	During Installation	During Termination
	(A) SINGLE CORE Unarmoured	20 x D
Armoured	15 X D	12 X D
(B) THREE CORE Unarmoured	15 x D	12 X D

Table 48: D.C. Test Voltage after Installation.*

Voltage Grade kV	D.C. Voltage kV
3.6/6	15
(06/10)	25
8.7/15	37
(12/20)	50
18/30	76

Table 49: Rating factor for variation in laying in Dept. Of laying in

Dept. of laying (cm)	50	60	100	125	150	175	200	250	300
Single core <- 185 mm ²	1.04	1.02	0.98	0.96	0.95	0.94	0.93	0.91	0.90
Single core >- 185 mm ²	1.06	1.06	0.97	0.95	0.93	0.91	0.90	0.88	0.86
Three core cables	1.04	1.03	0.98	0.96	0.95	0.94	0.93	0.91	0.90

Table 50: Rating Factors for Variation in Ambient Air Temperature

Air Temp. °C	20	25	30	35	40	45	50	55	60
Rating Factor	1.08	1.04	1	0.96	0.91	0.87	0.82	0.76	0.71

Table 51: Rating Factors for Variation in Ground Temperature

Group Temp. °C	10	15	20	25	30	35	40	45	50
Rating Factor	1.07	1.04	1	0.96	0.93	0.89	0.85	0.8	0.76

Table 52: Rating factors for variation in thermal resistivity of soil (multicore cables laid direct in the ground)

Nominal area of conductor mm ²	For values of thermal resistivity of soil in K-m/W					
	0.8	0.9	1	2	2.5	3
25	1.2	1.16	1.13	0.91	0.84	0.78
35	1.21	1.17	1.13	0.91	0.83	0.78
50	1.21	1.17	1.14	0.91	0.83	0.77
70	1.21	1.18	1.14	0.9	0.83	0.77
95	1.22	1.18	1.14	0.9	0.83	0.77
120	1.22	1.18	1.14	0.9	0.83	0.77
150	1.22	1.18	1.15	0.9	0.83	0.77
185	1.23	1.18	1.15	0.9	0.83	0.77
240	1.23	1.19	1.15	0.9	0.83	0.77
300	1.23	1.19	1.15	0.9	0.82	0.77
400	1.23	1.19	1.15	0.9	0.82	0.76

Table 53: Rating factors for variation in thermal resistivity of soil three single core cables laid direct in the ground (three cables in trefoil touching)

Nominal area of conductor mm ²	For values of thermal resistivity of soil in K-m/W					
	0.8	0.9	1	2	2.5	3
25	1.25	1.2	1.16	0.89	0.81	0.75
35	1.25	1.21	1.16	0.89	0.81	0.75
50	1.26	1.21	1.16	0.89	0.81	0.74
70	1.27	1.22	1.17	0.89	0.81	0.74
95	1.28	1.22	1.18	0.89	0.8	0.74
120	1.28	1.22	1.18	0.88	0.8	0.74
150	1.28	1.23	1.18	0.88	0.8	0.74
185	1.29	1.23	1.18	0.88	0.8	0.74
240	1.29	1.23	1.18	0.88	0.8	0.73
300	1.3	1.24	1.19	0.88	0.8	0.73
400	1.3	1.24	1.19	0.88	0.79	0.73

INTRODUCTION

The risk of fire is always present in any buildings and structures. An incident of fire poses serious threat to the life of inhabitants and loss of property.

Apart from burning caused by flame, fatality occurs due to the inhalation of acidic gases evolved from burning materials and due to the thick dark smoke generated which obscures vision. Dark smoke is generated from normal cables within the first few seconds of a fire. This hampers the visibility of exits and causes panic. The acidic gases (HCl) evolved reacts with water in mouth, eye and lungs of human beings forming hydrochloric acid. This causes suffocation and prolonged inhalation results in fatality. As a result, rescue and evacuation operations are hampered.

Further, the acidic gases generated in a fire can even cause damage to the structural reinforcements and electronic gadgets even though direct flame has not caused any damage.

Normal cables in a fire burn and acts as channels for propagating fire and fire travels from one place to another through these cables.

Using Fujcab Brand Low Smoke and Fume wires and cables inside buildings significantly reduce the damages to life and property caused by fire. This is achieved as these cables burn very slowly and do not propagate fire. They emit very low smoke, fumes and do not produce acid gases during a fire.

Fujcab Brand Low Smoke and Fume wires and cables being flame retardant, slows down the spread of fire. This extra time is very critical for the fire fighters for putting down the fire and for rescuing the occupants trapped.

While burning Fujcab Brand Low Smoke and Fume wires and cables, the secondary damages caused by fire being very minimal, it prevents loss of human life by panic and suffocation and do not cause permanent damages to the building materials and equipments.

Fujcab Brand Low Smoke and Fume wires and cables are highly recommended in the following premises.

Housing apartments, Hotels, Hospitals, multistoried commercial buildings, shopping malls, Movie theaters, Airports, Educational institutions etc.

These cables are also designated as LSF/LSZH/LSHF/LSOH/HFFR/LSNH etc. High quality non-halogenated compounds are used in sheathing and insulation of these cables. These cables pass smoke cube test and acid emission test as detailed below.

Fire Resistant cables are suitable for emergency applications. During fire the circuit integrity maintained for sufficient time so that vital life safety systems such as emergency lighting, fire alarm, voice alarm, sprinkler pumps can work.

TESTING OF LSF/LSZH & FIRE RESISTANT CABLES

Flame Propagation on Single Cable: This test is carried out as per BS EN 50265-1 and IEC 60332-1 to check the resistance of cable to flame propagation.

Flame Propagation on Multiple Cables: This test is carried out as per BS EN 50266 and IEC 60332-3 to determine the ability of bunched cables to restrain flame propagation.

Smoke Emission: This test is carried out as per BS EN 50268 and BS EN 61034. The light transmittance shall not fall below 70% during the test.

Oxygen and Temperature Index: This test is carried out as per ASTM D 2863 to determine the minimum oxygen Concentration to support candle-like combustion of LSF/LSZH Materials.

Acidic (Corrosive) gas evolved (HCL level < 0.5%): This test is conducted to measure the amount of acidic gases evolved during Combustion of materials from Cables. This test is conducted as per IEC 60754-1.

Measurement of Ph and Conductivity: This test is conducted to determine degree of acidity of gases evolved during combustion of electric cables by measuring pH-value and conductivity. This test is conducted as per IEC 60754-2.






Fire Resistant test on cables: This test is carried out as per BS 7846 & BS 6387 'CWZ' & IEC 60331-21

Table-54

**Single Core Wires, solid or stranded copper conductor, LSF/LSZH insulated
450/750V, conf. to BS 7211 / BS EN 50525-3-41**

Nominal Area of the conductor	Maximum Cable diameter	Radial thickness of Insulation	Number/ nominal diameter of wires
Sq. mm	mm	mm	No./mm
1.5	3.2	0.7	1/1.38
1.5	3.3	0.7	7/0.53
2.5	3.9	0.8	1/1.78
2.5	4.0	0.8	7/0.67
4	4.4	0.8	1/2.26
4	4.6	0.8	7/0.85
6	5.0	0.8	1/2.77
6	5.2	0.8	7/1.04
10	6.4	1.0	1/3.57
10	6.7	1.0	7
16	7.8	1.0	7
25	9.7	1.2	7
35	10.9	1.2	7
50	12.8	1.4	7
70	14.6	1.4	19
95	17.1	1.6	19
120	18.8	1.6	19
150	20.9	1.8	19
185	23.3	2.0	37
240	26.6	2.2	37
300	29.6	2.4	37
400	33.2	2.6	61
500	36.9	2.8	61
630	41.1	2.8	61

Nominal Area of the conductor	Maximum conductor resistance	Current Rating		Weight of Cables
		Laid in conduits	Laid in Free Air (Approx.)	
Sq. mm	ohm/Km	Amps	Amps	Kg/Km
1.5	12.1	16	20	21
1.5	12.1	16	20	23
2.5	7.41	21	26	33
2.5	7.41	21	26	35
4	4.61	28	35	47
4	4.61	28	35	51
6	3.08	36	46	66
6	3.08	36	46	71
10	1.83	50	63	114
10	1.83	50	63	117
16	1.15	68	80	167
25	0.727	89	108	262
35	0.524	110	133	360
50	0.387	134	166	479
70	0.268	177	205	687
95	0.193	207	247	935
120	0.153	239	290	1162
150	0.124	262	334	1433
185	0.0991	296	388	1778
240	0.0754	346	463	2280
300	0.0601	394	540	2893
400	0.0470	401	580	3715
500	0.0366	530	620	4691
630	0.0283	611	715	6035




* Standard Packing: 100 yards/Mtrs rolls upto 16sq.mm
1000 Mtrs from 25sq.mm to 150sq.mm
500 Mtrs from 185sq.mm to 630sq.mm

Current Rating is based on the below conditions.
Amb. temp: 30°C
Conductor Operating temp: 90°C
Conductor size from 16 mm² to 630 mm² is circular compacted

Table-55

**Single core cable, Copper Conductor, XLPE insulated,
Aluminium wire armoured, LSF/LSZH sheathed, 600/1000V, conf. to BS: 6724**



Area	Thickness of XLPE Insulation	Thickness of Bedding	Dimension of Armour Wire	Thickness of LSF Outer sheath	Overall diameter	Net Wt. of Cable
	Nominal	Nominal	Nominal	Nominal	Approx	Approx
mm ²	mm	mm	mm	mm	mm	kg/km
50	1.0	0.8	0.90	1.5	17.5	650
70	1.1	0.8	1.25	1.5	20.2	940
95	1.1	0.8	1.25	1.6	22.3	1210
120	1.2	0.8	1.25	1.6	24.2	1465
150	1.4	1.0	1.60	1.7	27.4	1920
185	1.6	1.0	1.60	1.8	30.0	2325
240	1.7	1.0	1.60	1.8	32.8	2875
300	1.8	1.0	1.60	1.9	35.6	3445
400	2.0	1.2	2.00	2.0	40.5	4480
500	2.2	1.2	2.00	2.1	44.2	5550
630	2.4	1.2	2.00	2.2	48.8	7040
800	2.6	1.4	2.50	2.4	55.4	9020
1000	2.8	1.4	2.50	2.5	60.6	11040

Area	D.C. resistance at 20 °C	A.C. resistance at operating Temp. 90 °C.	Reactance at 50 Hz	Current Rating			Short circuit rating for 1 Sec.	Voltage Drop
	Max	Approx	Approx	Ground	Duct	Air		
mm ²	Ohm/km	Ohm/km	Ohm/km	Amps	Amps	Amps	kA(rms)	V/A/km
50	0.387	0.494	0.106	208	208	203	7.15	0.88
70	0.268	0.342	0.102	262	256	260	10.01	0.62
95	0.193	0.247	0.098	313	301	319	13.59	0.46
120	0.153	0.196	0.096	355	337	370	17.16	0.38
150	0.124	0.159	0.095	397	364	425	21.45	0.32
185	0.0991	0.128	0.092	447	402	488	26.46	0.27
240	0.0754	0.098	0.089	514	451	576	34.32	0.23
300	0.0601	0.079	0.090	573	492	656	42.90	0.21
400	0.0470	0.063	0.089	648	533	749	57.20	0.19
500	0.0366	0.051	0.088	718	577	847	71.50	0.18
630	0.0283	0.042	0.086	790	623	954	90.09	0.17
800	0.0221	0.035	0.086	833	649	1037	114.40	0.16
1000	0.0176	0.030	0.084	884	690	1125	143.00	0.15

The above data is indicative & may be changed without prior information.

* Standard Packing: 1000 Mtrs from 50sq.mm to 185sq.mm
500 Mtrs from 240sq.mm to 630sq.mm
300 Mtrs from 800sq.mm to 1000sq.mm

Operating conditions - Amb. air temp: 40° C


Ground temp: 20° C

Depth of laying: 50 cm

Thermal resistivity of soil: 120° C-cm/W

Table-56

Two core cable, Copper conductor, XLPE insulated, Gal. steel wire armoured, LSF/LSZH sheathed, 600/1000V, conf. to BS: 6724



Area	Thickness of XLPE Insulation	Thick. of Bedding	Dimension of Armour Wire	Thickness of LSF Outsheath	Over all diameter	Net Wt. of Cable
	Nominal	Nominal	Nominal	Nominal	Approx	Approx
mm ²	mm	mm	mm	mm	mm	kg/km
1.5	0.6	0.8	0.90	1.3	12.1	255
2.5	0.7	0.8	0.90	1.4	13.6	315
4	0.7	0.8	0.90	1.4	14.7	370
6	0.7	0.8	0.90	1.4	15.9	440
10	0.7	0.8	0.90	1.5	18.0	575
16	0.7	0.8	1.25	1.5	20.4	740
25	0.9	0.8	1.25	1.6	20.4	1000
35	0.9	1.0	1.60	1.7	23.3	1425
50	1.0	1.0	1.60	1.8	25.8	1755
70	1.1	1.0	1.60	1.9	29.0	2310
95	1.1	1.2	2.00	2.0	33.1	3160
120	1.2	1.2	2.00	2.1	36.1	3750
150	1.4	1.2	2.00	2.2	39.3	4410
185	1.6	1.4	2.50	2.4	44.7	5680
240	1.7	1.4	2.50	2.5	49.0	6955
300	1.8	1.6	2.50	2.6	53.5	8400
400	2.0	1.6	2.50	2.8	59.0	10400


Area	D.C. resistance at 20 °C	A.C. resistance at operating temp. 90 °C	Reactance at 50Hz	Current Rating			Short circuit rating for 1 Sec.	Voltage Drop
	Max	Approx	Approx	Ground	Duct	Air		
mm ²	Ohm/km	Ohm/km	Ohm/km	Amps	Amps	Amps	kA(rms)	V/A/km
1.5	12.1	15.43	0.105	33	27	27	0.21	26.72
2.5	7.41	9.45	0.099	42	36	36	0.36	16.37
4	4.61	5.88	0.093	57	46	48	0.57	10.18
6	3.08	3.93	0.088	70	58	62	0.86	6.80
10	1.83	2.33	0.084	96	78	84	1.43	4.04
16	1.15	1.47	0.081	124	101	111	2.29	2.54
25	0.727	0.93	0.081	164	133	144	3.58	1.61
35	0.524	0.67	0.079	196	159	178	5.01	1.17
50	0.387	0.49	0.075	232	189	215	7.15	0.87
70	0.268	0.34	0.074	286	235	269	10.01	0.61
95	0.193	0.25	0.072	344	283	333	13.59	0.45
120	0.153	0.20	0.072	395	326	385	17.16	0.36
150	0.124	0.16	0.073	443	366	439	21.45	0.30
185	0.0991	0.13	0.072	499	415	507	26.46	0.26
240	0.0754	0.10	0.071	576	480	598	34.32	0.21
300	0.0601	0.08	0.071	646	540	682	42.90	0.19
400	0.0470	0.06	0.070	744	622	785	57.20	0.16

The above data is indicative & may be changed without prior information.
 Conductor upto 16mm² will be round.
 Conductor of 25mm² and above will be compacted sector shaped conductor.
 * Standard Packing: 1000 Mtrs upto 95sq.mm
 500 Mtrs from 120sq.mm to 300sq.mm
 300 Mtrs for 400sq.mm

Operating conditions - Amb. air temp. 40° C
 Ground temp: 20° C
 Depth of laying : 50 cm
 Thermal resistivity of soil: 120° C-cm/W

Table-57

Three core cable, Copper conductor, XLPE insulated, Gal. steel wire armoured, LSF/LSZH sheathed, 600/1000V, conf. to BS: 6724



Area	Thickness of XLPE Insulation	Thick. of Bedding	Dimension of Armour Wire	Thickness of LSF Outersheath	Over all diameter	Net Wt. of Cable
	Nominal	Nominal	Nominal	Nominal	Approx	Approx
mm ²	mm	mm	mm	mm	mm	kg/km
1.5	0.6	0.8	0.9	1.3	12.6	280
2.5	0.7	0.8	0.9	1.4	14.1	355
4	0.7	0.8	0.9	1.4	15.3	430
6	0.7	0.8	0.9	1.4	16.6	525
10	0.7	0.8	1.25	1.5	19.5	810
16	0.7	0.8	1.25	1.6	21.6	985
25	0.9	1.0	1.6	1.7	23.6	1500
35	0.9	1.0	1.6	1.8	25.7	1905
50	1.0	1.0	1.6	1.8	28.5	2335
70	1.1	1.0	1.6	1.9	32.2	3150
95	1.1	1.2	2.0	2.1	37.0	4270
120	1.2	1.2	2.0	2.2	40.4	5160
150	1.4	1.4	2.5	2.3	45.5	6560
185	1.6	1.4	2.5	2.4	49.8	7820
240	1.7	1.4	2.5	2.6	55.1	9660
300	1.8	1.6	2.5	2.7	60.2	11845
400	2.0	1.6	2.5	2.9	66.6	14715

Area	D.C. resistance at 20 °C	A.C. resistance at operating temp.90 °C	Reactance at 50Hz	Current Rating			Short circuit rating for 1 Sec.	Voltage Drop
				Ground	Duct	Air		
mm ²	Max Ohm/km	Approx Ohm/km	Approx Ohm/km	Amps	Amps	Amps	kA(rms)	V/A/km
1.5	12.1	15.43	0.105	25	22	23	0.21	26.72
2.5	7.41	9.45	0.099	32	30	31	0.36	16.37
4	4.61	5.88	0.093	42	39	41	0.57	10.18
6	3.08	3.93	0.088	52	49	52	0.86	6.80
10	1.83	2.33	0.084	71	66	72	1.43	4.04
16	1.15	1.47	0.081	105	84	94	2.29	2.54
25	0.727	0.93	0.081	136	111	123	3.58	1.61
35	0.524	0.67	0.079	163	133	151	5.01	1.17
50	0.387	0.49	0.075	194	158	184	7.15	0.87
70	0.268	0.34	0.074	241	197	231	10.01	0.61
95	0.193	0.25	0.072	288	237	285	13.59	0.45
120	0.153	0.20	0.072	331	273	331	17.16	0.36
150	0.124	0.16	0.073	370	309	378	21.45	0.30
185	0.0991	0.13	0.072	418	348	436	26.46	0.26
240	0.0754	0.10	0.071	483	403	514	34.32	0.21
300	0.0601	0.08	0.071	540	452	586	42.90	0.19
400	0.0470	0.07	0.070	621	530	674	57.20	0.17

The above data is indicative & may be changed without prior information.
 Conductor upto 16mm² will be round.
 Conductor of 25mm² and above will be compacted sector shaped conductor.
 * Standard Packing: 1000 Mtrs upto 95sq.mm
 500 Mtrs from 120sq.mm to 300sq.mm
 300 Mtrs for 400sq.mm

Operating conditions - Amb. air temp: 40° C
 Ground temp: 20° C
 Depth of laying: 50 cm
 Thermal resistivity of soil: 120° C-cm/W



Table-58

Four core cable, Copper conductor, XLPE insulated, Gal. steel wire armoured, LSF/LSZH sheathed, 600/1000V, conf. to BS: 6724

Area	Thickness of XLPE Insulation	Thick. Of Bedding	Dimension of Armour Wire	Thickness of LSF Outsheath	Over all diameter	Net Wt. of Cable
	Nominal	Nominal	Nominal	Nominal	Approx	Approx
mm ²	mm	mm	mm	mm	mm	kg/km
1.5	0.6	0.8	0.90	1.3	13.3	335
2.5	0.7	0.8	0.90	1.4	15.0	430
4	0.7	0.8	0.90	1.4	16.4	535
6	0.7	0.8	1.25	1.5	18.7	770
10	0.7	0.8	1.25	1.5	21.1	960
16	0.7	0.8	1.25	1.6	23.4	1200
25	0.9	1.0	1.60	1.7	26.1	1855
35	0.9	1.0	1.60	1.8	28.6	2370
50	1.0	1.0	1.60	1.9	32.0	2950
70	1.1	1.2	2.00	2.1	37.7	4355
95	1.1	1.2	2.00	2.2	41.7	5445
120	1.2	1.4	2.50	2.3	47.1	7010
150	1.4	1.4	2.50	2.4	51.4	8365
185	1.6	1.4	2.50	2.6	56.6	10050
240	1.7	1.6	2.50	2.7	63.0	12450
300	1.8	1.6	2.50	2.9	68.8	15300
400	2.0	1.8	3.15	3.2	78.1	20100


Area	D.C. resistance at 20 °C	A.C. resistance at operating temp. 90 °C	Reactance at 50Hz	Current Rating			Short circuit rating for 1 Sec.	Voltage Drop
	Max	Approx	Approx	Ground	Duct	Air		
mm ²	Ohm/km	Ohm/km	Ohm/km	Amps	Amps	Amps	kA(rms)	V/A/km
1.5	12.1	15.43	0.105	25	22	23	0.21	26.72
2.5	7.41	9.45	0.099	32	30	31	0.36	16.37
4	4.61	5.88	0.093	42	39	41	0.57	10.18
6	3.08	3.93	0.088	52	49	52	0.86	6.80
10	1.83	2.33	0.084	71	66	72	1.43	4.04
16	1.15	1.47	0.081	105	84	94	2.29	2.54
25	0.727	0.93	0.081	136	111	123	3.58	1.61
35	0.524	0.67	0.079	163	133	151	5.01	1.17
50	0.387	0.49	0.075	194	158	184	7.15	0.87
70	0.268	0.34	0.074	241	197	231	10.01	0.61
95	0.193	0.25	0.072	288	237	285	13.59	0.45
120	0.153	0.20	0.072	331	273	331	17.16	0.36
150	0.124	0.16	0.073	370	309	378	21.45	0.30
185	0.0991	0.13	0.072	418	348	436	26.46	0.26
240	0.0754	0.10	0.071	483	403	514	34.32	0.21
300	0.0601	0.08	0.071	540	452	586	42.90	0.19
400	0.0470	0.07	0.070	621	530	674	57.20	0.17

The above data is indicative & may be changed without prior information.
 Conductor upto 16mm² will be round.
 Conductor of 25mm² and above will be compacted sector shaped conductor.
 * Standard Packing: 1000 Mtrs upto 70sq.mm
 500 Mtrs from 95sq.mm to 300sq.mm
 200 Mtrs for 400sq.mm

Operating conditions - Amb. air temp. 40° C
 Ground temp: 20° C
 Depth of laying : 50 cm
 Thermal resistivity of soil: 120° C-cm/W

Table-59

Five core cable, Copper conductor, XLPE insulated, Gal. steel wire armoured, LSF/LSZH sheathed, 600/1000V, conf. to BS: 6724



Area	Thickness of XLPE Insulation	Thickness of Bedding	Dimension of Armour Wire	Thickness of LSF Outersheath	Over all diameter	Net Wt. of Cable
	Nominal	Nominal	Nominal	Nominal	Approx	Approx
mm ²	mm	mm	mm	mm	mm	kg/km
1.5	0.6	0.8	0.9	1.4	14.3	385
2.5	0.7	0.8	0.9	1.4	16.1	495
4	0.7	0.8	0.9	1.5	17.8	620
6	0.7	0.8	1.25	1.5	20.0	845
10	0.7	0.8	1.25	1.6	22.9	1130
16	0.7	1.0	1.6	1.7	26.6	1685
25	0.9	1.0	1.6	1.8	31.5	2330
35	0.9	1.0	1.6	1.9	34.8	2965
50	1.0	1.2	2.0	2.0	40.4	4075
70	1.1	1.2	2.0	2.2	46.3	5475


Area	D.C. resistance at 20 °C	A.C. resistance at operating temp. 90 °C	Reactance at 50Hz	Current Rating			Short circuit rating for 1 Sec.	Voltage Drop
	Max	Approx	Approx	Ground	Duct	Air		
mm ²	Ohm/km	Ohm/km	Ohm/km	Amps	Amps	Amps	kA(rms)	V/A/km
1.5	12.1	15.43	0.105	25	22	23	0.21	26.72
2.5	7.41	9.45	0.099	32	30	31	0.36	16.37
4	4.61	5.88	0.093	42	39	41	0.57	10.18
6	3.08	3.93	0.088	52	49	52	0.86	6.80
10	1.83	2.33	0.084	71	66	72	1.43	4.04
16	1.15	1.47	0.081	105	84	94	2.29	2.54
25	0.727	0.93	0.081	136	111	123	3.58	1.61
35	0.524	0.67	0.079	163	133	151	5.01	1.17
50	0.387	0.49	0.075	194	158	184	7.15	0.87
70	0.268	0.34	0.074	241	197	231	10.01	0.61

The above data is indicative & may be changed without prior information.
 Conductor upto 10mm² will be round, non compacted.
 Conductor above 10mm² will be round, compacted.
 * Standard Packing: 1000 Mtr Drums

Operating conditions - Amb. Air temp. 40° C
 Ground temp: 20° C
 Depth of laying : 50 cm
 Thermal resistivity of soil: 120° C-cm/W

Table-60

Auxillary (Control) cable, 1.5mm², Copper conductor, XLPE insulated, Gal. steel wire armoured, LSF/LSZH sheathed, 600/1000V, conf. to BS: 6724

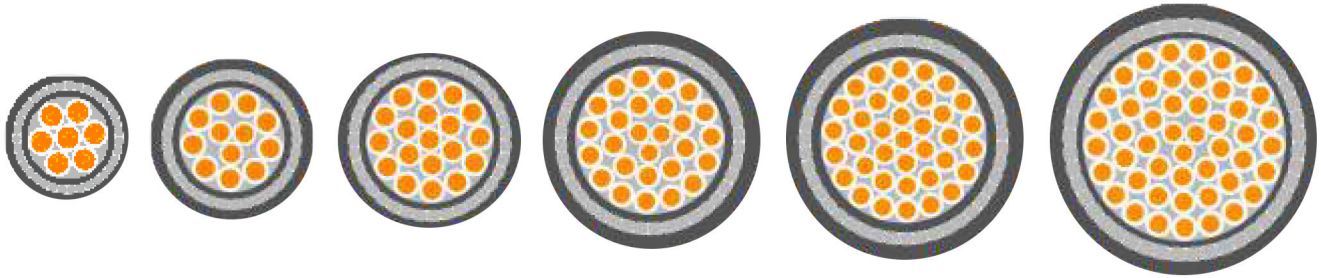

Area	Thickness of XLPE Insulation	Thickness of Bedding	Dimension of Armour Wire	Thickness of LSF Outersheath	Over all diameter	Net Wt. of Cable
	Nominal	Nominal	Nominal	Nominal	Approx	Approx
mm ²	mm	mm	mm	mm	mm	kg/km
7 x 1.5	0.6	0.8	0.90	1.4	15.2	440
12 x 1.5	0.6	0.8	1.25	1.5	19.4	745
19 x 1.5	0.6	0.8	1.25	1.6	22.2	965
27 x 1.5	0.6	1.0	1.60	1.7	26.7	1425
37 x 1.5	0.6	1.0	1.60	1.7	29.0	1710
48 x 1.5	0.6	1.0	1.60	1.8	32.7	2070

Area	D.C. resistance at 20 °C	A.C. resistance at operating temp. 90 °C	Reactance at 50Hz	Current Rating			Short circuit rating for 1 Sec.	Voltage Drop
	Max	Approx	Approx	Ground	Duct	Air		
mm ²	Ohm/km	Ohm/km	Ohm/km	Amps	Amps	Amps	kA(rms)	V/A/km
7 x 1.5	12.1	15.43	0.105	21	17	17	0.215	26.73
12 x 1.5	12.1	15.43	0.105	18	14	14	0.215	26.73
19 x 1.5	12.1	15.43	0.105	15	12	12	0.215	26.73
27 x 1.5	12.1	15.43	0.105	13	10	10	0.215	26.73
37 x 1.5	12.1	15.43	0.105	11	9	9	0.215	26.73
48 x 1.5	12.1	15.43	0.105	10	8	8	0.215	26.73

The above data is indicative & may be changed without prior information.
 * Standard Packing: 1000 Mtr Drums

Operating conditions - Amb. air temp. 40° C
 Ground temp: 20° C
 Depth of laying : 50 cm
 Thermal resistivity of soil: 120° C-cm/W

Table - 61

Auxillary (Control) cable, 2.5mm², Copper conductor, XLPE insulated, Gal. steel wire armoured, LSF/LSZH sheathed, 600/1000V, conf. to BS: 6724

Area	Thickness of XLPE Insulation	Thick. Of Bedding	Dimension of Armour Wire	Thickness of LSF Outsheath	Over all diameter	Net Wt. of Cable
	Nominal	Nominal	Nominal	Nominal	Approx	Approx
mm ²	mm	mm	mm	mm	mm	kg/km
7 x 2.5	0.7	0.8	0.90	1.4	17.1	570
12 x 2.5	0.7	0.8	1.25	1.6	22.4	980
19 x 2.5	0.7	1.0	1.60	1.7	26.6	1485
27 x 2.5	0.7	1.0	1.60	1.8	30.7	1905
37 x 2.5	0.7	1.0	1.60	1.8	33.8	2320
48 x 2.5	0.7	1.2	2.00	2.0	39.3	3165

Area	D.C. resistance at 20 °C	A.C. resistance at operating temp. 90 °C	Reactance at 50Hz	Current Rating			Short circuit rating for 1 Sec.	Voltage Drop
	Max	Approx	Approx	Ground	Duct	Air		
mm ²	Ohm/km	Ohm/km	Ohm/km	Amps	Amps	Amps	kA(rms)	V/A/km
7 x 2.5	7.41	9.45	0.099	27	22	23	0.358	16.37
12 x 2.5	7.41	9.45	0.099	22	19	19	0.358	16.37
19 x 2.5	7.41	9.45	0.099	19	16	16	0.358	16.37
27 x 2.5	7.41	9.45	0.099	16	14	13	0.358	16.37
37 x 2.5	7.41	9.45	0.099	14	12	12	0.358	16.37
48 x 2.5	7.41	9.45	0.099	13	11	11	0.358	16.37

The above data is indicative & may be changed without prior information.

* Standard Packing: 1000 Mtr Drums

Operating conditions - Amb. Air temp. 40° C

Ground temp: 20° C

Depth of laying : 50 cm

Thermal resistivity of soil: 120° C-cm/W

Table - 62

Auxillary (Control) cable, 4mm², Copper conductor, XLPE insulated, Gal. steel wire armoured, LSF/LSZH sheathed, 600/1000V, conf. to BS: 6724

Area	Thickness of XLPE Insulation	Thick. Of Bedding	Dimension of Armour Wire	Thickness of LSF Outsheath	Over all diameter	Net Wt. of Cable
	Nominal	Nominal	Nominal	Nominal	Approx	Approx
mm ²	mm	mm	mm	mm	mm	kg/km
7 x 4	0.7	0.8	1.25	1.5	19.7	840
12 x 4	0.7	1.0	1.60	1.6	25.7	1400
19 x 4	0.7	1.0	1.60	1.7	29.3	1900
27 x 4	0.7	1.0	1.60	1.9	34.4	2485
37 x 4	0.7	1.2	2.00	2.0	39.2	3410
48 x 4	0.7	1.2	2.00	2.1	44.1	4150

Area	D.C. resistance at 20 °C	A.C. resistance at operating temp. 90 °C	Reactance at 50Hz	Current Rating			Short circuit rating for 1 Sec.	Voltage Drop
	Max	Approx	Approx	Ground	Duct	Air		
mm ²	Ohm/km	Ohm/km	Ohm/km	Amps	Amps	Amps	kA(rms)	V/A/km
7 x 4	4.61	5.88	0.093	36	29	30	0.572	10.18
12 x 4	4.61	5.88	0.093	30	24	25	0.572	10.18
19 x 4	4.61	5.88	0.093	25	20	21	0.572	10.18
27 x 4	4.61	5.88	0.093	22	17	18	0.572	10.18
37 x 4	4.61	5.88	0.093	19	16	16	0.572	10.18
48 x 4	4.61	5.88	0.093	18	14	15	0.572	10.18

The above data is indicative & may be changed without prior information.

* Standard Packing: 1000 Mtr Drums

Operating conditions - Amb. air temp. 40° C


Ground temp: 20° C

Depth of laying : 50 cm

Thermal resistivity of soil: 120° C-cm/W

Table-63

Two core Fire resistant cable, Copper conductor, Glass mica taped, XLPE insulated, Gal. steel wire armoured, LSF/LSZH sheathed, 600/1000V, conf. to BS: 7846



Area	Thickness of XLPE Insulation	Thick. of Bedding	Dimension of Armour Wire	Thickness of LSF Outsheath	Over all diameter	Net Wt. of Cable
	Nominal	Nominal	Nominal	Nominal	Approx	Approx
mm ²	mm	mm	mm	mm	mm	kg/km
1.5	0.6	0.8	0.90	1.3	13.0	280
2.5	0.7	0.8	0.90	1.4	14.5	345
4	0.7	0.8	0.90	1.4	15.5	405
6	0.7	0.8	0.90	1.4	16.5	480
10	0.7	0.8	0.90	1.5	19.0	625
16	0.7	0.8	1.25	1.5	21.5	865
25	0.9	0.8	1.25	1.6	21.5	1070
35	0.9	1.0	1.60	1.7	24.5	1470
50	1.0	1.0	1.60	1.8	26.5	1800
70	1.1	1.0	1.60	1.9	30.0	2350
95	1.1	1.2	2.00	2.0	34.0	3195
120	1.2	1.2	2.00	2.1	37.0	3805
150	1.4	1.2	2.00	2.2	40.0	4430
185	1.6	1.4	2.50	2.4	46.0	5725
240	1.7	1.4	2.50	2.5	50.0	7005
300	1.8	1.6	2.50	2.6	55.0	8445
400	2.0	1.6	2.50	2.8	60.0	10485


Area	D.C. resistance at 20 °C	A.C. resistance at operating temp. 90 °C	Reactance at 50Hz	Current Rating			Short circuit rating for 1 Sec.	Voltage Drop
	Max	Approx	Approx	Ground	Duct	Air		
mm ²	Ohm/km	Ohm/km	Ohm/km	Amps	Amps	Amps	kA(rms)	V/A/km
1.5	12.1	15.43	0.105	33	27	27	0.21	26.72
2.5	7.41	9.45	0.099	42	36	36	0.36	16.37
4	4.61	5.88	0.093	57	46	48	0.57	10.18
6	3.08	3.93	0.088	70	58	62	0.86	6.80
10	1.83	2.33	0.084	96	78	84	1.43	4.04
16	1.15	1.47	0.081	124	101	111	2.29	2.54
25	0.727	0.93	0.081	164	133	144	3.58	1.61
35	0.524	0.67	0.079	196	159	178	5.01	1.17
50	0.387	0.49	0.075	232	189	215	7.15	0.87
70	0.268	0.34	0.074	286	235	269	10.01	0.61
95	0.193	0.25	0.072	344	283	333	13.59	0.45
120	0.153	0.20	0.072	395	326	385	17.16	0.36
150	0.124	0.16	0.073	443	366	439	21.45	0.30
185	0.0991	0.13	0.072	499	415	507	26.46	0.26
240	0.0754	0.10	0.071	576	480	598	34.32	0.21
300	0.0601	0.08	0.071	646	540	682	42.90	0.19
400	0.0470	0.06	0.070	744	622	785	57.20	0.16

The above data is indicative & may be changed without prior information.
 Conductor upto 16mm² will be round.
 Conductor of 25mm² and above will be compacted sector shaped conductor.
 * Standard Packing: 1000 Mtrs upto 95sq.mm
 500 Mtrs from 120sq.mm to 300sq.mm
 300 Mtrs for 400sq.mm

Operating conditions - Amb. air temp. 40° C
 Ground temp: 20° C
 Depth of laying : 50 cm
 Thermal resistivity of soil: 120° C-cm/W

Table-64

Three core Fire resistant cable, Copper conductor, Glass mica taped, XLPE insulated, Gal. steel wire armoured, LSF/LSZH sheathed, 600/1000V, conf. to BS: 7846



Area	Thickness of XLPE Insulation	Thick. of Bedding	Dimension of Armour Wire	Thickness of LSF Outsheath	Over all diameter	Net Wt. of Cable
	Nominal	Nominal	Nominal	Nominal	Approx	Approx
mm ²	mm	mm	mm	mm	mm	kg/km
1.5	0.6	0.8	0.9	1.3	13.5	315
2.5	0.7	0.8	0.9	1.4	15	390
4	0.7	0.8	0.9	1.4	16.5	460
6	0.7	0.8	0.9	1.4	17.5	565
10	0.7	0.8	1.25	1.5	20.5	850
16	0.7	0.8	1.25	1.6	22.5	1055
25	0.9	1.0	1.6	1.7	24.5	1570
35	0.9	1.0	1.6	1.8	26.5	1935
50	1.0	1.0	1.6	1.8	30.0	2400
70	1.1	1.0	1.6	1.9	33.0	3175
95	1.1	1.2	2.0	2.1	38.0	4325
120	1.2	1.2	2.0	2.2	42.0	5195
150	1.4	1.4	2.5	2.3	47.0	6600
185	1.6	1.4	2.5	2.4	51.0	7850
240	1.7	1.4	2.5	2.6	56.0	9770
300	1.8	1.6	2.5	2.7	61.0	11895
400	2.0	1.6	2.5	2.9	68.0	14785


Area	D.C. resistance at 20 °C	A.C. resistance at operating temp. 90 °C	Reactance at 50Hz	Current Rating			Short circuit rating for 1 Sec.	Voltage Drop
				Ground	Duct	Air		
mm ²	Max Ohm/km	Approx Ohm/km	Approx Ohm/km	Amps	Amps	Amps	kA(rms)	V/A/km
1.5	12.1	15.43	0.105	25	22	23	0.21	26.72
2.5	7.41	9.45	0.099	32	30	31	0.36	16.37
4	4.61	5.88	0.093	42	39	41	0.57	10.18
6	3.08	3.93	0.088	52	49	52	0.86	6.80
10	1.83	2.33	0.084	71	66	72	1.43	4.04
16	1.15	1.47	0.081	105	84	94	2.29	2.54
25	0.727	0.93	0.081	136	111	123	3.58	1.61
35	0.524	0.67	0.079	163	133	151	5.01	1.17
50	0.387	0.49	0.075	194	158	184	7.15	0.87
70	0.268	0.34	0.074	241	197	231	10.01	0.61
95	0.193	0.25	0.072	288	237	285	13.59	0.45
120	0.153	0.20	0.072	331	273	331	17.16	0.36
150	0.124	0.16	0.073	370	309	378	21.45	0.30
185	0.0991	0.13	0.072	418	348	436	26.46	0.26
240	0.0754	0.10	0.071	483	403	514	34.32	0.21
300	0.0601	0.08	0.071	540	452	586	42.90	0.19
400	0.0470	0.07	0.070	621	530	674	57.20	0.17

The above data is indicative & may be changed without prior information.
 Conductor upto 16mm² will be round.
 Conductor of 25mm² and above will be compacted sector shaped conductor.
 * Standard Packing: 1000 Mtrs upto 95sq.mm
 500 Mtrs from 120sq.mm to 300sq.mm
 300 Mtrs for 400sq.mm

Operating conditions - Amb. air temp. 40° C
 Ground temp: 20° C
 Depth of laying : 50 cm
 Thermal resistivity of soil: 120° C-cm/W

Table-65

Four core Fire resistant cable, Copper conductor, Glass mica taped, XLPE insulated, Gal. steel wire armoured, LSF/LSZH sheathed, 600/1000V, conf. to BS: 7846



Area	Thickness of XLPE Insulation	Thick. Of Bedding	Dimension of Armour Wire	Thickness of LSF Outsheath	Over all diameter	Net Wt. of Cable
	Nominal	Nominal	Nominal	Nominal	Approx	Approx
mm ²	mm	mm	mm	mm	mm	kg/km
1.5	0.6	0.8	0.90	1.3	14.5	350
2.5	0.7	0.8	0.90	1.4	16.0	445
4	0.7	0.8	0.90	1.4	17.5	540
6	0.7	0.8	1.25	1.5	20.0	780
10	0.7	0.8	1.25	1.5	22.5	995
16	0.7	0.8	1.25	1.6	24.5	1275
25	0.9	1.0	1.60	1.7	27.5	1930
35	0.9	1.0	1.60	1.8	30.0	2400
50	1.0	1.0	1.60	1.9	33.0	3000
70	1.1	1.2	2.00	2.1	39.0	4320
95	1.1	1.2	2.00	2.2	43.0	5485
120	1.2	1.4	2.50	2.3	48.0	7050
150	1.4	1.4	2.50	2.4	53.0	8410
185	1.6	1.4	2.50	2.6	58.0	10100
240	1.7	1.6	2.50	2.7	64.0	12595
300	1.8	1.6	2.50	2.9	70.0	15395
400	2.0	1.8	3.15	3.2	79.0	20200


Area	D.C. resistance at 20 °C	A.C. resistance at operating temp.90 °C	Reactance at 50Hz	Current Rating			Short circuit rating for 1 Sec.	Voltage Drop
	Max	Approx	Approx	Ground	Duct	Air		
mm ²	Ohm/km	Ohm/km	Ohm/km	Amps	Amps	Amps	kA(rms)	V/A/km
1.5	12.1	15.43	0.105	25	22	23	0.21	26.72
2.5	7.41	9.45	0.099	32	30	31	0.36	16.37
4	4.61	5.88	0.093	42	39	41	0.57	10.18
6	3.08	3.93	0.088	52	49	52	0.86	6.80
10	1.83	2.33	0.084	71	66	72	1.43	4.04
16	1.15	1.47	0.081	105	84	94	2.29	2.54
25	0.727	0.93	0.081	136	111	123	3.58	1.61
35	0.524	0.67	0.079	163	133	151	5.01	1.17
50	0.387	0.49	0.075	194	158	184	7.15	0.87
70	0.268	0.34	0.074	241	197	231	10.01	0.61
95	0.193	0.25	0.072	288	237	285	13.59	0.45
120	0.153	0.20	0.072	331	273	331	17.16	0.36
150	0.124	0.16	0.073	370	309	378	21.45	0.30
185	0.0991	0.13	0.072	418	348	436	26.46	0.26
240	0.0754	0.10	0.071	483	403	514	34.32	0.21
300	0.0601	0.08	0.071	540	452	586	42.90	0.19
400	0.0470	0.07	0.070	621	530	674	57.20	0.17

The above data is indicative & may be changed without prior information.
 Conductor upto 16mm² will be round.
 Conductor of 25mm² and above will be compacted sector shaped conductor.
 * Standard Packing: 1000 Mtrs upto 95sq.mm
 500 Mtrs from 120sq.mm to 300sq.mm
 300 Mtrs for 400sq.mm

Operating conditions - Amb. air temp. 40° C
 Ground temp: 20° C
 Depth of laying : 50 cm
 Thermal resistivity of soil: 120° C-cm/W

Table-66

Five core Fire resistant cable, Copper conductor, Glass mica taped, XLPE insulated, Gal. steel wire armoured, LSF/LSZH sheathed, 600/1000V, conf. to BS: 7846



Area	Thickness of XLPE Insulation	Thickness of Bedding	Dimension of Armour Wire	Thickness of LSF Outersheath	Over all diameter	Net Wt. of Cable
	Nominal	Nominal	Nominal	Nominal	Approx	Approx
mm ²	mm	mm	mm	mm	mm	kg/km
1.5	0.6	0.8	0.9	1.4	15.5	415
2.5	0.7	0.8	0.9	1.4	17.5	525
4	0.7	0.8	0.9	1.5	19.0	645
6	0.7	0.8	1.25	1.5	21.5	910
10	0.7	0.8	1.25	1.6	24.0	1210
16	0.7	1.0	1.6	1.7	27.5	1705
25	0.9	1.0	1.6	1.8	32.5	2430
35	0.9	1.0	1.6	1.9	36.0	3025
50	1.0	1.2	2.0	2.0	42.0	4155
70	1.1	1.2	2.0	2.2	48.0	5480


Area	D.C. resistance at 20 °C	A.C. resistance at operating temp. 90 °C	Reactance at 50Hz	Current Rating			Short circuit rating for 1 Sec.	Voltage Drop
	Max	Approx	Approx	Ground	Duct	Air		
mm ²	Ohm/km	Ohm/km	Ohm/km	Amps	Amps	Amps	kA(rms)	V/A/km
1.5	12.1	15.43	0.105	25	22	23	0.21	26.72
2.5	7.41	9.45	0.099	32	30	31	0.36	16.37
4	4.61	5.88	0.093	42	39	41	0.57	10.18
6	3.08	3.93	0.088	52	49	52	0.86	6.80
10	1.83	2.33	0.084	71	66	72	1.43	4.04
16	1.15	1.47	0.081	105	84	94	2.29	2.54
25	0.727	0.93	0.081	136	111	123	3.58	1.61
35	0.524	0.67	0.079	163	133	151	5.01	1.17
50	0.387	0.49	0.075	194	158	184	7.15	0.87
70	0.268	0.34	0.074	241	197	231	10.01	0.61

The above data is indicative & may be changed without prior information.
 Conductor upto 16mm² will be round.
 Conductor of 25mm² and above will be compacted sector shaped conductor.
 * Standard Packing: 1000 Mtrs upto 95sq.mm
 500 Mtrs from 120sq.mm to 300sq.mm
 300 Mtrs for 400sq.mm

Operating conditions - Amb. air temp. 40° C
 Ground temp: 20° C
 Depth of laying : 50 cm
 Thermal resistivity of soil: 120° C-cm/W

Table-67

Auxiliary (Control) - Fire resistant cable, 1.5mm², Copper conductor, Glass mica taped, XLPE insulated, Gal. steel wire armoured, LSF/LSZH sheathed, 600/1000V, conf. to BS:7846

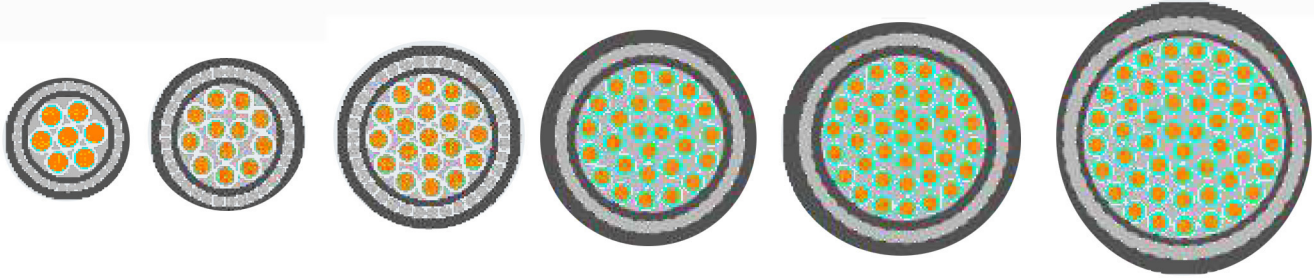

Area	Thickness of XLPE Insulation	Thickness of Bedding	Dimension of Armour Wire	Thickness of LSF Outersheath	Over all diameter	Net Wt. of Cable
	Nominal	Nominal	Nominal	Nominal	Approx	Approx
mm ²	mm	mm	mm	mm	mm	kg/km
7 x 1.5	0.6	0.8	0.90	1.4	16.5	470
12 x 1.5	0.6	0.8	1.25	1.5	21.5	785
19 x 1.5	0.6	0.8	1.25	1.6	24.5	1025
27 x 1.5	0.6	1.0	1.60	1.7	29.5	1505
37 x 1.5	0.6	1.0	1.60	1.7	33.0	1815
48 x 1.5	0.6	1.0	1.60	1.8	37.0	2290

Area	D.C. resistance at 20 °C	A.C. resistance at operating temp. 90 °C	Reactance at 50Hz	Current Rating			Short circuit rating for 1 Sec.	Voltage Drop
	Max	Approx	Approx	Ground	Duct	Air		
mm ²	Ohm/km	Ohm/km	Ohm/km	Amps	Amps	Amps	kA(rms)	V/A/km
7 x 1.5	12.1	15.43	0.105	21	17	17	0.215	26.73
12 x 1.5	12.1	15.43	0.105	18	14	14	0.215	26.73
19 x 1.5	12.1	15.43	0.105	15	12	12	0.215	26.73
27 x 1.5	12.1	15.43	0.105	13	10	10	0.215	26.73
37 x 1.5	12.1	15.43	0.105	11	9	9	0.215	26.73
48 x 1.5	12.1	15.43	0.105	10	8	8	0.215	26.73

The above data is indicative & may be changed without prior information.
 * Standard Packing: 1000 Mtr Drums

Operating conditions - Amb. Air temp. 40° C
 Ground temp: 20° C
 Depth of laying : 50 cm
 Thermal resistivity of soil: 120° C-cm/W

Table-68

Auxiliary (Control) - Fire resistant cable, 2.5mm², Copper conductor, Glass mica taped, XLPE insulated, Gal. steel wire armoured, LSF/LSZH sheathed, 600/1000V, conf. to BS:7846

Area	Thickness of XLPE Insulation	Thick. Of Bedding	Dimension of Armour Wire	Thickness of LSF Outersheath	Over all diameter	Net Wt. of Cable
	Nominal	Nominal	Nominal	Nominal	Approx	Approx
mm ²	mm	mm	mm	mm	mm	kg/km
7 x 2.5	0.7	0.8	0.90	1.4	18.5	595
12 x 2.5	0.7	0.8	1.25	1.6	24.5	1010
19 x 2.5	0.7	1.0	1.60	1.7	29.0	1535
27 x 2.5	0.7	1.0	1.60	1.8	34.0	1960
37 x 2.5	0.7	1.0	1.60	1.8	36.0	2395
48 x 2.5	0.7	1.2	2.00	2.0	43.0	3390

Area	D.C. resistance at 20 °C	A.C. resistance at operating temp. 90 °C	Reactance at 50Hz	Current Rating			Short circuit rating for 1 Sec.	Voltage Drop
	Max	Approx	Approx	Ground	Duct	Air		
mm ²	Ohm/km	Ohm/km	Ohm/km	Amps	Amps	Amps	kA(rms)	V/A/km
7 x 2.5	7.41	9.448	0.099	27	22	23	0.358	16.37
12 x 2.5	7.41	9.448	0.099	22	19	19	0.358	16.37
19 x 2.5	7.41	9.448	0.099	19	16	16	0.358	16.37
27 x 2.5	7.41	9.448	0.099	16	14	13	0.358	16.37
37 x 2.5	7.41	9.448	0.099	14	12	12	0.358	16.37
48 x 2.5	7.41	9.448	0.099	13	11	11	0.358	16.37

The above data is indicative & may be changed without prior information.
* Standard Packing: 1000 Mtr Drums

Operating conditions - Amb. Air temp. 40° C
Ground temp: 20° C
Depth of laying : 50 cm
Thermal resistivity of soil: 120° C-cm/W

Table-69

Auxiliary (Control) - Fire resistant cable, 4mm², Copper conductor, Glass mica taped, XLPE insulated, Gal. steel wire armoured, LSF/LSZH sheathed, 600/1000V, conf. to BS:7846

Area	Thickness of XLPE Insulation	Thick. Of Bedding	Dimension of Armour Wire	Thickness of LSF Outersheath	Over all diameter	Net Wt. of Cable
	Nominal	Nominal	Nominal	Nominal	Approx	Approx
mm ²	mm	mm	mm	mm	mm	kg/km
7 x 4	0.7	0.8	1.25	1.5	21.0	860
12 x 4	0.7	1.0	1.60	1.6	27.5	1435
19 x 4	0.7	1.0	1.60	1.7	32.0	1940
27 x 4	0.7	1.0	1.60	1.9	38.0	2495
37 x 4	0.7	1.2	2.00	2.0	43.0	3475
48 x 4	0.7	1.2	2.00	2.1	48.0	4311

Area	D.C. resistance at 20 °C	A.C. resistance at operating temp. 90 °C	Reactance at 50Hz	Current Rating			Short circuit rating for 1 Sec.	Voltage Drop
	Max	Approx	Approx	Ground	Duct	Air		
mm ²	Ohm/km	Ohm/km	Ohm/km	Amps	Amps	Amps	kA(rms)	V/A/km
7 x 4	4.61	5.878	0.093	36	29	30	0.572	10.18
12 x 4	4.61	5.878	0.093	30	24	25	0.572	10.18
19 x 4	4.61	5.878	0.093	25	20	21	0.572	10.18
27 x 4	4.61	5.878	0.093	22	17	18	0.572	10.18
37 x 4	4.61	5.878	0.093	19	16	16	0.572	10.18
48 x 4	4.61	5.878	0.093	18	14	15	0.572	10.18

The above data is indicative & may be changed without prior information.
* Standard Packing: 1000 Mtr Drums

Operating conditions - Amb. Air temp. 40° C
Ground temp: 20° C
Depth of laying : 50 cm
Thermal resistivity of soil: 120° C-cm/W

Tables - 70 to 83

Group Rating Factors for Circuits of Three Single Core Cables in Trefoil formation

Table 70: Touching Horizontal Formation laid Direct in Ground

No. of Circuits	Spacing (Between Centres of Circuits)				
	Touching	15 cm	30 cm	45 cm	60 cm
2	0.78	0.81	0.85	0.88	0.90
3	0.68	0.71	0.77	0.81	0.83
4	0.61	0.65	0.72	0.76	0.79
5	0.56	0.61	0.68	0.73	0.78

Table 72: Cables laid on Racks/Trays in covered trench with removable covers where air circulation is restricted, Trefoils are separated by two cable dia horizontally and the trays are in tiers with 30 cm. gap between them.

No. of Racks/ Trays in tiers	No. of Trefoils in horizontal formation		
	1	2	3
1	0.95	0.90	0.88
2	0.9	0.85	0.83
3	0.88	0.83	0.81
6	0.86	0.81	0.79

Table 71: Cables laid in Trefoil Ducts in horizontal formation

No. of Circuits	Spacing (Between Centres of Circuits)		
	Touching	45 cm	60 cm
2	0.87	0.90	0.91
3	0.79	0.83	0.86
4	0.74	0.79	0.82
5	0.71	0.76	0.79

Table 73: Cables laid as in 'C' but open air

No. of Racks	No. of Cables per Rack		
	1	2	3
1	1	0.98	0.96
2	1	0.95	0.93
3	1	0.94	0.92
6	1	0.93	0.9

Group Rating Factors for Circuits of Multi-core Cables

Table 74: Cables laid inside concrete trench with removable covers, on cable trays where air circulation is restricted. The cables spaced by one cable diameter and trays in tiers by 300 mm. The clearance of the cable from the Wall is 25 mm.

No. of Cable trays in Tier	Number of cables				
	1	2	3	6	9
1	0.95	0.9	0.88	0.85	0.84
2	0.90	0.85	0.83	0.81	0.80
3	0.88	0.83	0.81	0.79	0.78
6	0.86	0.81	0.79	0.77	0.76

Table 76: Cables laid on cable trays exposed to air, the cables are touching and trays in tiers by 300 mm. The clearance between the wall and the cable is 25 mm.

No. of Cable trays in Tier	No. of Cables per Rack			
	2	3	6	9
1	0.84	0.8	0.75	0.73
2	0.8	0.76	0.71	0.69
3	0.78	0.74	0.7	0.68
6	0.76	0.72	0.68	0.66

Table 78: Cables laid Direct in single way ducts/pipes in horizontal formation.

No. of Cables in group	Spacing of cables			
	Touching	30 cm	45 cm	60 cm
2	0.88	0.9	0.92	0.94
3	0.82	0.84	0.87	0.89
4	0.77	0.8	0.84	0.87
5	0.74	0.78	0.82	0.85
6	0.71	0.76	0.81	0.84

Table 80: Rating Factors for Variation in Ambient Air Temperature

Air Temp. °C	15	20	25	30	35	40	45	50	55
Rating Factor	1.22	1.18	1.14	1.10	1.05	1.00	0.95	0.89	0.84

Table 82: Rating Factors for variation in thermal resistivity of soil (multicore cables laid direct in the ground) - Average values

Nominal area of conductor mm ²	For values of thermal resistivity of Soil in °C-cm/W					
	80	90	100	150	200	250
Up to 16	1.09	1.06	1.04	0.95	0.86	0.79
25 to 150	1.14	1.1	1.07	0.93	0.84	0.76
185 & above	1.16	1.11	1.07	0.92	0.82	0.74

Table 75: Cables laid on cable trays exposed to air, the cables spaced by one cable diameter and trays in tiers by 300 mm. The clearance between the wall and the cable is 25 mm.

No. of Cable trays in Tier	No. of Cables per Rack			
	2	3	6	9
1	0.98	0.96	0.93	0.92
2	0.95	0.93	0.9	0.89
3	0.94	0.92	0.89	0.88
6	0.93	0.9	0.87	0.86

Table 77: Cables laid Direct in Ground in horizontal formation.

No. of Cables in group	Spacing of cables			
	Touching	15 cm	30 cm	45 cm
2	0.79	0.82	0.87	0.90
3	0.69	0.75	0.79	0.83
4	0.62	0.69	0.74	0.79
5	0.58	0.65	0.72	0.76
6	0.54	0.61	0.69	0.75

Table 79: Rating Factor for Variation in Dept. of laying in Ground

Dept. of Laying (cm)	50	80	100	125	150	200 & above
Rating Factor upto 50 mm ²	1	0.97	0.95	0.94	0.93	0.91
Rating Factor 70 mm ² to 300 mm ²	1	0.96	0.94	0.92	0.91	0.88
Rating Factor above 300 mm ²	1	0.94	0.92	0.9	0.89	0.86


Table 81: Rating Factors for Variation in Ground Temperature

Group Temp.	15	20	25	30	35	40	45	50	55
Rating Factor	1.04	1.00	0.96	0.93	0.89	0.85	0.80	0.76	0.71

Table 83: Rating Factors for variation in thermal resistivity of soil, three single core cables laid direct in the ground (three cables in trefoil touching) : Average Values

Nominal area of conductor mm ²	For values of thermal resistivity of Soil in °C-cm/W					
	80	90	100	150	200	250
Up to 150	1.16	1.11	1.07	0.91	0.81	0.73
185 to 400	1.17	1.12	1.07	0.9	0.8	0.72
500 & above	1.18	1.13	1.08	0.9	0.79	0.71

SUB INDEX




- Introduction 61
- Technical Information - Single / Multi Pair, Polyethylene Insulated PVC/LSF sheathed cables as per BS: 5308 (Part 1) 63
 - **BS5308 Part 1 / Type 1 (unarmoured cables)**
 - Polyethylene Insulated Overall Shielded Unarmoured Cables, 300/500V As Per BS:5308 (Part 1) 64
 - Polyethylene Insulated Individual & Overall Shielded Unarmoured Cables, 300/500V As Per BS:5308 (Part 1) 65
 - **BS5308 Part 1 / Type 2 (armoured cables)**
 - Polyethylene Insulated Overall Shielded Armoured Cables, 300/500 Volt As Per BS:5308 (Part 1) 66
 - Polyethylene Insulated Individual & Overall Shielded Armoured Cables, 300/500V As Per BS:5308 (Part 1). 67
- Technical Information - Single / Multi Pair, XLPE Insulated PVC/LSF sheathed cables Gen. as per BS: 5308 (Part 1). 68
 - **BS5308 Part 1 / Type 1 (unarmoured cables)**
 - XLPE Insulated Overall Shielded Unarmoured PVC/LSF Cables, 300/500V Generally As Per BS:5308 (Part 1). 69
 - XLPE Insulated Individual & Overall Shielded Unarmoured PVC/LSF Cables, 300/500V Generally As Per BS:5308 (Part 1).. 70
 - **BS5308 Part 1 / Type 2 (armoured cables)**
 - XLPE Insulated Overall Shielded Armoured PVC/LSF Cables, 300/500 V Generally As Per BS:5308 (Part 1). 71
 - XLPE Insulated Individual & Overall Shielded Armoured PVC/LSF Cables, 300/500V Generally As Per BS:5308 (Part 1).. 72
- Technical Information - Single / Multi Pair, PVC Insulated PVC/LSF sheathed cables BS: 5308 (Part 2) 73
 - **BS5308 Part 2 / Type 1 (unarmoured cables)**
 - PVC Insulated Overall Shielded Unarmoured Cables, 300/500V As Per BS:5308 (Part 2). 74
 - PVC Insulated Individual & Overall Shielded Unarmoured Cables, 300/500 V As Per BS:5308 (Part 2) 75
 - **BS5308 Part 2 / Type 2 (armoured cables)**
 - PVC Insulated Overall Shielded Armoured Cables, 300/500V As Per BS:5308 (Part 2). 76
 - PVC Insulated Individual & Overall Shielded Armoured Cables, 300/500V As Per BS:5308 (Part 2). 77

INTRODUCTION

Power Plus cable, manufacturer of Power, control cables and wiring cables, offers a wide range of Instrumentation cables for various applications including Petrochemical, Oil & Gas, Smelters, cement plants, power plants, industrial automation, etc. Our cables are designed to carry communication and control signals of analog, voice or data type. Screened cables are used where electromagnetic interference into the cable is anticipated. Individual elements of a cable like pair or triad are screened when cross-interference with other adjacent elements needs to be avoided.

These cables are used for transmitting signals from process control devices and measurement equipments to drive sensors, control valves etc. The unarmoured types of cables are intended for indoor use or installations in conduit, cable tray, etc., whereas armoured cables are suitable for extra mechanical protection and direct burial in ground. These cables shall not be directly connected to a low impedance sources like main electricity power supply.

The manufacturing process for typical screened instrumentation cable is described below.

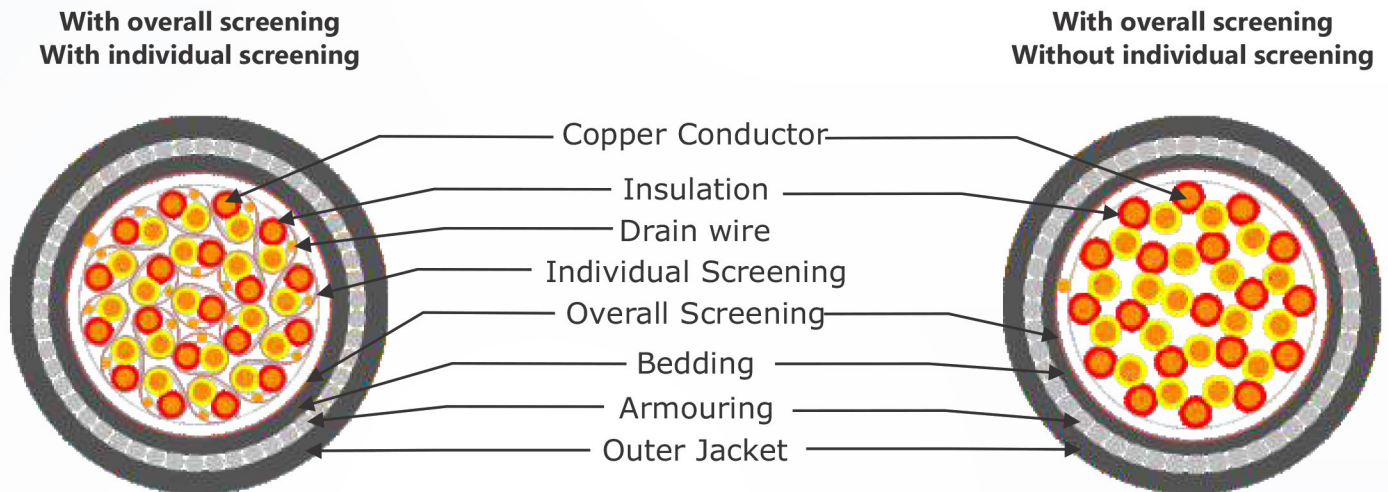

CONDUCTOR

Annealed Plain or Tinned, high conductivity electrolytic grade Solid, Stranded or Flexible Copper Conductors of Class 1, 2 or 5, complying to BS EN 60228.

INSULATION

The Conductors are insulated with Polyethylene, XLPE, general purpose or Heat Resistant PVC or LSF material as per requirement.

CORE IDENTIFICATION

The Cores are identified with coloured insulation or printed numerals as per customer requirement.

PAIR/TRIAD

Two or Three cores are uniformly twisted together to form a Pair or Triad. The lay length is chosen to minimize cross talk in the cable.

INDIVIDUAL SHIELDING

If required, Individual Shielding of Pair or Triad by Polyester laminated Aluminium tape (thin Layer of Aluminium bonded to polyester Film tape is termed as a Foil screen) in contact with annealed Tinned copper drain wire. The drain wire can be of solid or flexible type.

LAYING OF CORES, PAIR or TRIAD

Cores, Pair or Triad are assembled in concentric form with suitable lay length. A binder tape of plastic material is provided over the laid up assembly.

OVERALL SHIELDING

Overall Shielding of annealed bare or tinned copper braid or laminated Aluminium tape with tinned copper drain wire is provided as per requirement. Braided shield has higher tensile strength and is suitable for flexible applications. The overall shielding reduces cross talk and electromagnetic interference in the cable.

RIP CORD

For an easy jacket removal, high tensile strength nylon Rip Cord can be provided over laid up cores, pairs or triads if requested

INNER SHEATH

The shielded cable assembly is provided with an extruded inner sheath of PVC, Polyethylene or LSF compound as per requirement.

ARMOURING

The armouring over inner sheath consisting of galvanized Round steel wires or galvanized Steel Tape is provided as per customer requirements/specification.

OUTER SHEATH

An outer sheath of PVC, FR-PVC or LSF material is provided over armour in case of armoured cable or directly over collective screen in case of unarmoured cable. The color of outer sheath is generally Black, Grey, Blue, or Orange as required by customer.

APPLICABLE STANDARDS

BS: 5308 (Part-1&2), BS EN 50288-7 or customer's specifications.

**Single / Multi Pair, Polyethylene Insulated Individual / Overall Shielded,
Armoured / Unarmoured PVC sheathed cables as per BS: 5308 (Part 1)**

CONSTRUCTION

- | | |
|-------------------------------|--|
| 1. Conductor | : Plain Annealed Copper to BS EN 60228. |
| 2. Insulation | : Polyethylene as per BS:6234 |
| 3. Wrapping | : Polyester tape |
| 4. Pair / Overall Shielding | : Aluminium foil in contact with solid/stranded tinned copper drain wire |
| 5. Core / Pair Identification | : Blue & white coloured cores with pair numbers printed on white core. |
| 6. Wrapping | : Polyester tape |
| 7. Inner Sheath | : Polyethylene as per BS:6234 |
| 8. Armour | : Galvanised steel round wire (for Type 2 cables only) |
| 9. Outer Sheath | : Polyvinyl Chloride (PVC) Type TM1, in accordance with BS:7655 |

TECHNICAL INFORMATION

1. Maximum Operating Temperature	: 70°C
2. Working Voltage	: 300/500 Volt
3. Test voltage	: 1000 Volt for 1 minute between conductor, and between conductors and screen / armour
4. Max DC Conductor Resistance at 20°C	
Conductor Size	: Multipair
0.5 mm ² (Solid)	: 36.72 Ω/Km
0.5 mm ² (Flexible)	: 39.78 Ω/Km
1.0 mm ²	: 18.46 Ω/Km
1.5 mm ²	: 12.34 Ω/Km
5. Minimum insulation Resistance at 20°C	
Between individual conductor	: 5 G Ω.Km
Between individual Screens	: 1 M Ω.Km
6. Capacitance	
Max. mutual capacitance (IS & OS)	: 120 pF/m at 1 kHz
Maximum capacitance unbalance	: 250 nF/250m at 1 kHz
7. Maximum L/R ratio	
0.5 mm ²	: 25 μH/Ω
1.0 mm ²	: 25 μH/Ω
1.5 mm ²	: 40 μH/Ω
OPTIONAL FEATURES :	
- Annealed tinned copper conductor on request	
- Flame retardant to IEC 60332-1/IEC 60332-3	
- FR PVC / LSF sheathed cables also available	
BENDING RADIUS :	
Unarmoured cable : 6 X Overall Diameter	
Armoured cable : 8 X Overall Diameter	

Table-84


**POLYETHYLENE INSULATED OVERALL SHIELDED UNARMoured CABLES,
300/500V AS PER BS:5308 (Part 1) (Type 1)**



No. of Pairs	Cross Sectional Area (mm ²)	Conductor No./ Dia. of Wire (No./mm)	Nom. Insulation Thickness (mm)	Nom. Sheath Thickness (mm)	Approx. Overall Diameter (mm)
1	0.5	1/0.8	0.5	0.8	5.8
2	0.5	1/0.8	0.5	0.8	6.6
5	0.5	1/0.8	0.5	1.1	11.1
10	0.5	1/0.8	0.5	1.2	14.5
15	0.5	1/0.8	0.5	1.2	16.6
20	0.5	1/0.8	0.5	1.3	18.9
30	0.5	1/0.8	0.5	1.3	22.5
50	0.5	1/0.8	0.5	1.5	28.4
1	0.5	16/0.2	0.6	0.8	6.5
2	0.5	16/0.2	0.6	0.8	7.4
5	0.5	16/0.2	0.6	1.1	12.6
10	0.5	16/0.2	0.6	1.2	16.7
15	0.5	16/0.2	0.6	1.3	19.3
20	0.5	16/0.2	0.6	1.3	21.8
30	0.5	16/0.2	0.6	1.5	26.4
50	0.5	16/0.2	0.6	1.7	33.4
1	1	1/1.13	0.6	0.8	6.9
2	1	1/1.13	0.6	0.8	7.9
5	1	1/1.13	0.6	1.2	13.7
10	1	1/1.13	0.6	1.2	17.9
15	1	1/1.13	0.6	1.3	20.8
20	1	1/1.13	0.6	1.5	23.9
30	1	1/1.13	0.6	1.5	28.5
50	1	1/1.13	0.6	2	36.8
1	1.5	7/0.53	0.6	0.8	7.8
2	1.5	7/0.53	0.6	0.9	9.2
5	1.5	7/0.53	0.6	1.2	15.9
10	1.5	7/0.53	0.6	1.3	21.1
15	1.5	7/0.53	0.6	1.5	24.7
20	1.5	7/0.53	0.6	1.5	28
30	1.5	7/0.53	0.6	1.7	33.8
50	1.5	7/0.53	0.6	2	43.1

Table-85


**POLYETHYLENE INSULATED INDIVIDUAL & OVERALL SHIELDED
UNARMoured CABLES, 300/500V AS PER BS:5308 (Part 1) (Type 1)**



No. of Pairs	Cross Sectional Area (mm ²)	Conductor No./ Dia. of Wire (No./mm)	Nom. Insulation Thickness (mm)	Nom. Sheath Thickness (mm)	Approx. Overall Diameter (mm)
2	0.5	1/0.8	0.5	0.9	9.3
5	0.5	1/0.8	0.5	1.2	12.5
10	0.5	1/0.8	0.5	1.2	17.3
15	0.5	1/0.8	0.5	1.3	20.1
20	0.5	1/0.8	0.5	1.3	22.5
30	0.5	1/0.8	0.5	1.5	26.9
50	0.5	1/0.8	0.5	2	35.1
2	0.5	16/0.2	0.6	1.1	11
5	0.5	16/0.2	0.6	1.2	14.2
10	0.5	16/0.2	0.6	1.3	20.1
15	0.5	16/0.2	0.6	1.5	23.5
20	0.5	16/0.2	0.6	1.5	26.3
30	0.5	16/0.2	0.6	1.7	31.3
50	0.5	16/0.2	0.6	2.2	40.7
2	1	1/1.13	0.6	1.1	11.8
5	1	1/1.13	0.6	1.2	15.2
10	1	1/1.13	0.6	1.3	21.6
15	1	1/1.13	0.6	1.5	25.2
20	1	1/1.13	0.6	1.7	28.8
30	1	1/1.13	0.6	2	34.4
50	1	1/1.13	0.6	2.2	43.9
2	1.5	7/0.53	0.6	1.2	13.7
5	1.5	7/0.53	0.6	1.3	17.8
10	1.5	7/0.53	0.6	1.5	25.5
15	1.5	7/0.53	0.6	1.7	29.8
20	1.5	7/0.53	0.6	1.7	33.4
30	1.5	7/0.53	0.6	2	40
50	1.5	7/0.53	0.6	2.2	51.2

Table-86


**POLYETHYLENE INSULATED OVERALL SHIELDED ARMoured CABLES,
300/500 VOLT AS PER BS:5308 (Part 1) (Type 2)**



No. of Pairs	Cross Sectional Area (mm ²)	Conductor No./ Dia. Of Wire (No./mm)	Nom. Insulation Thickness (mm)	Nom. Sheath Thickness (mm)	Nom. Armour wire Dia. (mm)	Nom. Outer sheath Thickness (mm)	Approx. overall Diameter (mm)
1	0.5	1/0.8	0.5	0.8	0.9	1.3	10.2
2	0.5	1/0.8	0.5	0.8	0.9	1.3	11
5	0.5	1/0.8	0.5	1.1	0.9	1.4	15.7
10	0.5	1/0.8	0.5	1.2	1.25	1.6	20.2
15	0.5	1/0.8	0.5	1.2	1.25	1.6	22.3
20	0.5	1/0.8	0.5	1.3	1.6	1.7	25.5
30	0.5	1/0.8	0.5	1.3	1.6	1.8	29.3
50	0.5	1/0.8	0.5	1.5	1.6	2	35.6
1	0.5	16/0.2	0.6	0.8	0.9	1.3	10.9
2	0.5	16/0.2	0.6	0.8	0.9	1.3	11.8
5	0.5	16/0.2	0.6	1.1	0.9	1.5	17.4
10	0.5	16/0.2	0.6	1.2	1.25	1.6	22.4
15	0.5	16/0.2	0.6	1.3	1.6	1.7	25.9
20	0.5	16/0.2	0.6	1.3	1.6	1.8	28.6
30	0.5	16/0.2	0.6	1.5	1.6	1.9	33.4
50	0.5	16/0.2	0.6	1.7	2	2.1	41.6
1	1	1/1.13	0.6	0.8	0.9	1.3	11.3
2	1	1/1.13	0.6	0.8	0.9	1.4	12.5
5	1	1/1.13	0.6	1.2	1.25	1.5	19.2
10	1	1/1.13	0.6	1.2	1.25	1.7	23.8
15	1	1/1.13	0.6	1.3	1.6	1.8	27.6
20	1	1/1.13	0.6	1.5	1.6	1.8	30.7
30	1	1/1.13	0.6	1.5	1.6	2	35.7
50	1	1/1.13	0.6	2	2	2.2	45.2
1	1.5	7/0.53	0.6	0.8	0.9	1.4	12.4
2	1.5	7/0.53	0.6	0.9	0.9	1.4	13.8
5	1.5	7/0.53	0.6	1.2	1.25	1.6	21.6
10	1.5	7/0.53	0.6	1.3	1.6	1.8	27.9
15	1.5	7/0.53	0.6	1.5	1.6	1.9	31.7
20	1.5	7/0.53	0.6	1.5	2	2	36
30	1.5	7/0.53	0.6	1.7	2	2.1	42
50	1.5	7/0.53	0.6	2	2.5	2.4	52.9

Table-87

**POLYETHYLENE INSULATED INDIVIDUAL & OVERALL SHIELDED
ARMoured CABLES, 300/500V AS PER BS:5308 (Part 1) (Type 2)**



No. of Pairs	Cross Sectional Area (mm ²)	Conductor No./ Dia. Of Wire (No/mm)	Nom. Insulation Thickness (mm)	Nom. Sheath Thickness (mm)	Nom. Armour wire dia. (mm)	Nom. Outer sheath thickness (mm)	Approx. Overall Diameter (mm)
2	0.5	1/0.8	0.5	0.9	0.9	1.4	13.9
5	0.5	1/0.8	0.5	1.2	1.25	1.5	18
10	0.5	1/0.8	0.5	1.2	1.25	1.7	23.2
15	0.5	1/0.8	0.5	1.3	1.6	1.7	26.7
20	0.5	1/0.8	0.5	1.3	1.6	1.8	29.3
30	0.5	1/0.8	0.5	1.5	1.6	1.9	33.9
50	0.5	1/0.8	0.5	2	2	2.2	43.5
2	0.5	16/0.2	0.6	1.1	0.9	1.5	15.8
5	0.5	16/0.2	0.6	1.2	1.25	1.6	19.9
10	0.5	16/0.2	0.6	1.3	1.6	1.8	26.9
15	0.5	16/0.2	0.6	1.5	1.6	1.8	30.3
20	0.5	16/0.2	0.6	1.5	1.6	1.9	33.3
30	0.5	16/0.2	0.6	1.7	2	2.1	39.5
50	0.5	16/0.2	0.6	2.2	2.5	2.4	50.5
2	1	1/1.13	0.6	1.1	0.9	1.5	16.6
5	1	1/1.13	0.6	1.2	1.25	1.6	20.9
10	1	1/1.13	0.6	1.3	1.6	1.8	28.4
15	1	1/1.13	0.6	1.5	1.6	1.9	32.2
20	1	1/1.13	0.6	1.7	2	2	36.8
30	1	1/1.13	0.6	2	2	2.2	42.8
50	1	1/1.13	0.6	2.2	2.5	2.5	53.9
2	1.5	7/0.53	0.6	1.2	1.25	1.6	19.4
5	1.5	7/0.53	0.6	1.3	1.6	1.7	24.4
10	1.5	7/0.53	0.6	1.5	1.6	1.9	32.5
15	1.5	7/0.53	0.6	1.7	2	2	37.8
20	1.5	7/0.53	0.6	1.7	2	2.1	41.6
30	1.5	7/0.53	0.6	2	2.5	2.5	49.8
50	1.5	7/0.53	0.6	2.2	2.5	2.7	61.6

**Single / Multi Pair, XLPE Insulated Individual / Overall Shielded,
Armoured / Unarmoured LSF sheathed cables generally as per BS: 5308 (Part 1)**

CONSTRUCTION

- | | |
|-------------------------------|--|
| 1. Conductor | : Plain Annealed Copper to BS EN 60228. |
| 2. Insulation | : XLPE as per BS:7655-1.3 |
| 3. Wrapping | : Polyester tape |
| 4. Pair / Overall Shielding | : Aluminium foil in contact with solid/stranded tinned copper drain wire |
| 5. Core / Pair Identification | : Blue & White coloured cores with pair numbers printed on white core. |
| 6. Wrapping | : Polyester tape |
| 7. Inner Sheath | : LSF as per BS: 7655-6.1 |
| 8. Armour | : Galvanised steel round wire (for Type 2 cables only) |
| 9. Outer Sheath | : LSF as per BS:7655-6.1 |

TECHNICAL INFORMATION

1. Maximum Operating Temperature	: 90°C
2. Working Voltage	: 300/500 Volt
3. Test voltage	: 1000 Volt for 1 minute between conductor, and between conductors and screen / armour
4. Max DC Conductor Resistance at 20°C	
Conductor Size	: Multipair
0.5 mm ² (Solid)	: 36.72 Ω/Km
0.5 mm ² (Flexible)	: 39.78 Ω/Km
1.0 mm ²	: 18.46 Ω/Km
1.5 mm ²	: 12.34 Ω/Km
5. Minimum insulation Resistance at 20°C	
Between individual conductor	: 5 G Ω.Km
Between individual Screens	: 1 M Ω.Km
6. Capacitance	
Max. mutual capacitance (IS & OS)	: 120 pF/m at 1 kHz
Maximum capacitance unbalance	: 250 nF/250m at 1 kHz
7. Maximum L/R ratio	
0.5 mm ²	: 25 μH/Ω
1.0 mm ²	: 25 μH/Ω
1.5 mm ²	: 40 μH/Ω
OPTIONAL FEATURES :	
- Annealed tinned copper conductor on request	
- Flame retardant to IEC 60332-1/IEC 60332-3	
BENDING RADIUS :	
Unarmoured cable : 6 X Overall Diameter	
Armoured cable : 8 X Overall Diameter	

Table-88


**XLPE INSULATED OVERALL SHIELDED UNARMoured LSF CABLES,
300/500V GENERALLY AS PER BS:5308 (Part 1) (Type 1)**



No. of Pairs	Cross Sectional Area (mm ²)	Conductor No./ Dia. of Wire (No./mm)	Nom. Insulation Thickness (mm)	Nom. Sheath Thickness (mm)	Approx. Overall Diameter (mm)
1	0.5	1/0.8	0.5	0.8	5.8
2	0.5	1/0.8	0.5	0.8	6.6
5	0.5	1/0.8	0.5	1.1	11.1
10	0.5	1/0.8	0.5	1.2	14.5
15	0.5	1/0.8	0.5	1.2	16.6
20	0.5	1/0.8	0.5	1.3	18.9
30	0.5	1/0.8	0.5	1.3	22.5
50	0.5	1/0.8	0.5	1.5	28.4
1	0.5	16/0.2	0.6	0.8	6.5
2	0.5	16/0.2	0.6	0.8	7.4
5	0.5	16/0.2	0.6	1.1	12.6
10	0.5	16/0.2	0.6	1.2	16.7
15	0.5	16/0.2	0.6	1.3	19.3
20	0.5	16/0.2	0.6	1.3	21.8
30	0.5	16/0.2	0.6	1.5	26.4
50	0.5	16/0.2	0.6	1.7	33.4
1	1	1/1.13	0.6	0.8	6.9
2	1	1/1.13	0.6	0.8	7.9
5	1	1/1.13	0.6	1.2	13.7
10	1	1/1.13	0.6	1.2	17.9
15	1	1/1.13	0.6	1.3	20.8
20	1	1/1.13	0.6	1.5	23.9
30	1	1/1.13	0.6	1.5	28.5
50	1	1/1.13	0.6	2	36.8
1	1.5	7/0.53	0.6	0.8	7.8
2	1.5	7/0.53	0.6	0.9	9.2
5	1.5	7/0.53	0.6	1.2	15.9
10	1.5	7/0.53	0.6	1.3	21.1
15	1.5	7/0.53	0.6	1.5	24.7
20	1.5	7/0.53	0.6	1.5	28
30	1.5	7/0.53	0.6	1.7	33.8
50	1.5	7/0.53	0.6	2	43.1

Table-89


XLPE INSULATED INDIVIDUAL & OVERALL SHIELDED UNARMoured LSF CABLES, 300/500V GENERALLY AS PER BS:5308 (Part 1) (Type 1)



No. of Pairs	Cross Sectional Area (mm ²)	Conductor No./ Dia. of Wire (No./mm)	Nom. Insulation Thickness (mm)	Nom. Sheath Thickness (mm)	Approx. Overall Diameter (mm)
2	0.5	1/0.8	0.5	0.9	9.3
5	0.5	1/0.8	0.5	1.2	12.5
10	0.5	1/0.8	0.5	1.2	17.3
15	0.5	1/0.8	0.5	1.3	20.1
20	0.5	1/0.8	0.5	1.3	22.5
30	0.5	1/0.8	0.5	1.5	26.9
50	0.5	1/0.8	0.5	2	35.1
2	0.5	16/0.2	0.6	1.1	11
5	0.5	16/0.2	0.6	1.2	14.2
10	0.5	16/0.2	0.6	1.3	20.1
15	0.5	16/0.2	0.6	1.5	23.5
20	0.5	16/0.2	0.6	1.5	26.3
30	0.5	16/0.2	0.6	1.7	31.3
50	0.5	16/0.2	0.6	2.2	40.7
2	1	1/1.13	0.6	1.1	11.8
5	1	1/1.13	0.6	1.2	15.2
10	1	1/1.13	0.6	1.3	21.6
15	1	1/1.13	0.6	1.5	25.2
20	1	1/1.13	0.6	1.7	28.8
30	1	1/1.13	0.6	2	34.4
50	1	1/1.13	0.6	2.2	43.9
2	1.5	7/0.53	0.6	1.2	13.7
5	1.5	7/0.53	0.6	1.3	17.8
10	1.5	7/0.53	0.6	1.5	25.5
15	1.5	7/0.53	0.6	1.7	29.8
20	1.5	7/0.53	0.6	1.7	33.4
30	1.5	7/0.53	0.6	2	40
50	1.5	7/0.53	0.6	2.2	51.2

Table-90


**XLPE INSULATED OVERALL SHIELDED ARMoured LSF CABLES,
300/500 V GENERALLY AS PER BS:5308 (Part 1) (Type 2)**



No. of Pairs	Cross Sectional Area (mm ²)	Conductor No./ Dia. Of Wire (No/mm)	Nom. Insulation Thickness (mm)	Nom. Sheath Thickness (mm)	Nom. Armour wire dia. (mm)	Nom. Outer sheath thickness (mm)	Approx. Overall Diameter (mm)
1	0.5	1/0.8	0.5	0.8	0.9	1.3	10.2
2	0.5	1/0.8	0.5	0.8	0.9	1.3	11
5	0.5	1/0.8	0.5	1.1	0.9	1.4	15.7
10	0.5	1/0.8	0.5	1.2	1.25	1.6	20.2
15	0.5	1/0.8	0.5	1.2	1.25	1.6	22.3
20	0.5	1/0.8	0.5	1.3	1.6	1.7	25.5
30	0.5	1/0.8	0.5	1.3	1.6	1.8	29.3
50	0.5	1/0.8	0.5	1.5	1.6	2	35.6
1	0.5	16/0.2	0.6	0.8	0.9	1.3	10.9
2	0.5	16/0.2	0.6	0.8	0.9	1.3	11.8
5	0.5	16/0.2	0.6	1.1	0.9	1.5	17.4
10	0.5	16/0.2	0.6	1.2	1.25	1.6	22.4
15	0.5	16/0.2	0.6	1.3	1.6	1.7	25.9
20	0.5	16/0.2	0.6	1.3	1.6	1.8	28.6
30	0.5	16/0.2	0.6	1.5	1.6	1.9	33.4
50	0.5	16/0.2	0.6	1.7	2	2.1	41.6
1	1	1/1.13	0.6	0.8	0.9	1.3	11.3
2	1	1/1.13	0.6	0.8	0.9	1.4	12.5
5	1	1/1.13	0.6	1.2	1.25	1.5	19.2
10	1	1/1.13	0.6	1.2	1.25	1.7	23.8
15	1	1/1.13	0.6	1.3	1.6	1.8	27.6
20	1	1/1.13	0.6	1.5	1.6	1.8	30.7
30	1	1/1.13	0.6	1.5	1.6	2	35.7
50	1	1/1.13	0.6	2	2	2.2	45.2
1	1.5	7/0.53	0.6	0.8	0.9	1.4	12.4
2	1.5	7/0.53	0.6	0.9	0.9	1.4	13.8
5	1.5	7/0.53	0.6	1.2	1.25	1.6	21.6
10	1.5	7/0.53	0.6	1.3	1.6	1.8	27.9
15	1.5	7/0.53	0.6	1.5	1.6	1.9	31.7
20	1.5	7/0.53	0.6	1.5	2	2	36
30	1.5	7/0.53	0.6	1.7	2	2.1	42
50	1.5	7/0.53	0.6	2	2.5	2.4	52.9

Table-91

XLPE INSULATED INDIVIDUAL & OVERALL SHIELDED ARMoured LSF CABLES, 300/500V GENERALLY AS PER BS:5308 (Part 1) (Type 2)



No. of Pairs	Cross Sectional Area (mm ²)	Conductor No./ Dia. Of Wire (No/mm)	Nom. Insulation Thickness (mm)	Nom. Sheath Thickness (mm)	Nom. Armour wire dia. (mm)	Nom. Outer sheath thickness (mm)	Approx. Overall Diameter (mm)
2	0.5	1/0.8	0.5	0.9	0.9	1.4	13.9
5	0.5	1/0.8	0.5	1.2	1.25	1.5	18
10	0.5	1/0.8	0.5	1.2	1.25	1.7	23.2
15	0.5	1/0.8	0.5	1.3	1.6	1.7	26.7
20	0.5	1/0.8	0.5	1.3	1.6	1.8	29.3
30	0.5	1/0.8	0.5	1.5	1.6	1.9	33.9
50	0.5	1/0.8	0.5	2	2	2.2	43.5
2	0.5	16/0.2	0.6	1.1	0.9	1.5	15.8
5	0.5	16/0.2	0.6	1.2	1.25	1.6	19.9
10	0.5	16/0.2	0.6	1.3	1.6	1.8	26.9
15	0.5	16/0.2	0.6	1.5	1.6	1.8	30.3
20	0.5	16/0.2	0.6	1.5	1.6	1.9	33.3
30	0.5	16/0.2	0.6	1.7	2	2.1	39.5
50	0.5	16/0.2	0.6	2.2	2.5	2.4	50.5
2	1	1/1.13	0.6	1.1	0.9	1.5	16.6
5	1	1/1.13	0.6	1.2	1.25	1.6	20.9
10	1	1/1.13	0.6	1.3	1.6	1.8	28.4
15	1	1/1.13	0.6	1.5	1.6	1.9	32.2
20	1	1/1.13	0.6	1.7	2	2	36.8
30	1	1/1.13	0.6	2	2	2.2	42.8
50	1	1/1.13	0.6	2.2	2.5	2.5	53.9
2	1.5	7/0.53	0.6	1.2	1.25	1.6	19.4
5	1.5	7/0.53	0.6	1.3	1.6	1.7	24.4
10	1.5	7/0.53	0.6	1.5	1.6	1.9	32.5
15	1.5	7/0.53	0.6	1.7	2	2	37.8
20	1.5	7/0.53	0.6	1.7	2	2.1	41.6
30	1.5	7/0.53	0.6	2	2.5	2.5	49.8
50	1.5	7/0.53	0.6	2.2	2.5	2.7	61.6

**Single / Multi Pair, PVC Insulated Individual / Overall Shielded,
Armoured / Unarmoured PVC sheathed cables BS: 5308 (Part 2)**

CONSTRUCTION

1 Conductor	: Plain Annealed Copper to BS EN 60228.
2 Insulation	: Polyvinyl chloride (PVC) Type TI 1 to BS 7655
3 Wrapping	: Polyester tape
4 Pair / Overall Shielding	: Aluminium foil in contact with stranded tinned copper drain wire
5 Core / Pair Identification	: Blue & Black coloured cores with pair numbers printed on blue core.
6 Wrapping	: Polyester tape
7 Inner Sheath	: Polyvinyl Chloride(PVC), Type TM 1 to BS 7655
8 Armour	: Galvanised steel round wire (for Type 2 cables only)
9 Outer Sheath	: Polyvinyl Chloride(PVC), Type TM 1 to BS 7655

TECHNICAL INFORMATION

1. Maximum Operating Temperature	: 70 ⁰ C
2. Working Voltage	: 300/500 Volt
3. Test voltage	: 1000 Volt for 1 minute between conductor, and between conductors and screen / armour
4. Max DC Conductor Resistance at 20 ⁰ C	
Conductor Size	: Multipair
0.5 mm ²	: 39.78 Ω/Km
0.75 mm ²	: 26.52 Ω/Km
1.5 mm ²	: 12.34 Ω/Km
5. Minimum insulation Resistance at 20 ⁰ C	
Between individual conductor	: 25 MΩ.Km
Between individual Screen	: 1 MΩ.Km
6. Capacitance	
Maximum mutual capacitance	: 250 pF/m at 1 kHz
Maximum capacitance unbalance	: 400 nF/Km at 1 kHz
7. Maximum L/R ratio	
0.5 mm ²	: 25 μH/Ω
1.0 mm ²	: 25 μH/Ω
1.5 mm ²	: 40 μH/Ω
OPTIONAL FEATURES :	
- Annealed tinned copper conductor on request	
- Flame retardant to IEC 60332-1/IEC 60332-3	
- FR PVC sheathed cables also available	
BENDING RADIUS :	
Unarmoured cable : 6 X Overall Diameter	
Armoured cable : 8 X Overall Diameter	

Table-92


**PVC INSULATED OVERALL SHIELDED UNARMoured CABLES,
300/500V AS PER BS:5308 (Part 2) (Type 1)**



No. of Pairs	Cross Sectional Area (mm ²)	Conductor No./ Dia. Of Wire (No/mm)	Nom. Insulation Thickness (mm)	Nom. Sheath Thickness (mm)	Approx. Overall Diameter (mm)
1	0.5	16/0.2	0.6	0.8	6.5
2	0.5	16/0.2	0.6	0.8	7.4
5	0.5	16/0.2	0.6	1.1	12.6
10	0.5	16/0.2	0.6	1.2	16.7
15	0.5	16/0.2	0.6	1.3	19.3
20	0.5	16/0.2	0.6	1.3	21.8
30	0.5	16/0.2	0.6	1.5	27.4
50	0.5	16/0.2	0.6	1.7	33.4
1	0.75	24/0.2	0.6	0.8	6.8
2	0.75	24/0.2	0.6	0.8	7.8
5	0.75	24/0.2	0.6	1.2	13.8
10	0.75	24/0.2	0.6	1.3	18.2
15	0.75	24/0.2	0.6	1.3	21
20	0.75	24/0.2	0.6	1.5	24
30	0.75	24/0.2	0.6	1.7	29
50	0.75	24/0.2	0.6	2	36.9
1	1.5	7 / 0.53	0.6	0.8	7.8
2	1.5	7 / 0.53	0.6	0.9	9.2
5	1.5	7 / 0.53	0.6	1.2	15.9
10	1.5	7 / 0.53	0.6	1.3	21.1
15	1.5	7 / 0.53	0.6	1.5	24.7
20	1.5	7 / 0.53	0.6	1.5	28
30	1.5	7 / 0.53	0.6	1.7	33.8
50	1.5	7 / 0.53	0.6	2	43.1

Table-93


**PVC INSULATED INDIVIDUAL & OVERALL SHIELDED
UNARMoured CABLES, 300/500 V AS PER BS:5308 (Part 2) (Type 1)**



No. of Pairs	Cross Sectional Area (mm ²)	Conductor No./ Dia. Of Wire (No/mm)	Nom. Insulation Thickness (mm)	Nom. Sheath Thickness (mm)	Approx. Overall Diameter (mm)
2	0.5	16/0.2	0.6	1.1	11
5	0.5	16/0.2	0.6	1.2	14.2
10	0.5	16/0.2	0.6	1.3	20.1
15	0.5	16/0.2	0.6	1.5	23.5
20	0.5	16/0.2	0.6	1.5	26.3
30	0.5	16/0.2	0.6	1.7	31.3
50	0.5	16/0.2	0.6	2.2	40.7
2	0.75	24 / 0.2	0.6	1.1	11.8
5	0.75	24 / 0.2	0.6	1.2	15.3
10	0.75	24 / 0.2	0.6	1.3	21.7
15	0.75	24 / 0.2	0.6	1.5	25.4
20	0.75	24 / 0.2	0.6	1.7	28.8
30	0.75	24 / 0.2	0.6	2	34.5
50	0.75	24 / 0.2	0.6	2.2	44
2	1.5	7 / 0.53	0.6	1.2	13.7
5	1.5	7 / 0.53	0.6	1.3	17.8
10	1.5	7 / 0.53	0.6	1.5	25.5
15	1.5	7 / 0.53	0.6	1.7	29.8
20	1.5	7 / 0.53	0.6	1.7	33.4
30	1.5	7 / 0.53	0.6	2	40
50	1.5	7 / 0.53	0.6	2.2	51.2

Table-94


**PVC INSULATED OVERALL SHIELDED ARMoured CABLES,
300/500V AS PER BS:5308 (Part 2) (Type 2)**



No. of Pairs	Cross Sectional Area (mm ²)	Conductor No./ Dia. Of Wire (No/mm)	Nom. Insulation Thickness (mm)	Nom. Sheath Thickness (mm)	Nom. Armour wire dia. (mm)	Nom Outer sheath thickness (mm)	Approx. Overall Diameter (mm)
1	0.5	16/0.2	0.6	0.8	0.9	1.3	10.9
2	0.5	16/0.2	0.6	0.8	0.9	1.3	11.8
5	0.5	16/0.2	0.6	1.1	0.9	1.6	17.4
10	0.5	16/0.2	0.6	1.2	1.25	1.6	22.4
15	0.5	16/0.2	0.6	1.3	1.6	1.7	25.9
20	0.5	16/0.2	0.6	1.3	1.6	1.8	28.6
30	0.5	16/0.2	0.6	1.5	1.6	1.9	33.4
50	0.5	16/0.2	0.6	1.7	2	2.1	41.6
1	0.75	24/0.2	0.6	0.8	0.9	1.3	11.2
2	0.75	24/0.2	0.6	0.8	0.9	1.4	12.4
5	0.75	24/0.2	0.6	1.2	1.25	1.5	19.3
10	0.75	24/0.2	0.6	1.3	1.6	1.7	24.8
15	0.75	24/0.2	0.6	1.3	1.6	1.8	27.7
20	0.75	24/0.2	0.6	1.5	1.6	1.8	30.8
30	0.75	24/0.2	0.6	1.7	2	2	37
50	0.75	24/0.2	0.6	2	2.5	2.3	46.5
1	1.5	7 / 0.53	0.6	0.8	0.9	1.4	12.4
2	1.5	7 / 0.53	0.6	0.9	0.9	1.4	13.8
5	1.5	7 / 0.53	0.6	1.2	1.25	1.6	21.6
10	1.5	7 / 0.53	0.6	1.3	1.6	1.8	27.9
15	1.5	7 / 0.53	0.6	1.5	1.6	1.9	31.7
20	1.5	7 / 0.53	0.6	1.5	1.6	2	35.2
30	1.5	7 / 0.53	0.6	1.7	2	2.1	42
50	1.5	7 / 0.53	0.6	2	2.5	2.4	52.9


Table-95

**PVC INSULATED INDIVIDUAL & OVERALL SHIELDED
ARMoured CABLES, 300/500V AS PER BS:5308 (Part 2) (Type 2)**



No. of Pairs	Cross Sectional Area (mm ²)	Conductor No./ Dia. of Wire (No/mm)	Nom. Insulation Thickness (mm)	Nom. Sheath Thickness (mm)	Nom. Armour wire dia. (mm)	Nom. Outer sheath thickness (mm)	Approx. Overall Diameter (mm)
2	0.5	16/0.2	0.6	1.1	0.9	1.5	15.8
5	0.5	16/0.2	0.6	1.2	1.25	1.6	19.9
10	0.5	16/0.2	0.6	1.3	1.6	1.8	26.9
15	0.5	16/0.2	0.6	1.5	1.6	1.8	30.3
20	0.5	16/0.2	0.6	1.5	1.6	1.9	33.3
30	0.5	16/0.2	0.6	1.7	2	2.1	39.5
50	0.5	16/0.2	0.6	2.2	2.5	2.4	50.5
2	0.75	24 / 0.2	0.6	1.1	0.9	1.5	16.6
5	0.75	24 / 0.2	0.6	1.2	1.25	1.6	21
10	0.75	24 / 0.2	0.6	1.3	1.6	1.8	28.5
15	0.75	24 / 0.2	0.6	1.5	1.6	1.9	32.4
20	0.75	24 / 0.2	0.6	1.7	2	2	36.8
30	0.75	24 / 0.2	0.6	2	2	2.2	42.9
50	0.75	24 / 0.2	0.6	2.2	2.5	2.5	54
2	1.5	7 / 0.53	0.6	1.2	1.25	1.6	19.4
5	1.5	7 / 0.53	0.6	1.3	1.6	1.7	24.4
10	1.5	7 / 0.53	0.6	1.5	1.6	1.9	32.5
15	1.5	7 / 0.53	0.6	1.7	2	2	37.8
20	1.5	7 / 0.53	0.6	1.7	2	2.1	41.8
30	1.5	7 / 0.53	0.6	2	2.5	2.4	49.8
50	1.5	7 / 0.53	0.6	2.2	2.5	2.7	61.6

ENSURE QUALITY AND TIMELY DELIVERY

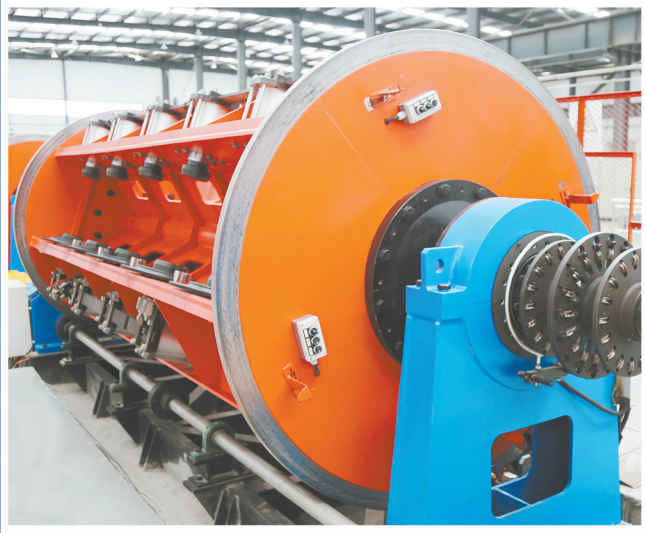





UAE CABLE®



Full Arabic legal name
Full English legal name

يولان لصناعة الكابلات الكهربائية ذ.م.م
YU LAN ELECTRICAL CABLE MANUFACTURING
LLC

الاسم القانوني الكامل باللغة العربية
الاسم القانوني الكامل باللغة الانجليزية

Registered address

UMM THAOB 7, UNION STREET, UMM THAOB,
UMM AL QUWAIN, Umm Al-Quwain, United
Arab Emirates, 39371, +971547116666
100556645800003

العنوان المسجل

Tax Registration Number

رقم التسجيل الضريبي

Note: that this product is for export only, not for use in UAE